

Risk Management

PCL and SDI




August 14, 2024

Boise Fire CA-SRF-000729

7,223 Acres

Acres from IR and GPS - August 13 | 21:30

- California Fire History (20 years)
- Potential Control Location (PCL) Suitability
POD Line Summary
 - Very Low (0-10)
 - 10.1-25
 - 25.1-50
 - 50.1-75
- Suppression Difficulty Index (SDI) 90th
Percentile POD Line Summary
 - Lowest Difficulty (0-10)
 - 10.1-20
 - 20.1-40
 - 40.1-70
 - 70.1-100
 - Highest Difficulty (>100.1)
- Ownership
 - Bureau of Indian Affairs (BIA)
 - US Forest Service (USFS)
 - Private

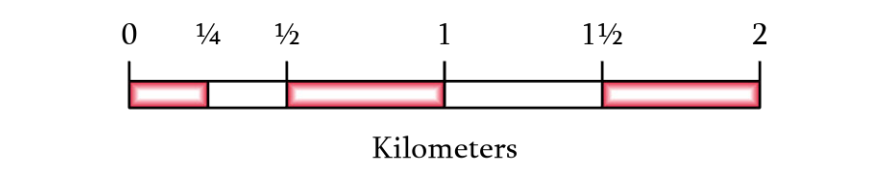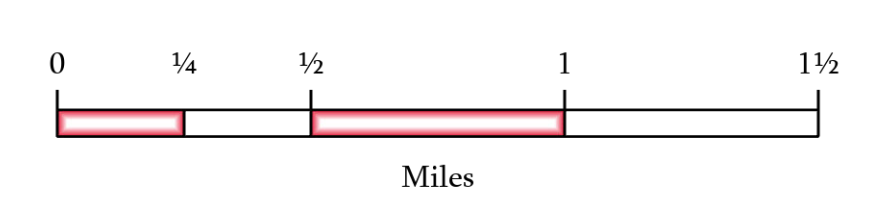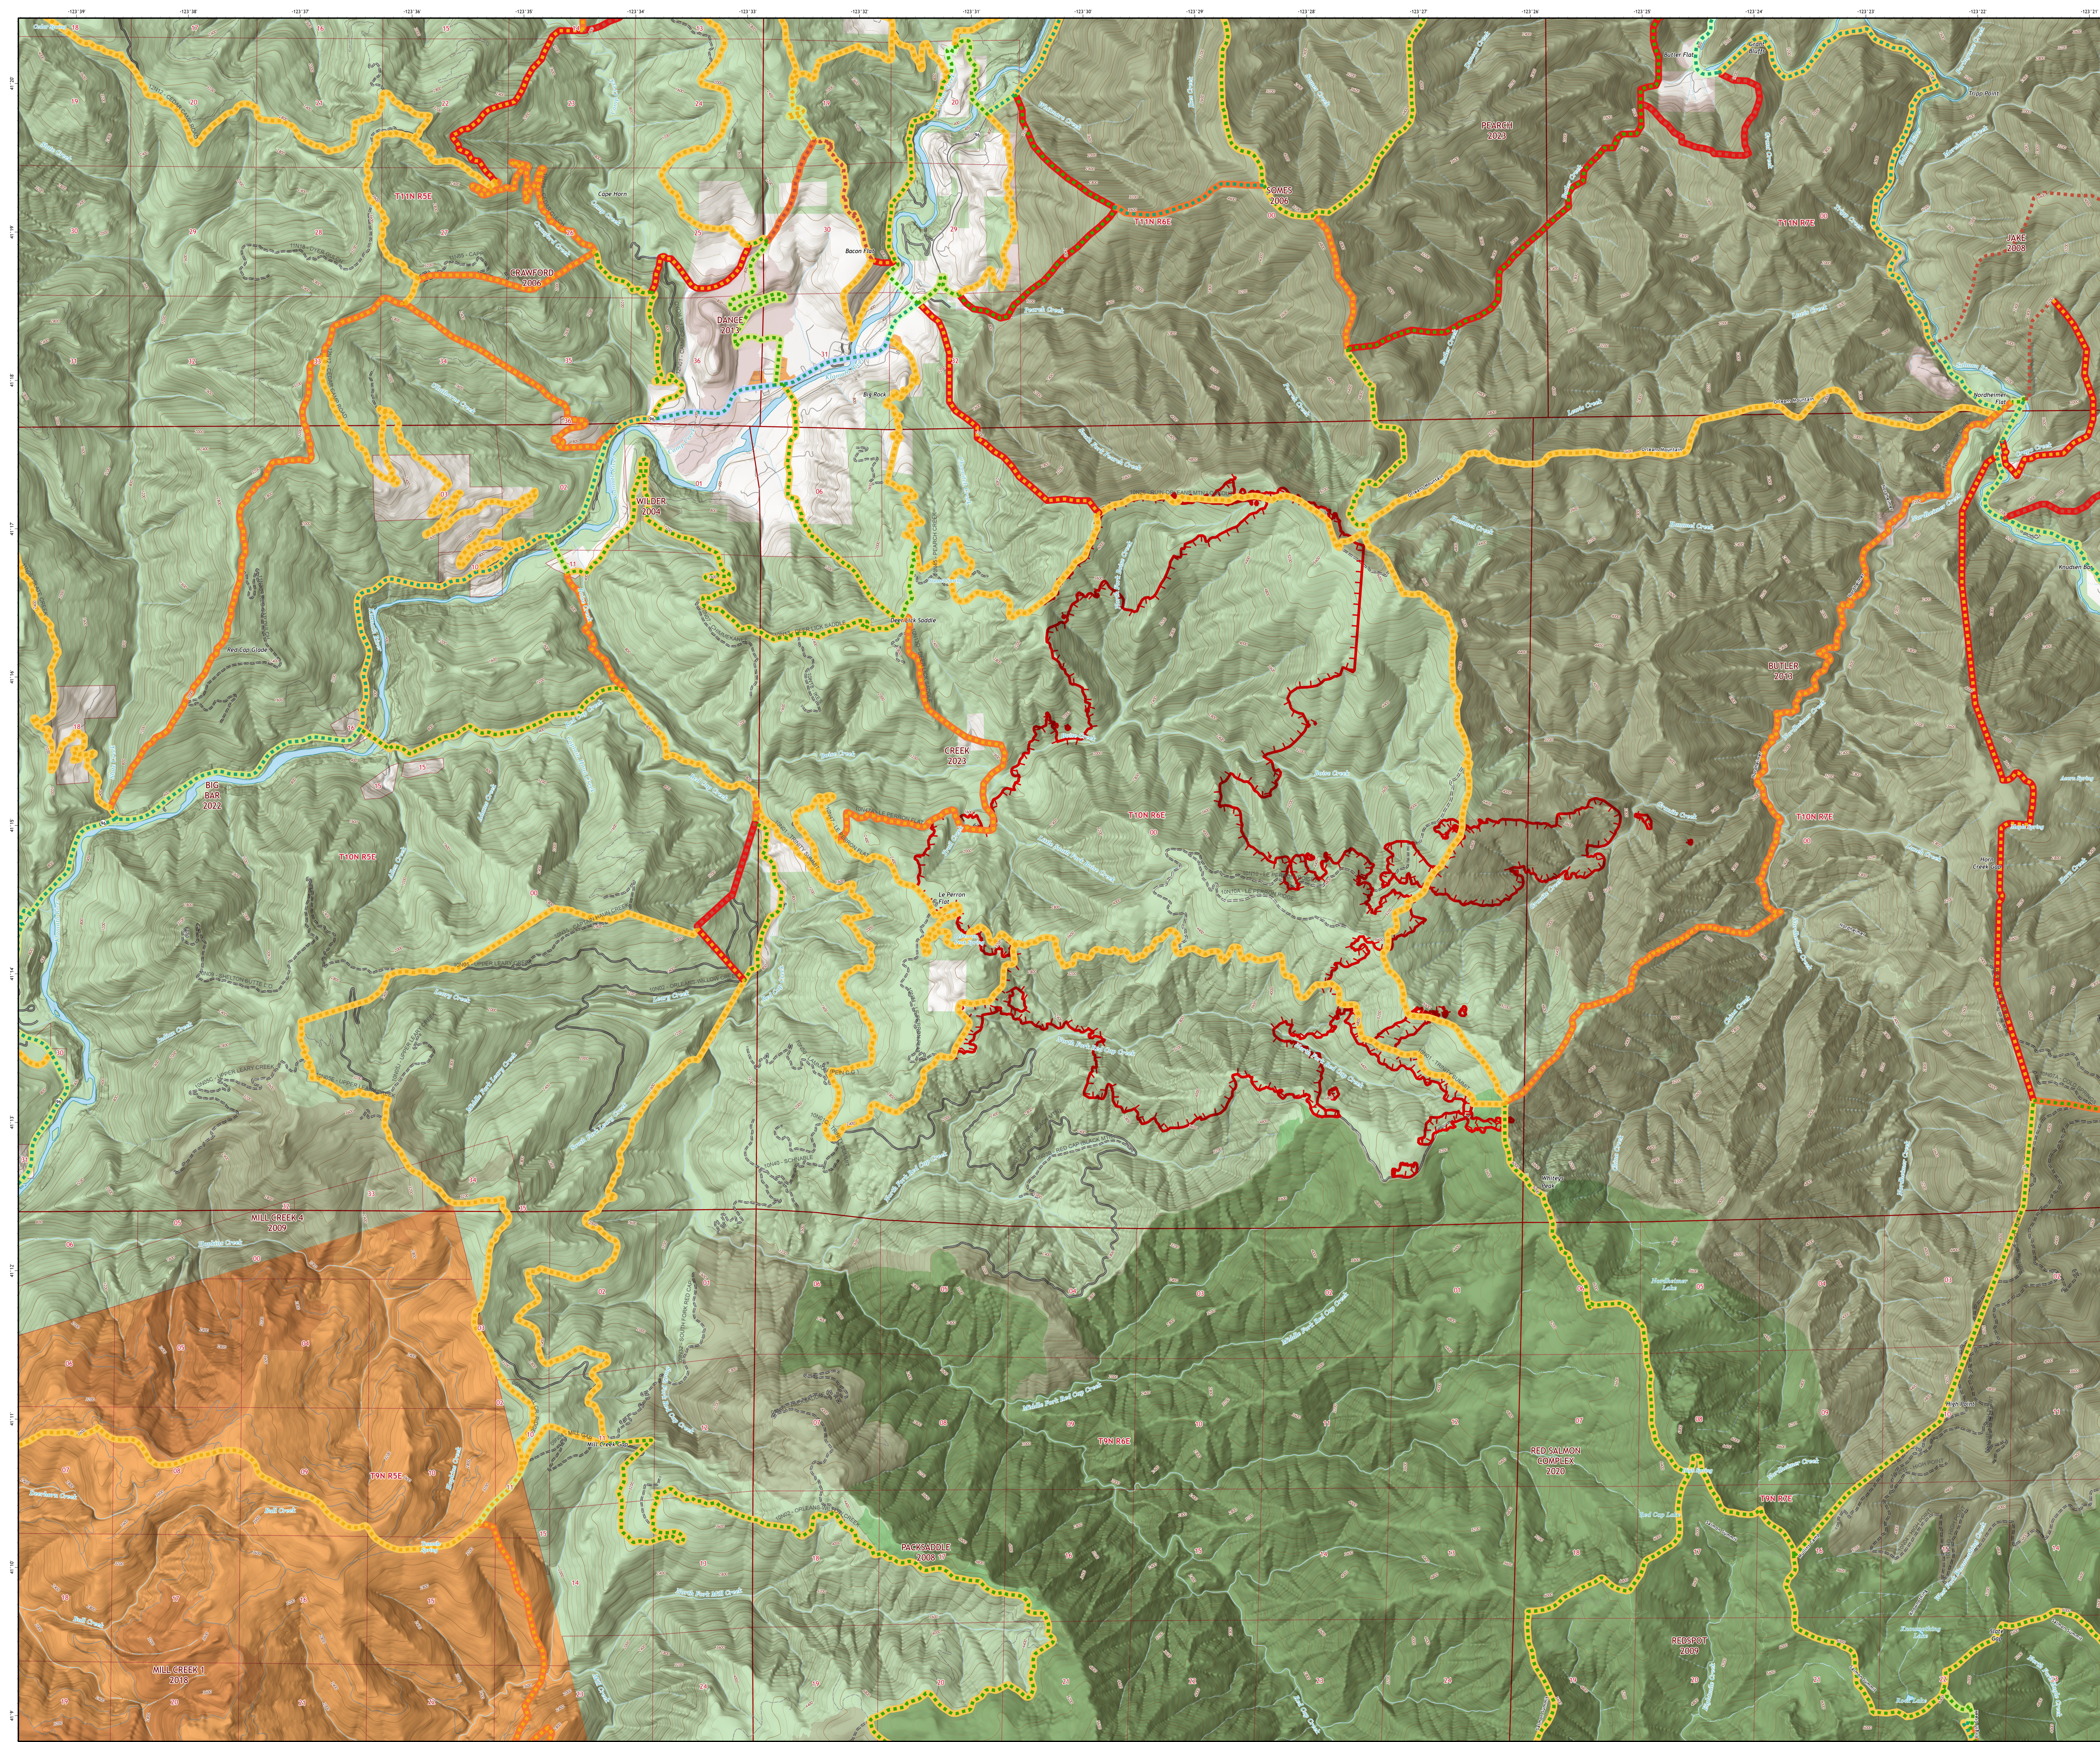

1:24,000