






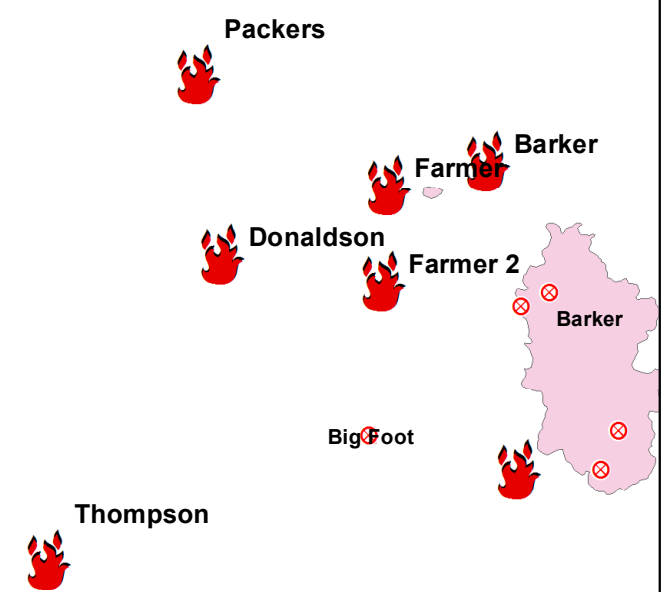
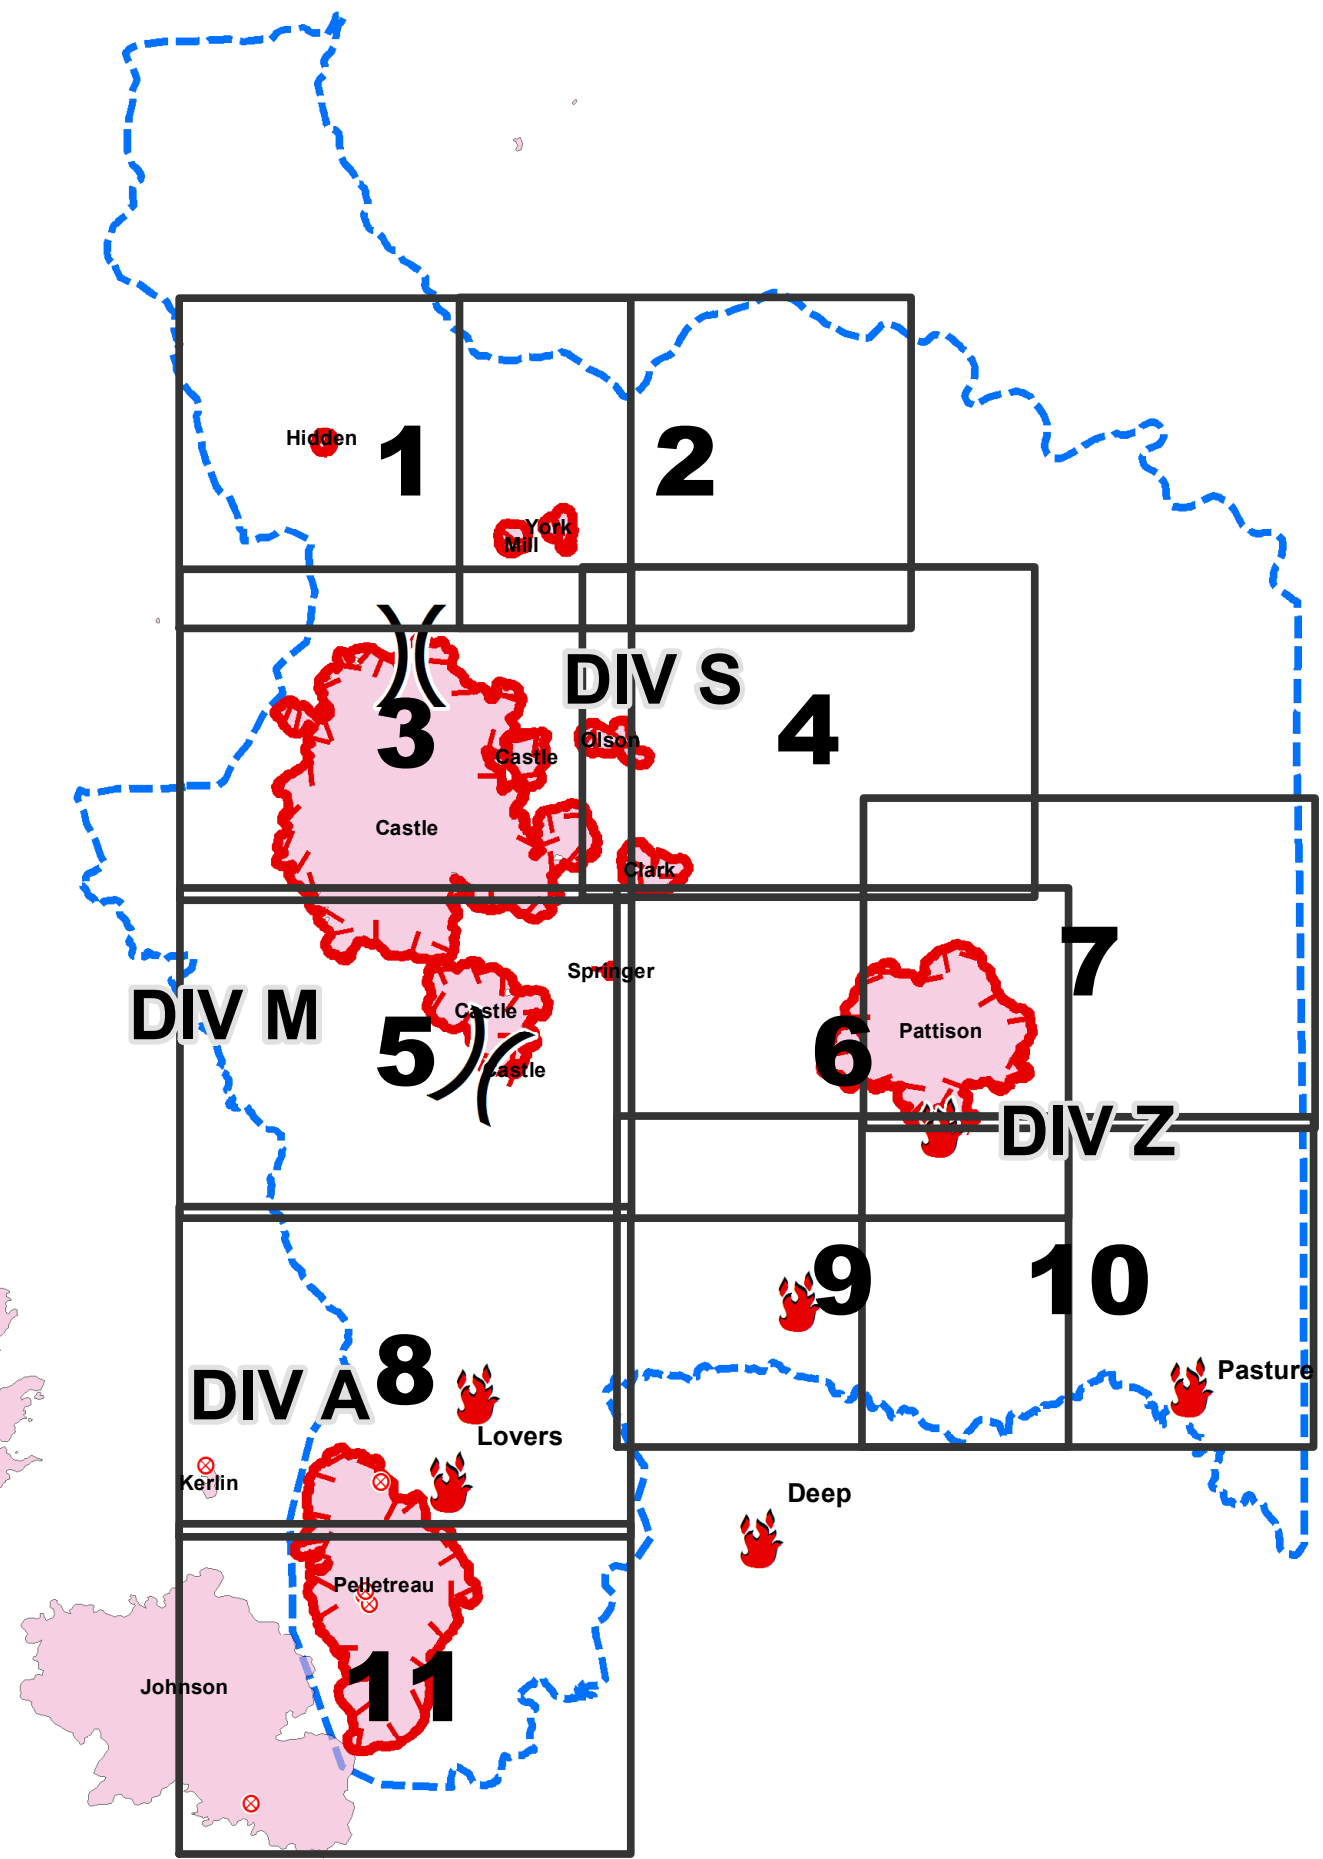
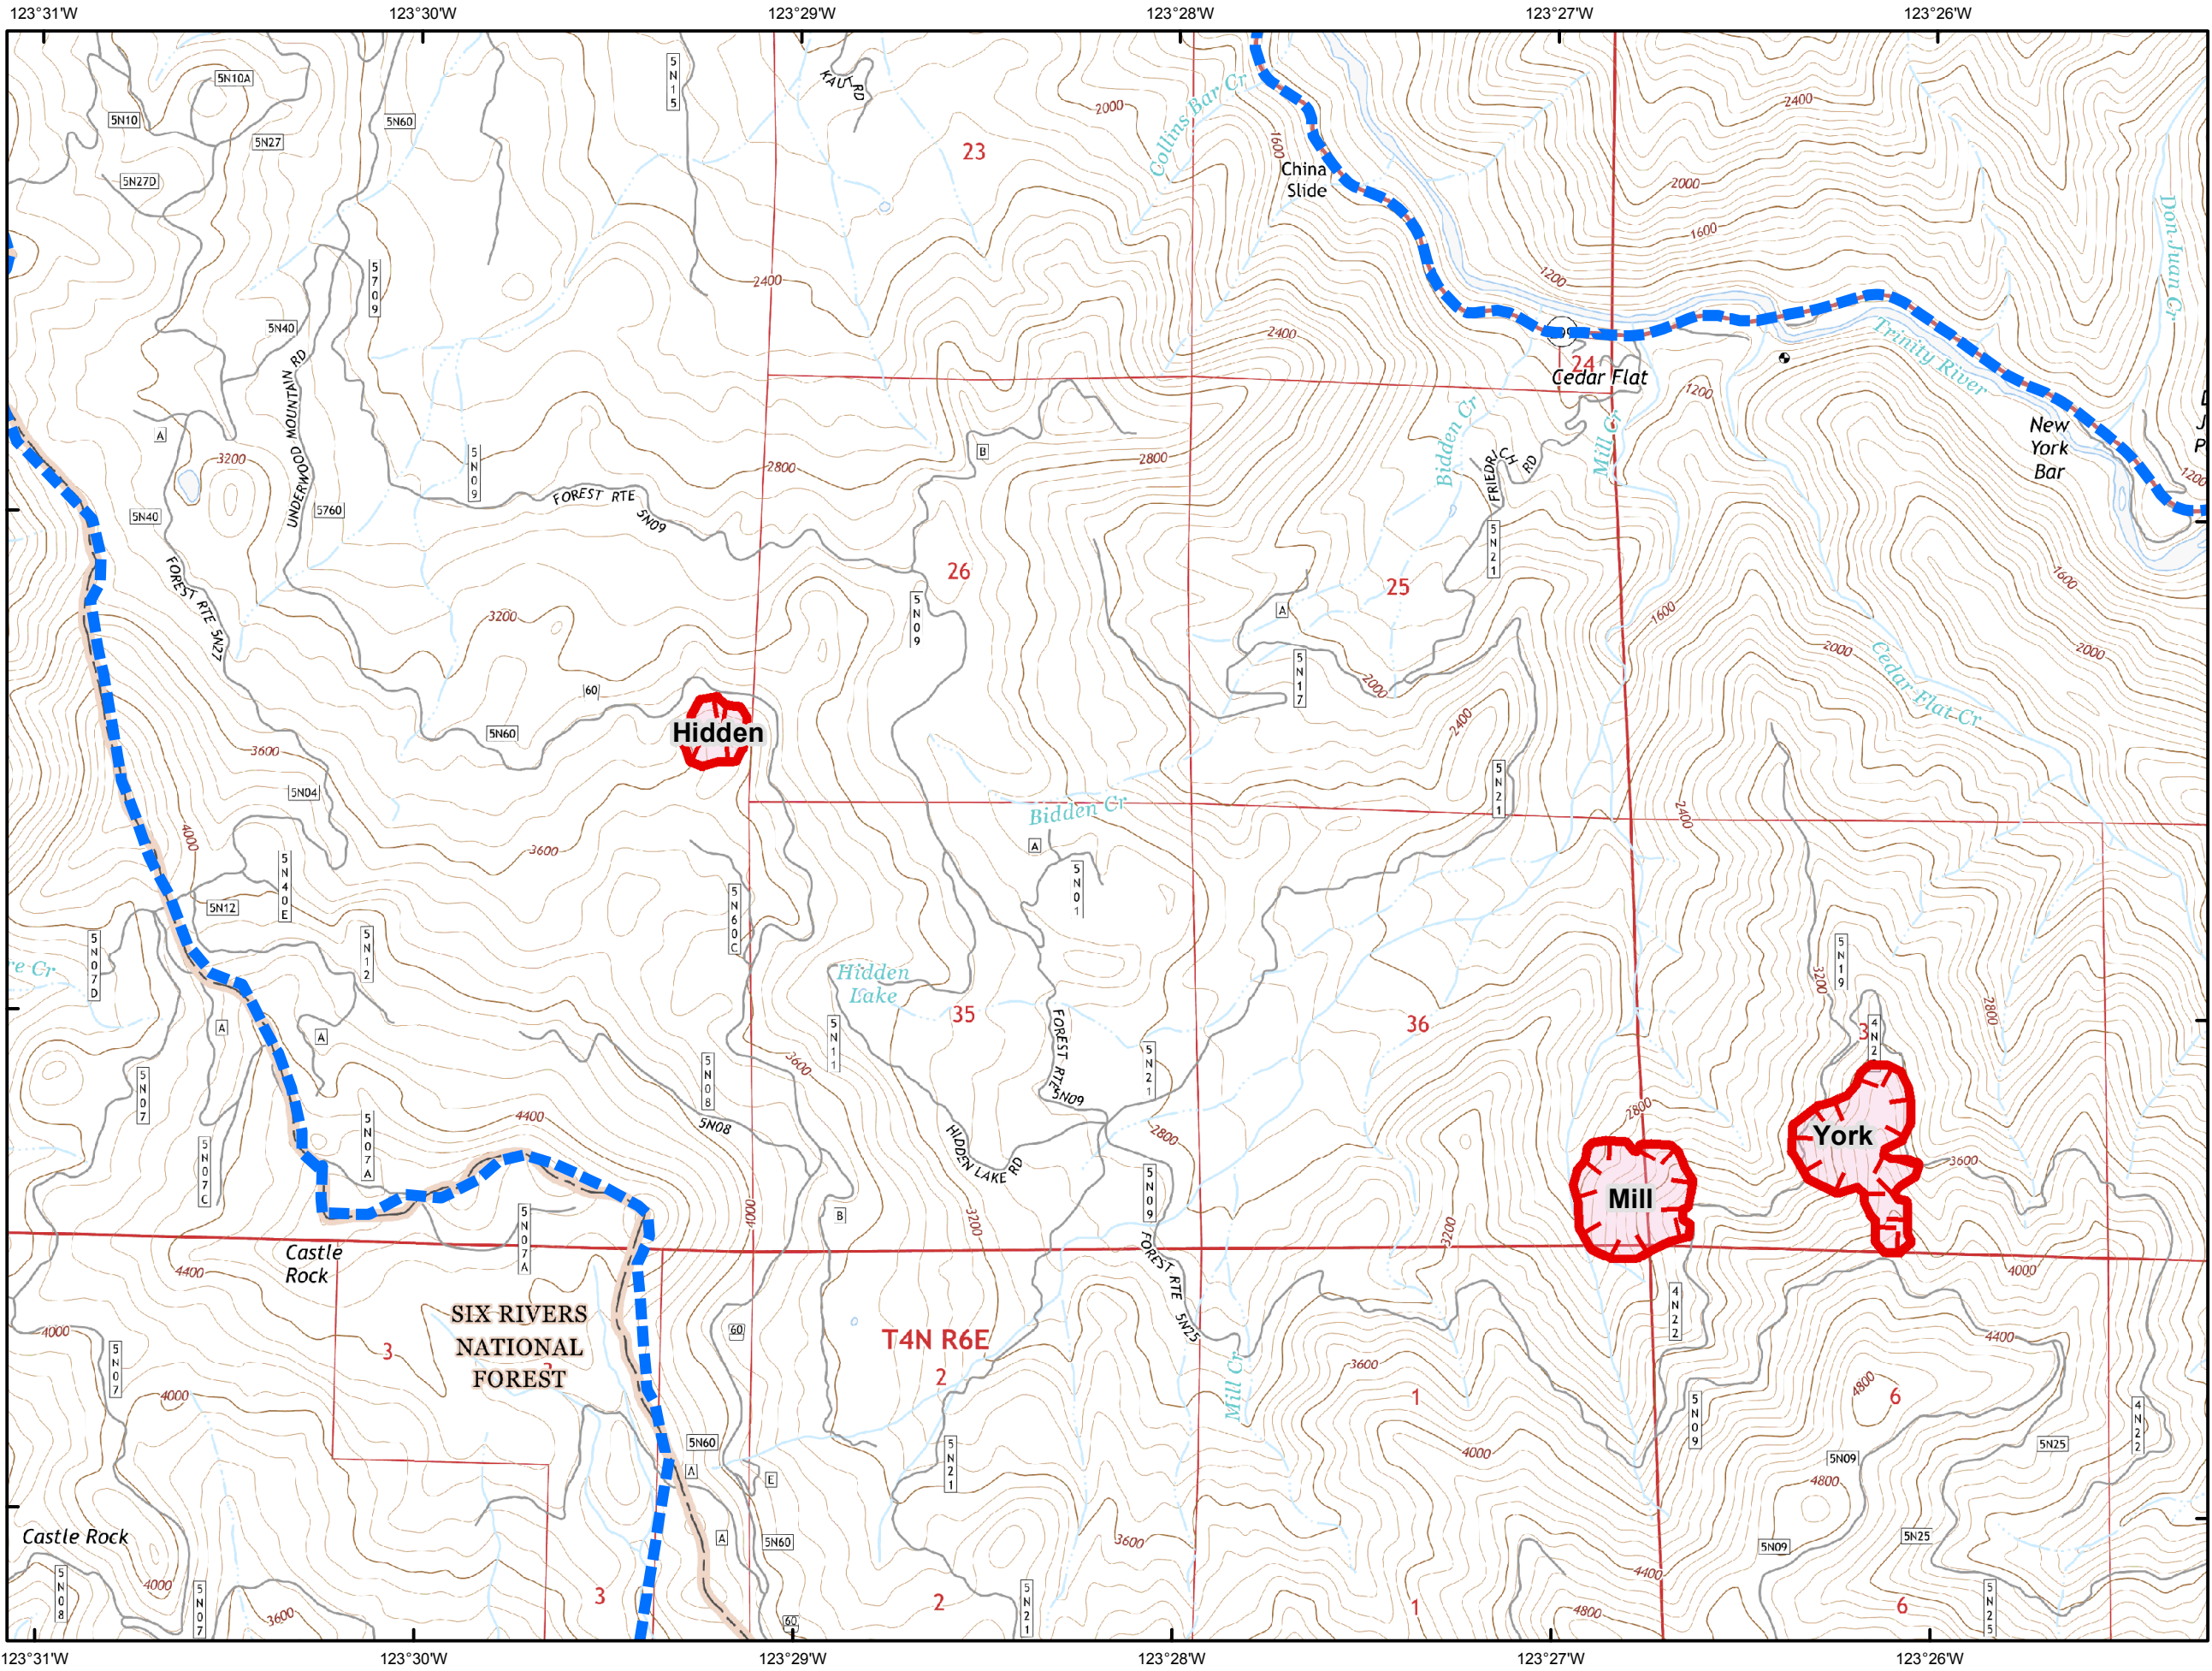


# South Complex CA-SHF-002108

## IAP Index Map August 3, 2015 Day Shift

-  Fire Location
-  Fire Origin
-  Incident Command Post
-  Uncontrolled Fire Edge
-  Completed Line
-  South Complex Area (Approximate)
-  IAP\_Grid\_Index







**South Complex  
CA-SHF-002108**

**IAP Map  
August 3, 2015  
Day Shift**

**Page 1**

-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)



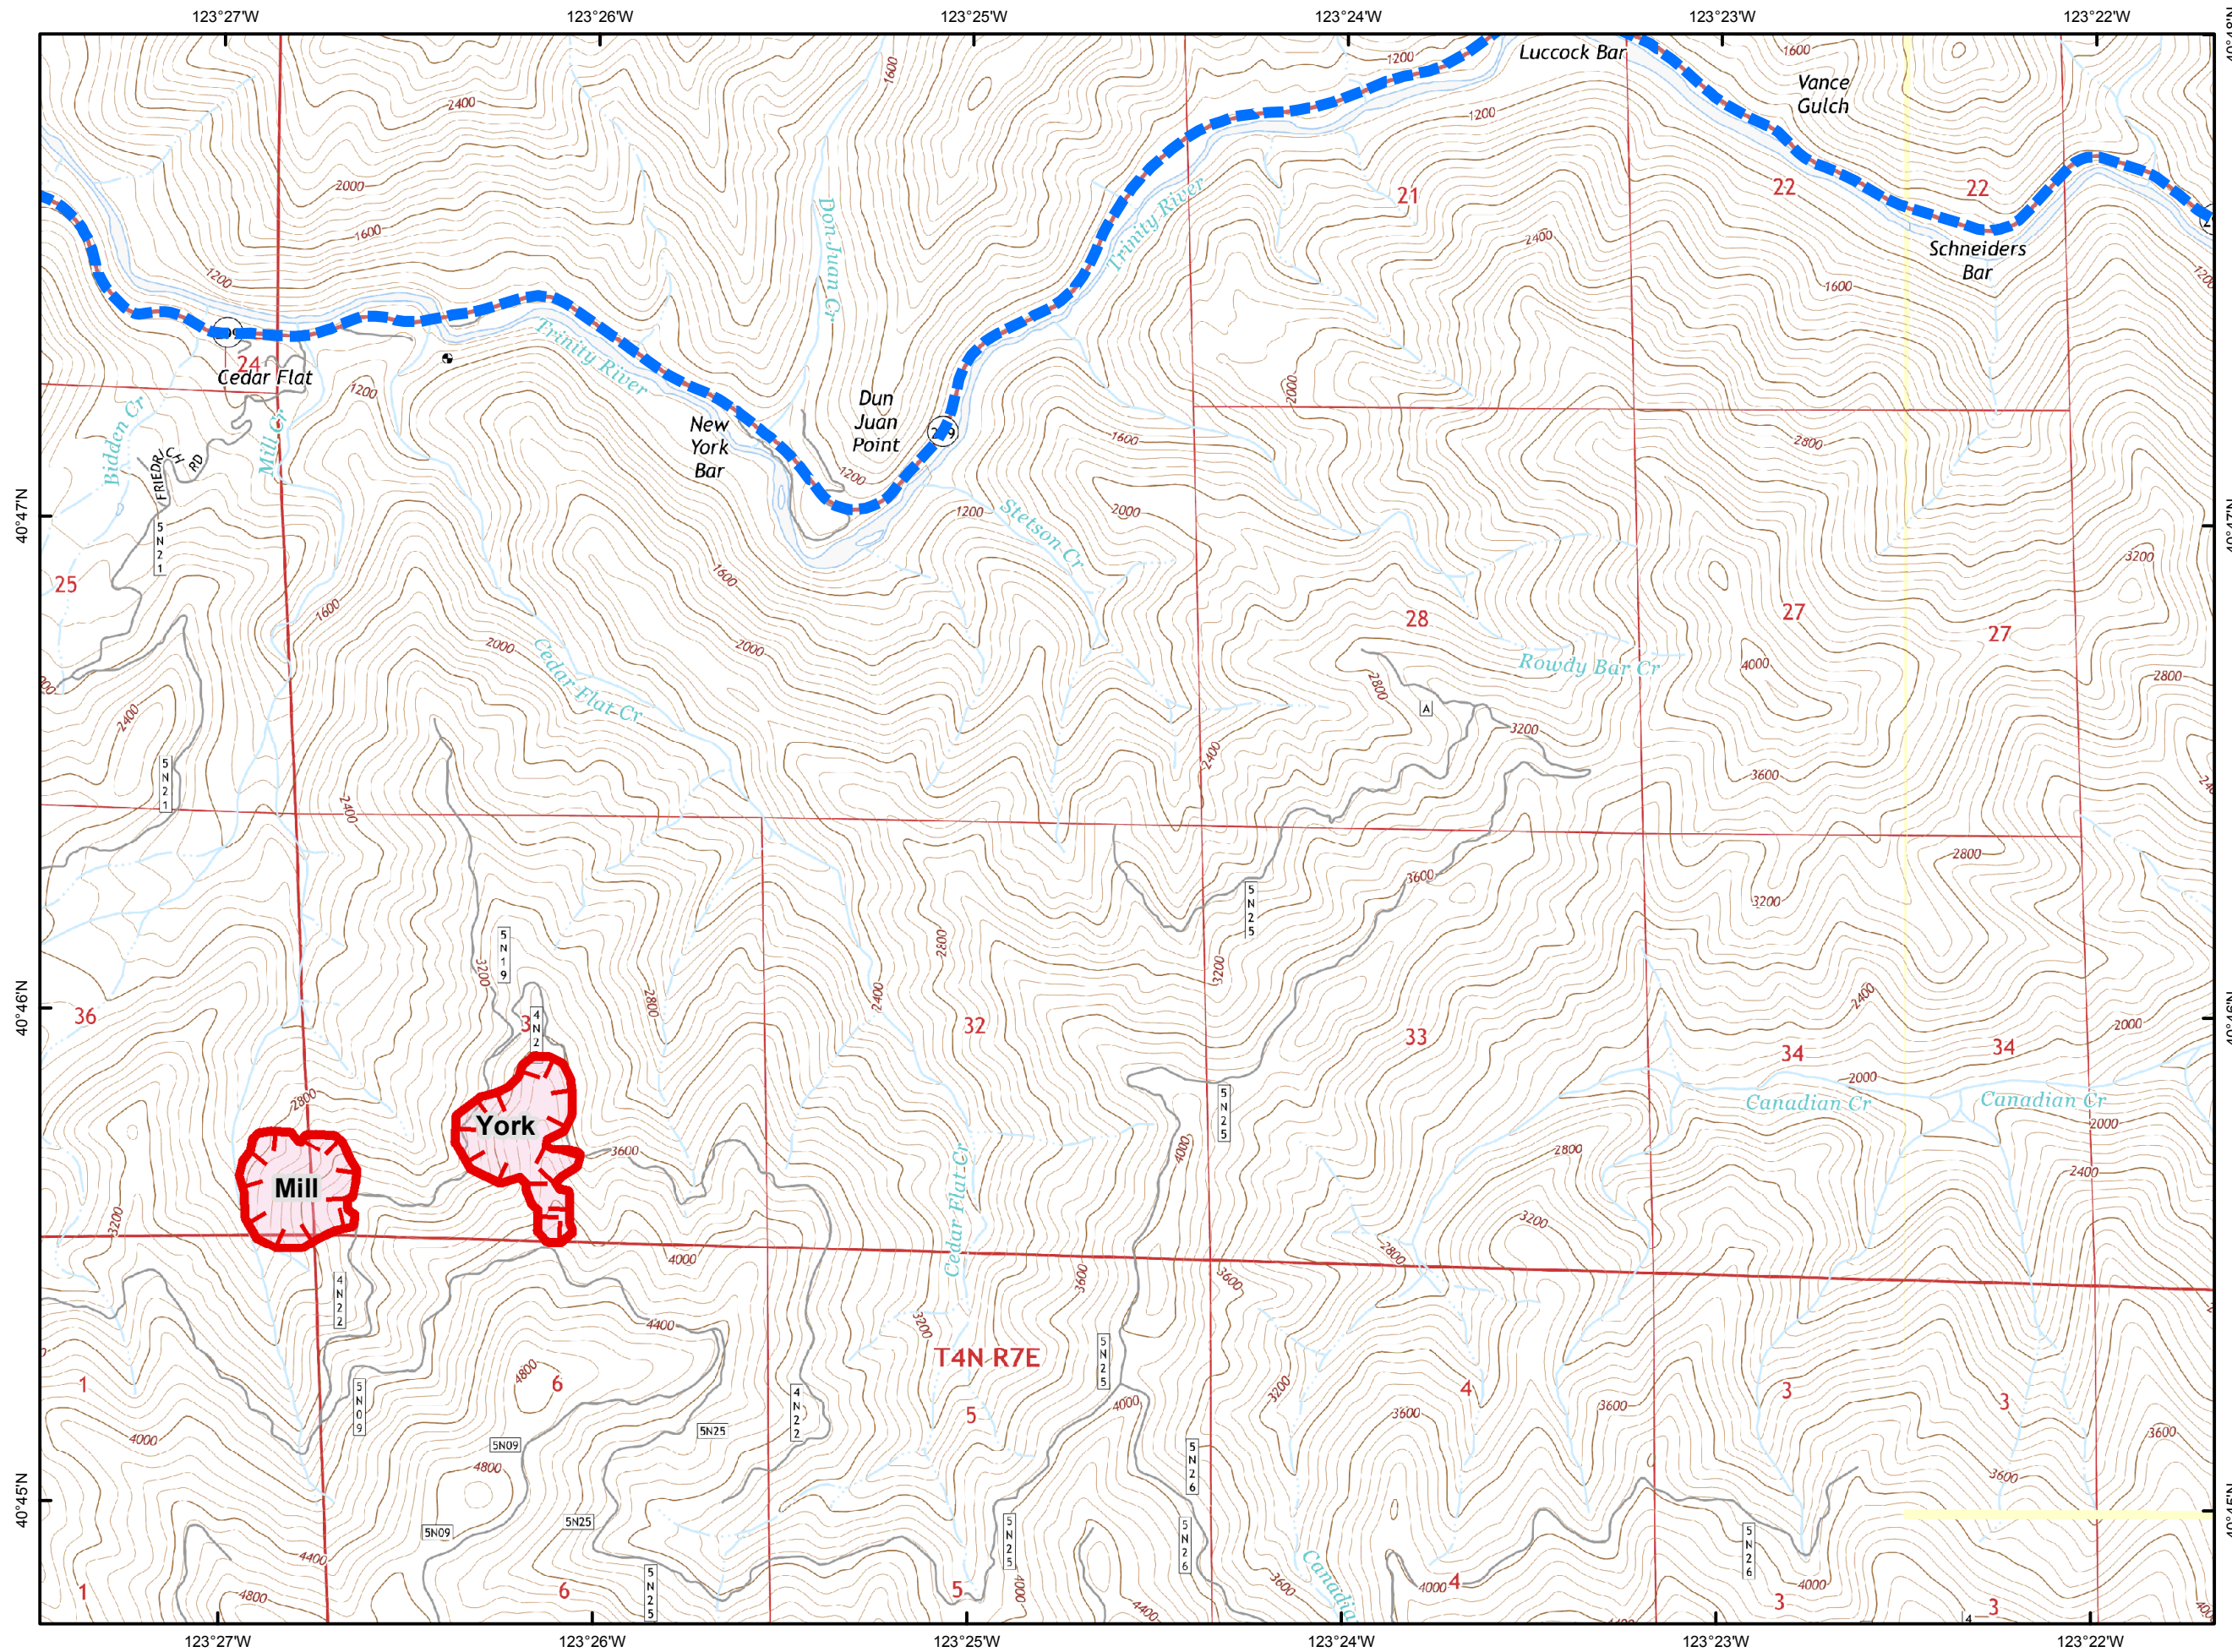
0 0.5 Miles





**South Complex  
CA-SHF-002108**

**IAP Map  
August 3, 2015  
Day Shift**

**Page 2**

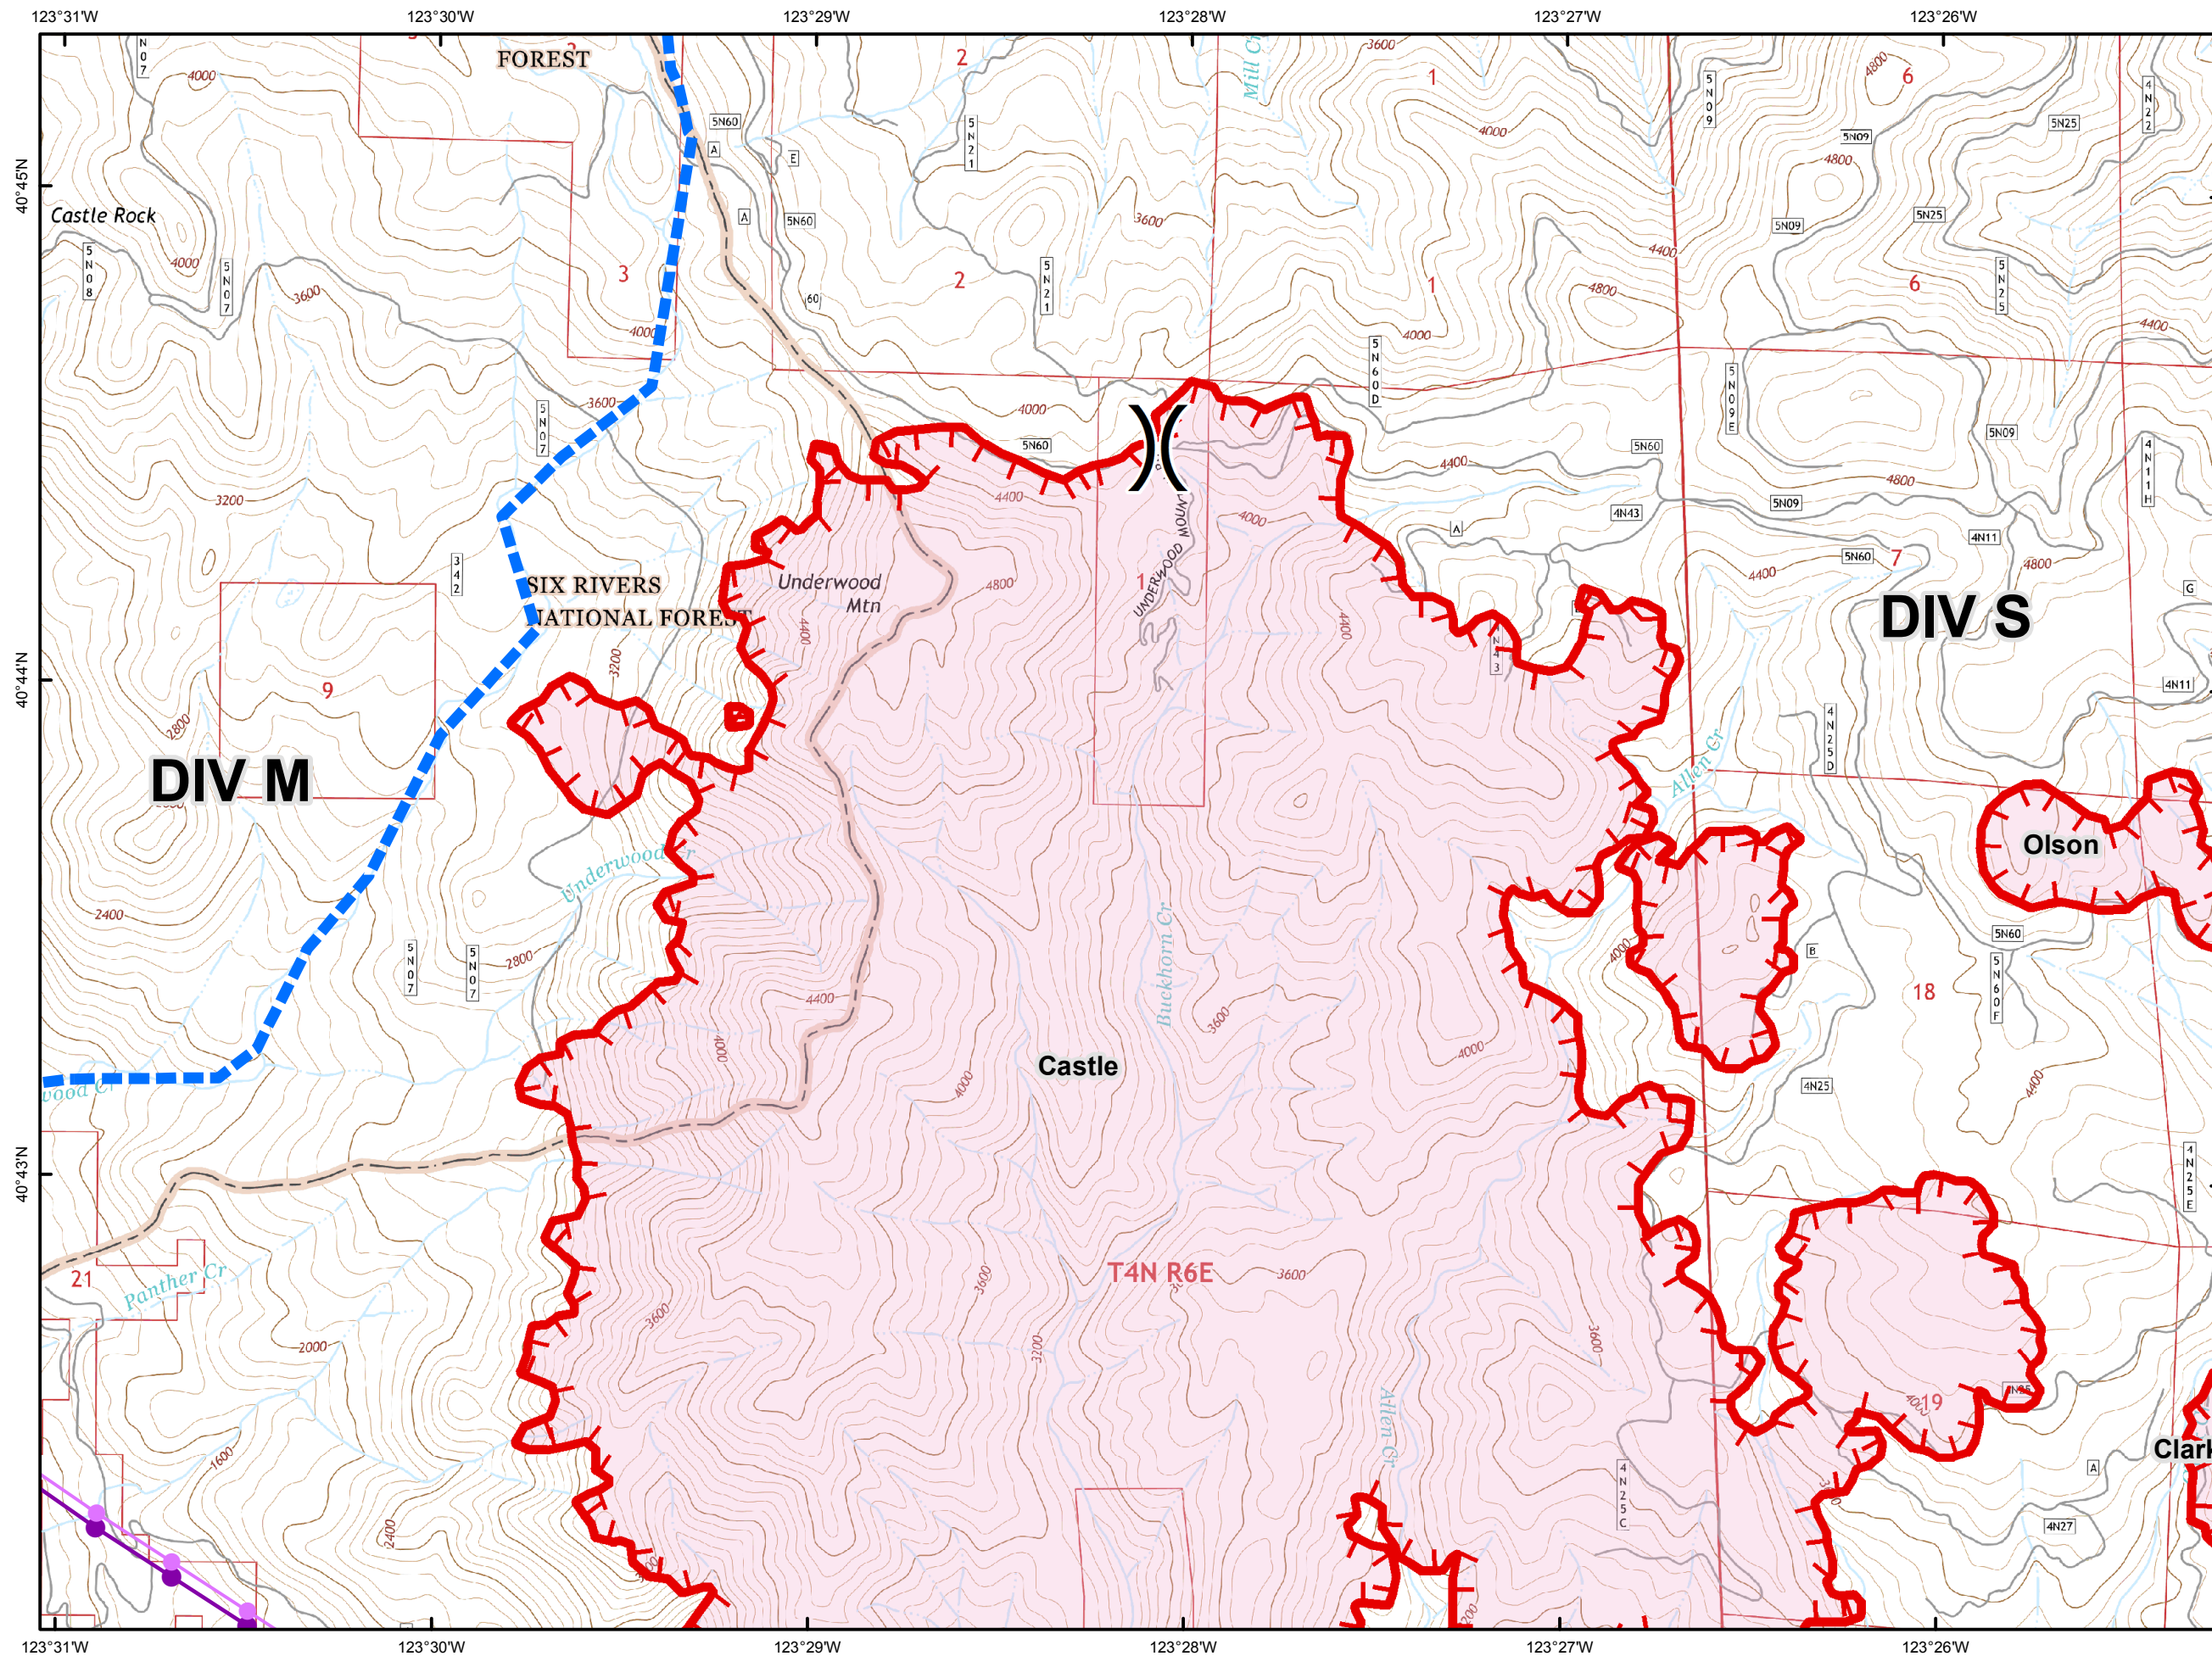


-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)



0 0.5 Miles





- Uncontrolled Fire Edge
- South Complex Boundary (Approximate)
- 100-161 KV Powerline
- Under 100 KV Powerline



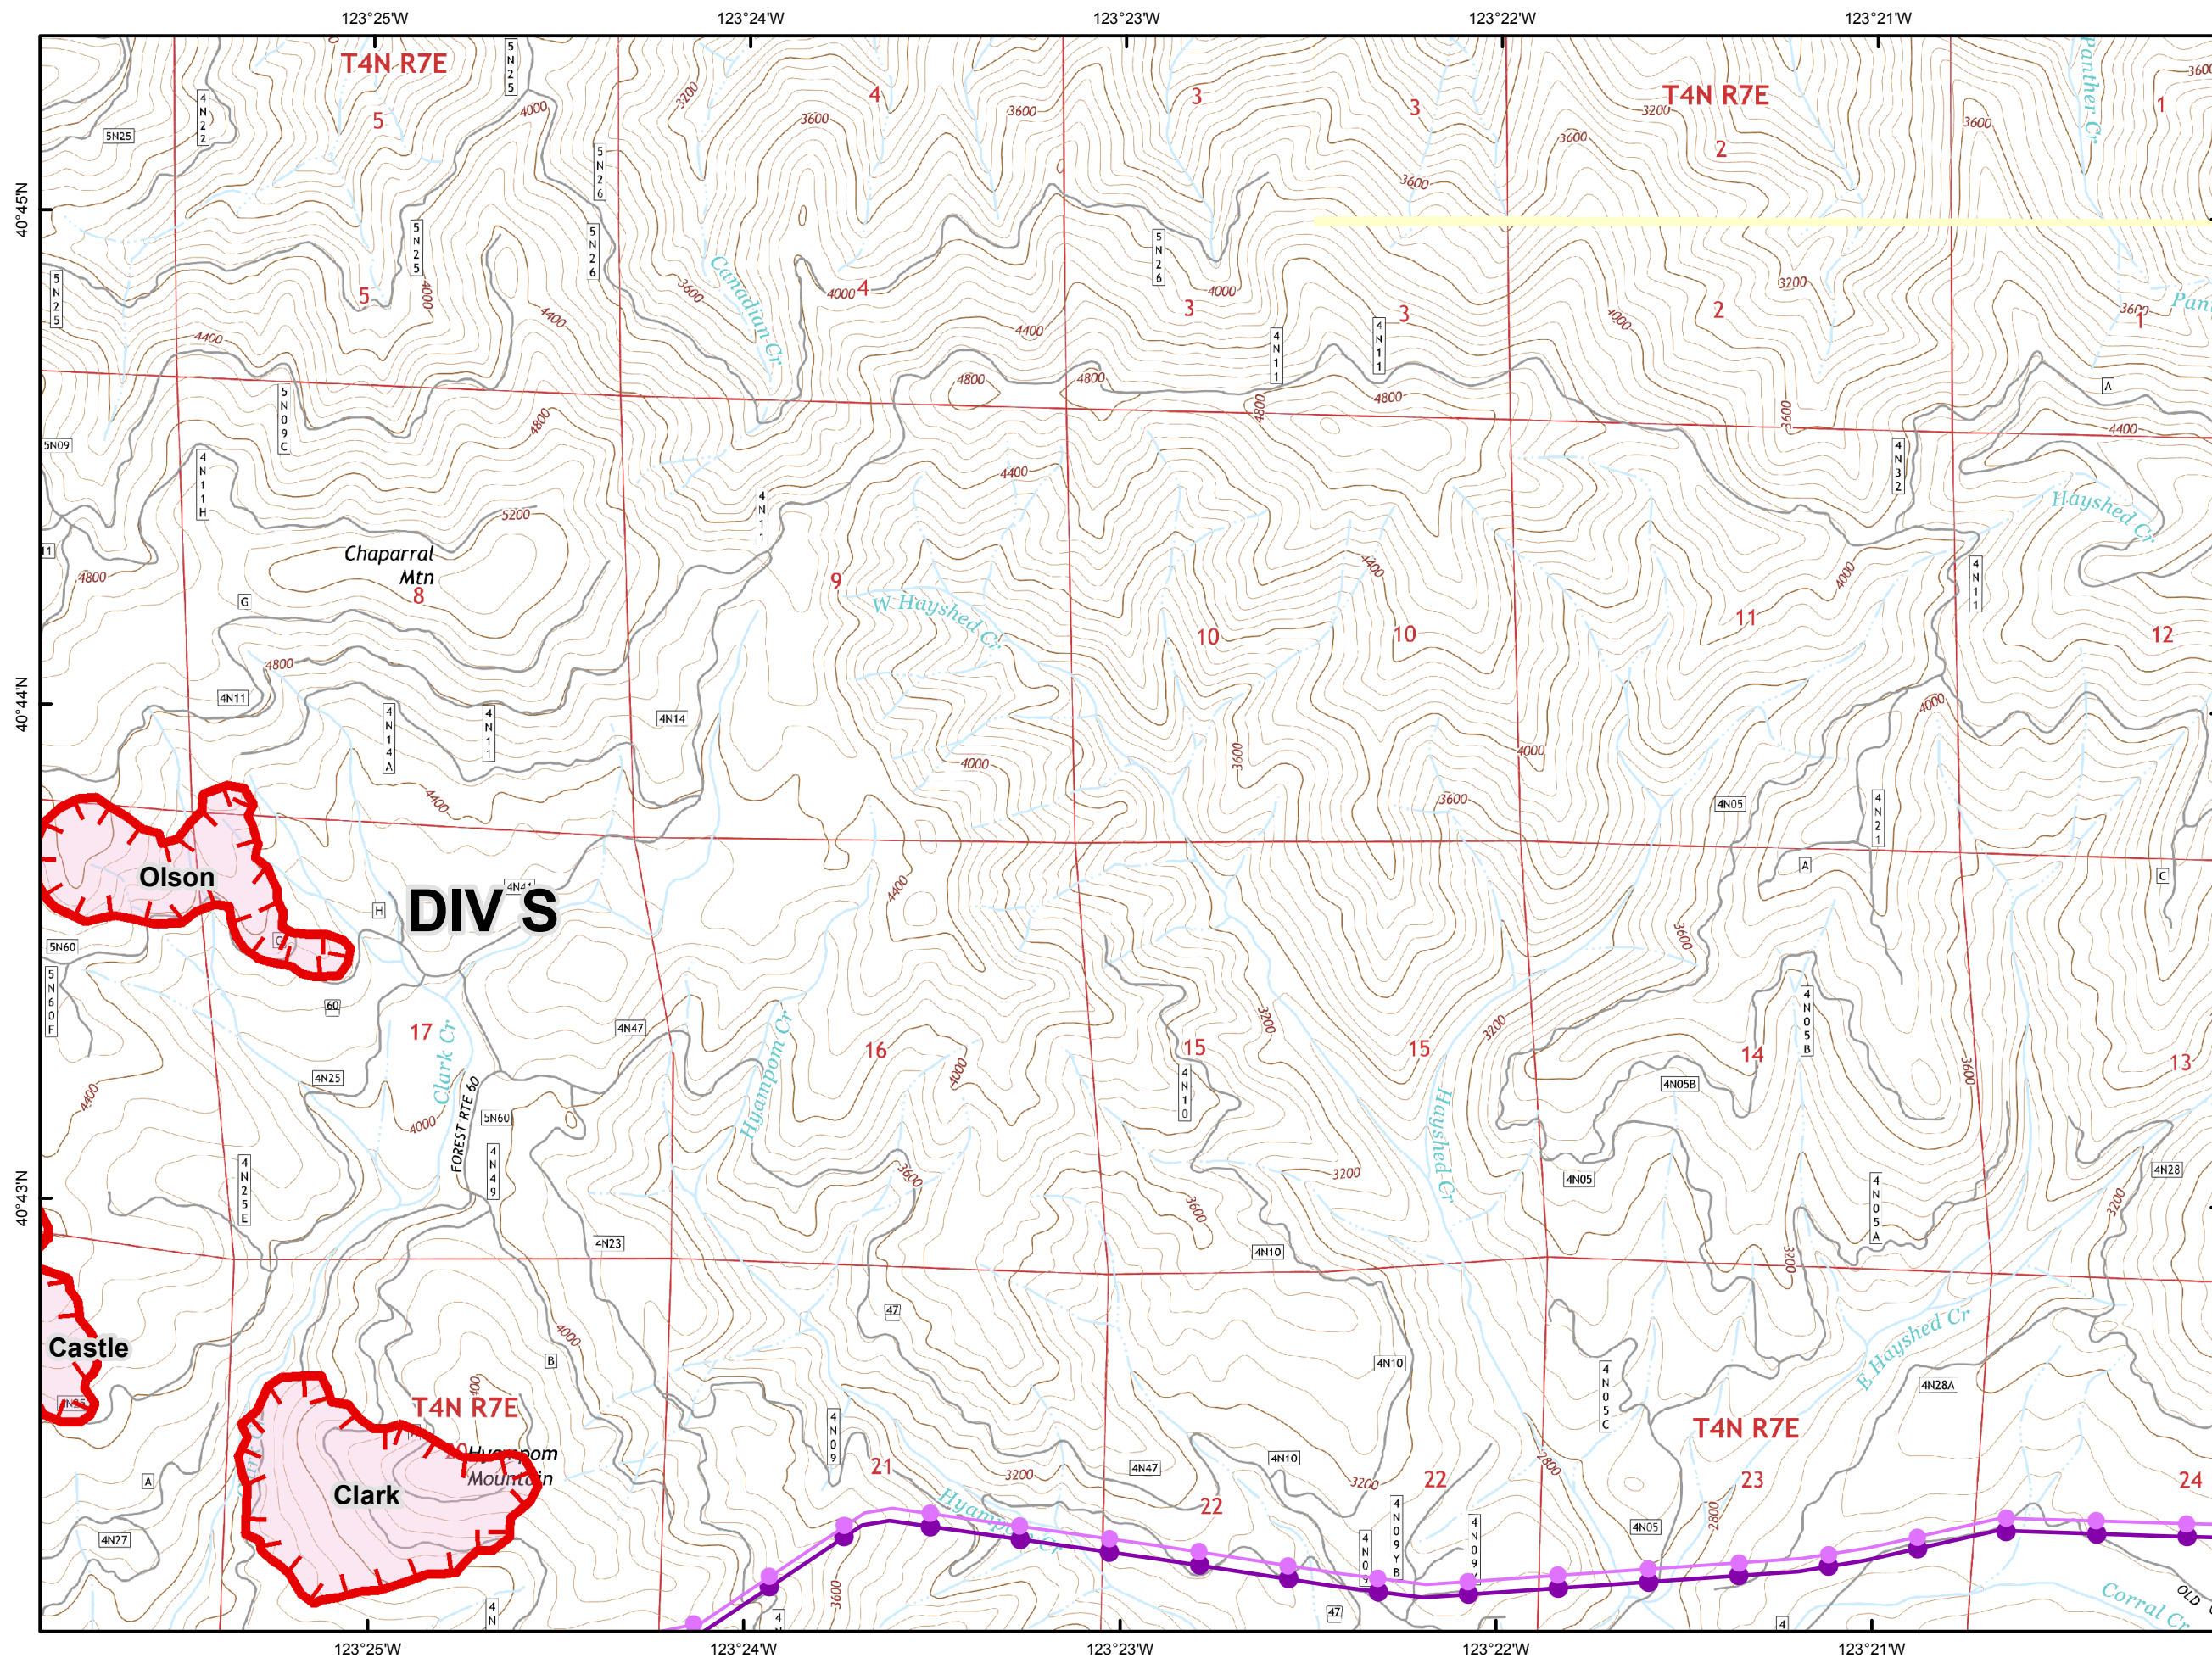
0 0.5 Miles







South Complex  
CA-SHF-002108

IAP Map  
August 3, 2015  
Day Shift

Page 4

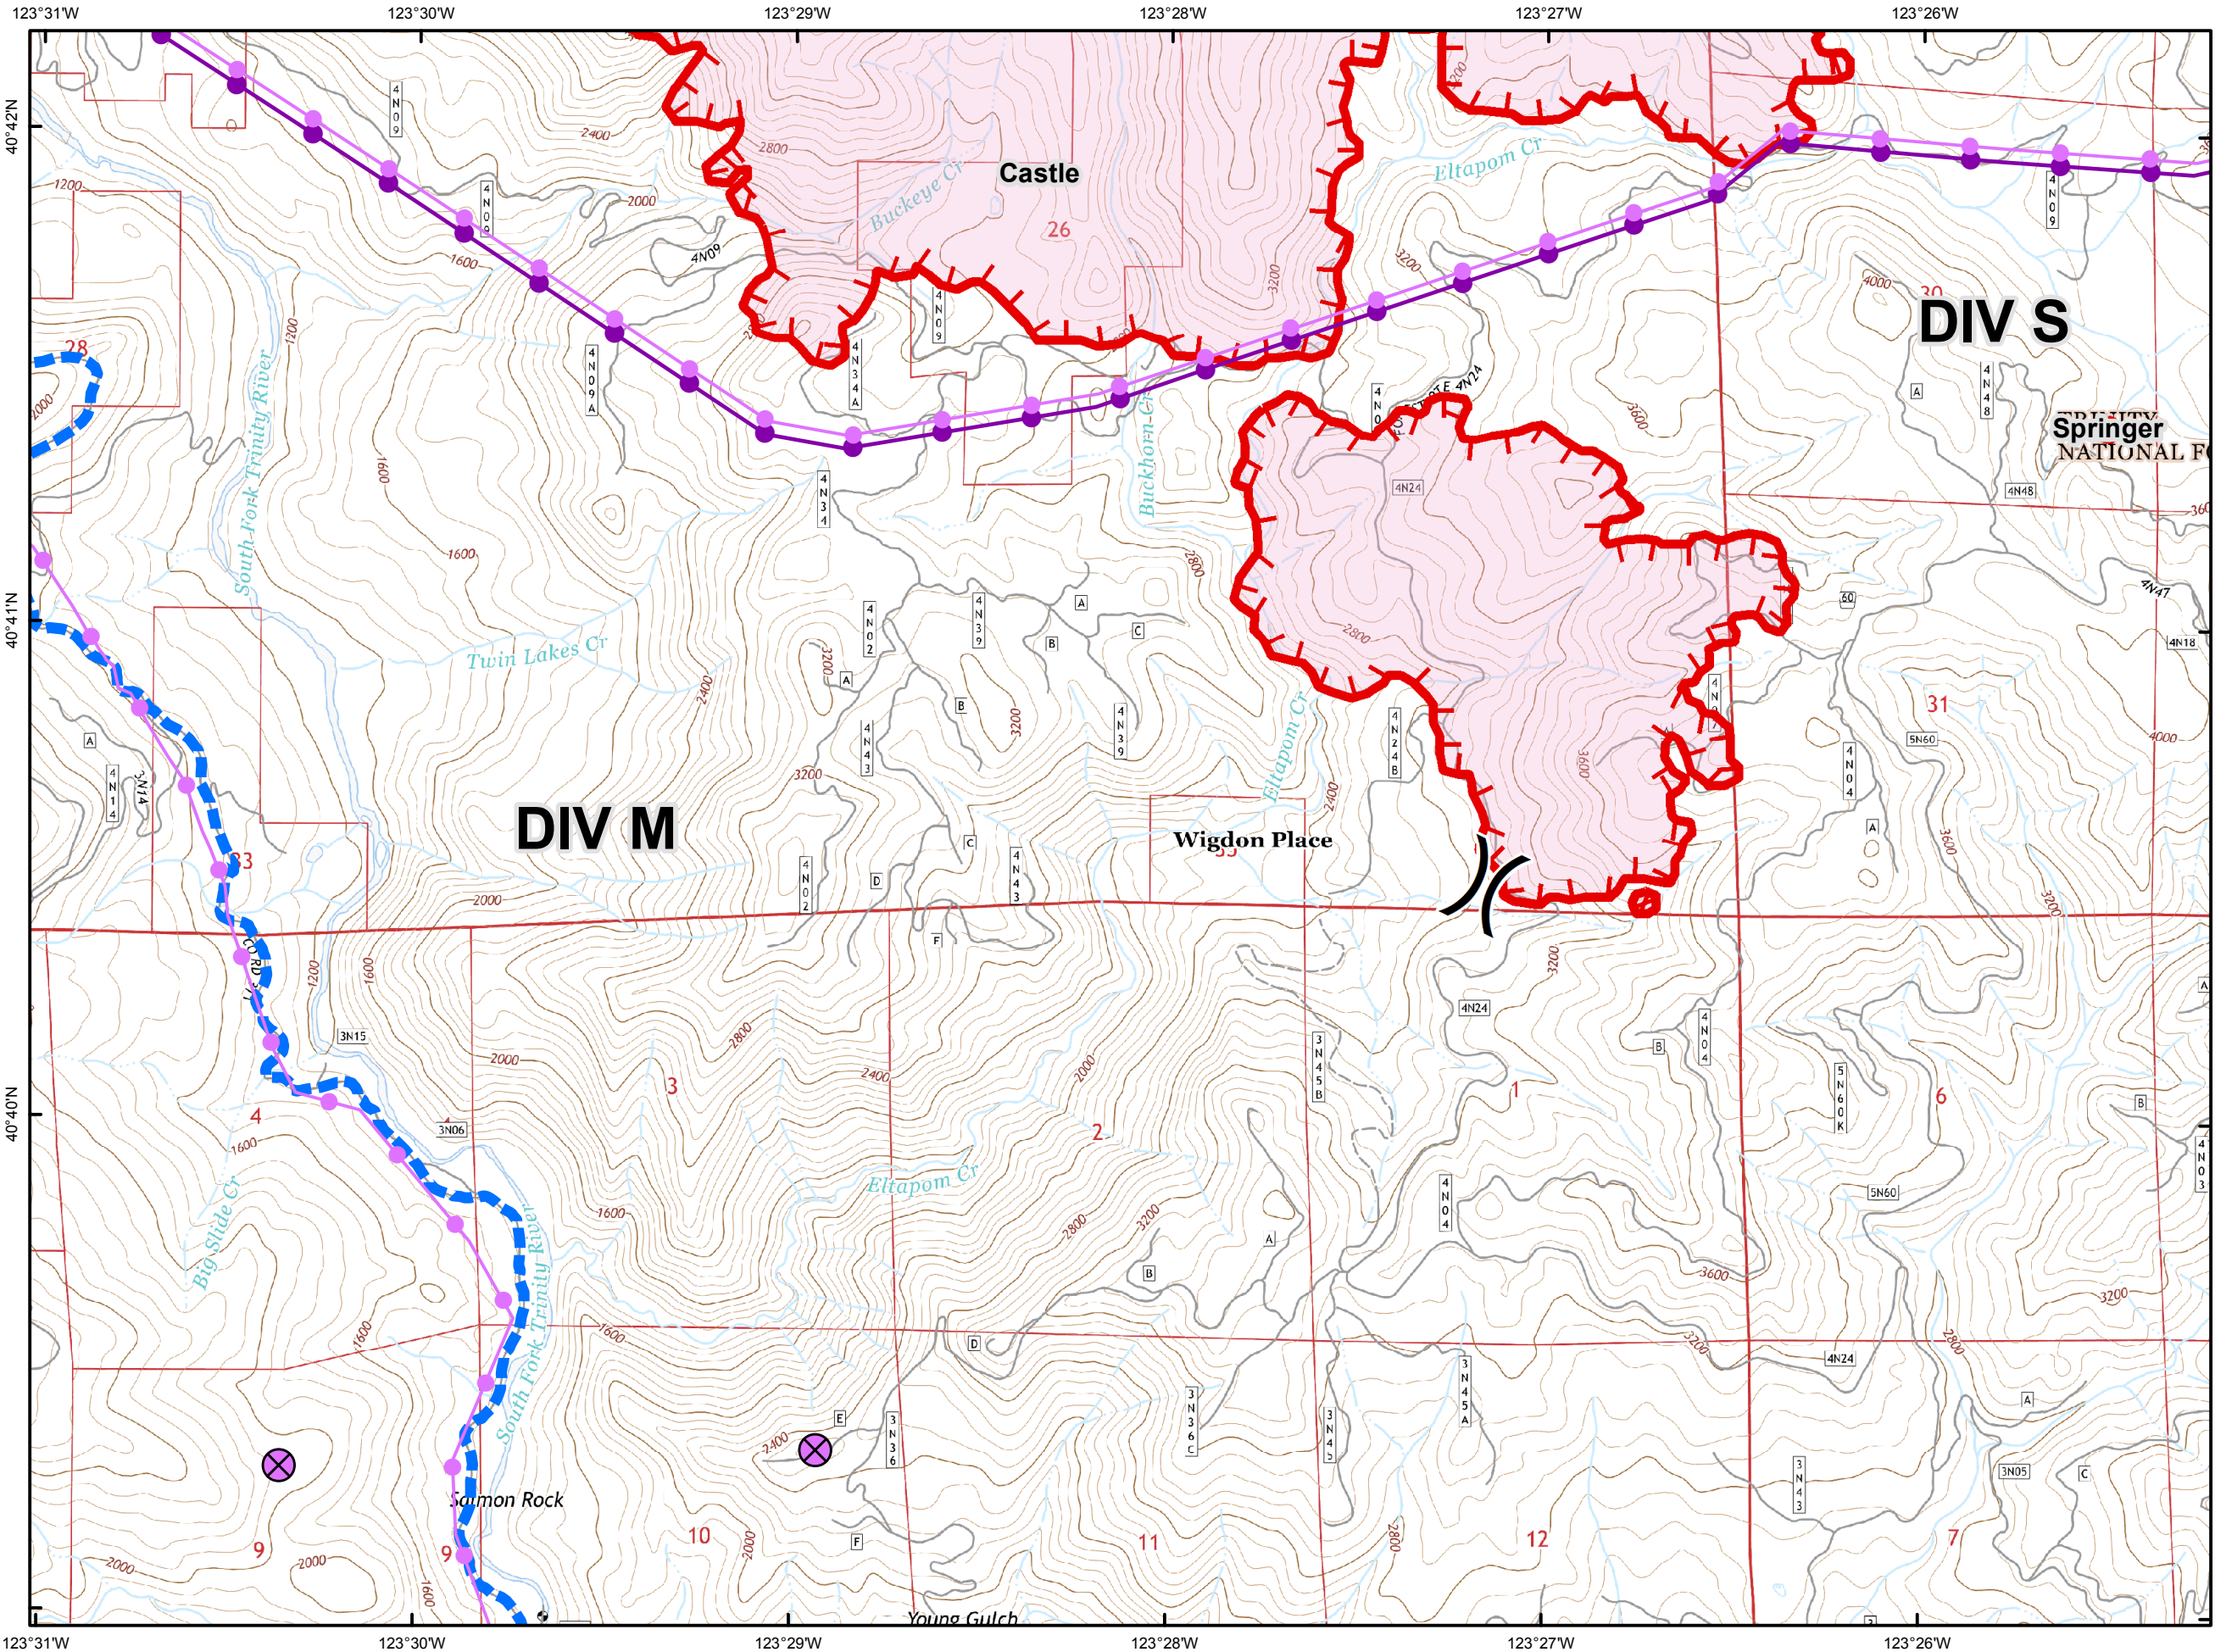


-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)
-  100-161 KV Powerline
-  Under 100 KV Powerline



0 0.5 Miles










**South Complex  
CA-SHF-002108**

**IAP Map  
August 3, 2015  
Day Shift**

**Page 5**

-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)
-  100-161 KV Powerline
-  Under 100 KV Powerline
-  Power Substation



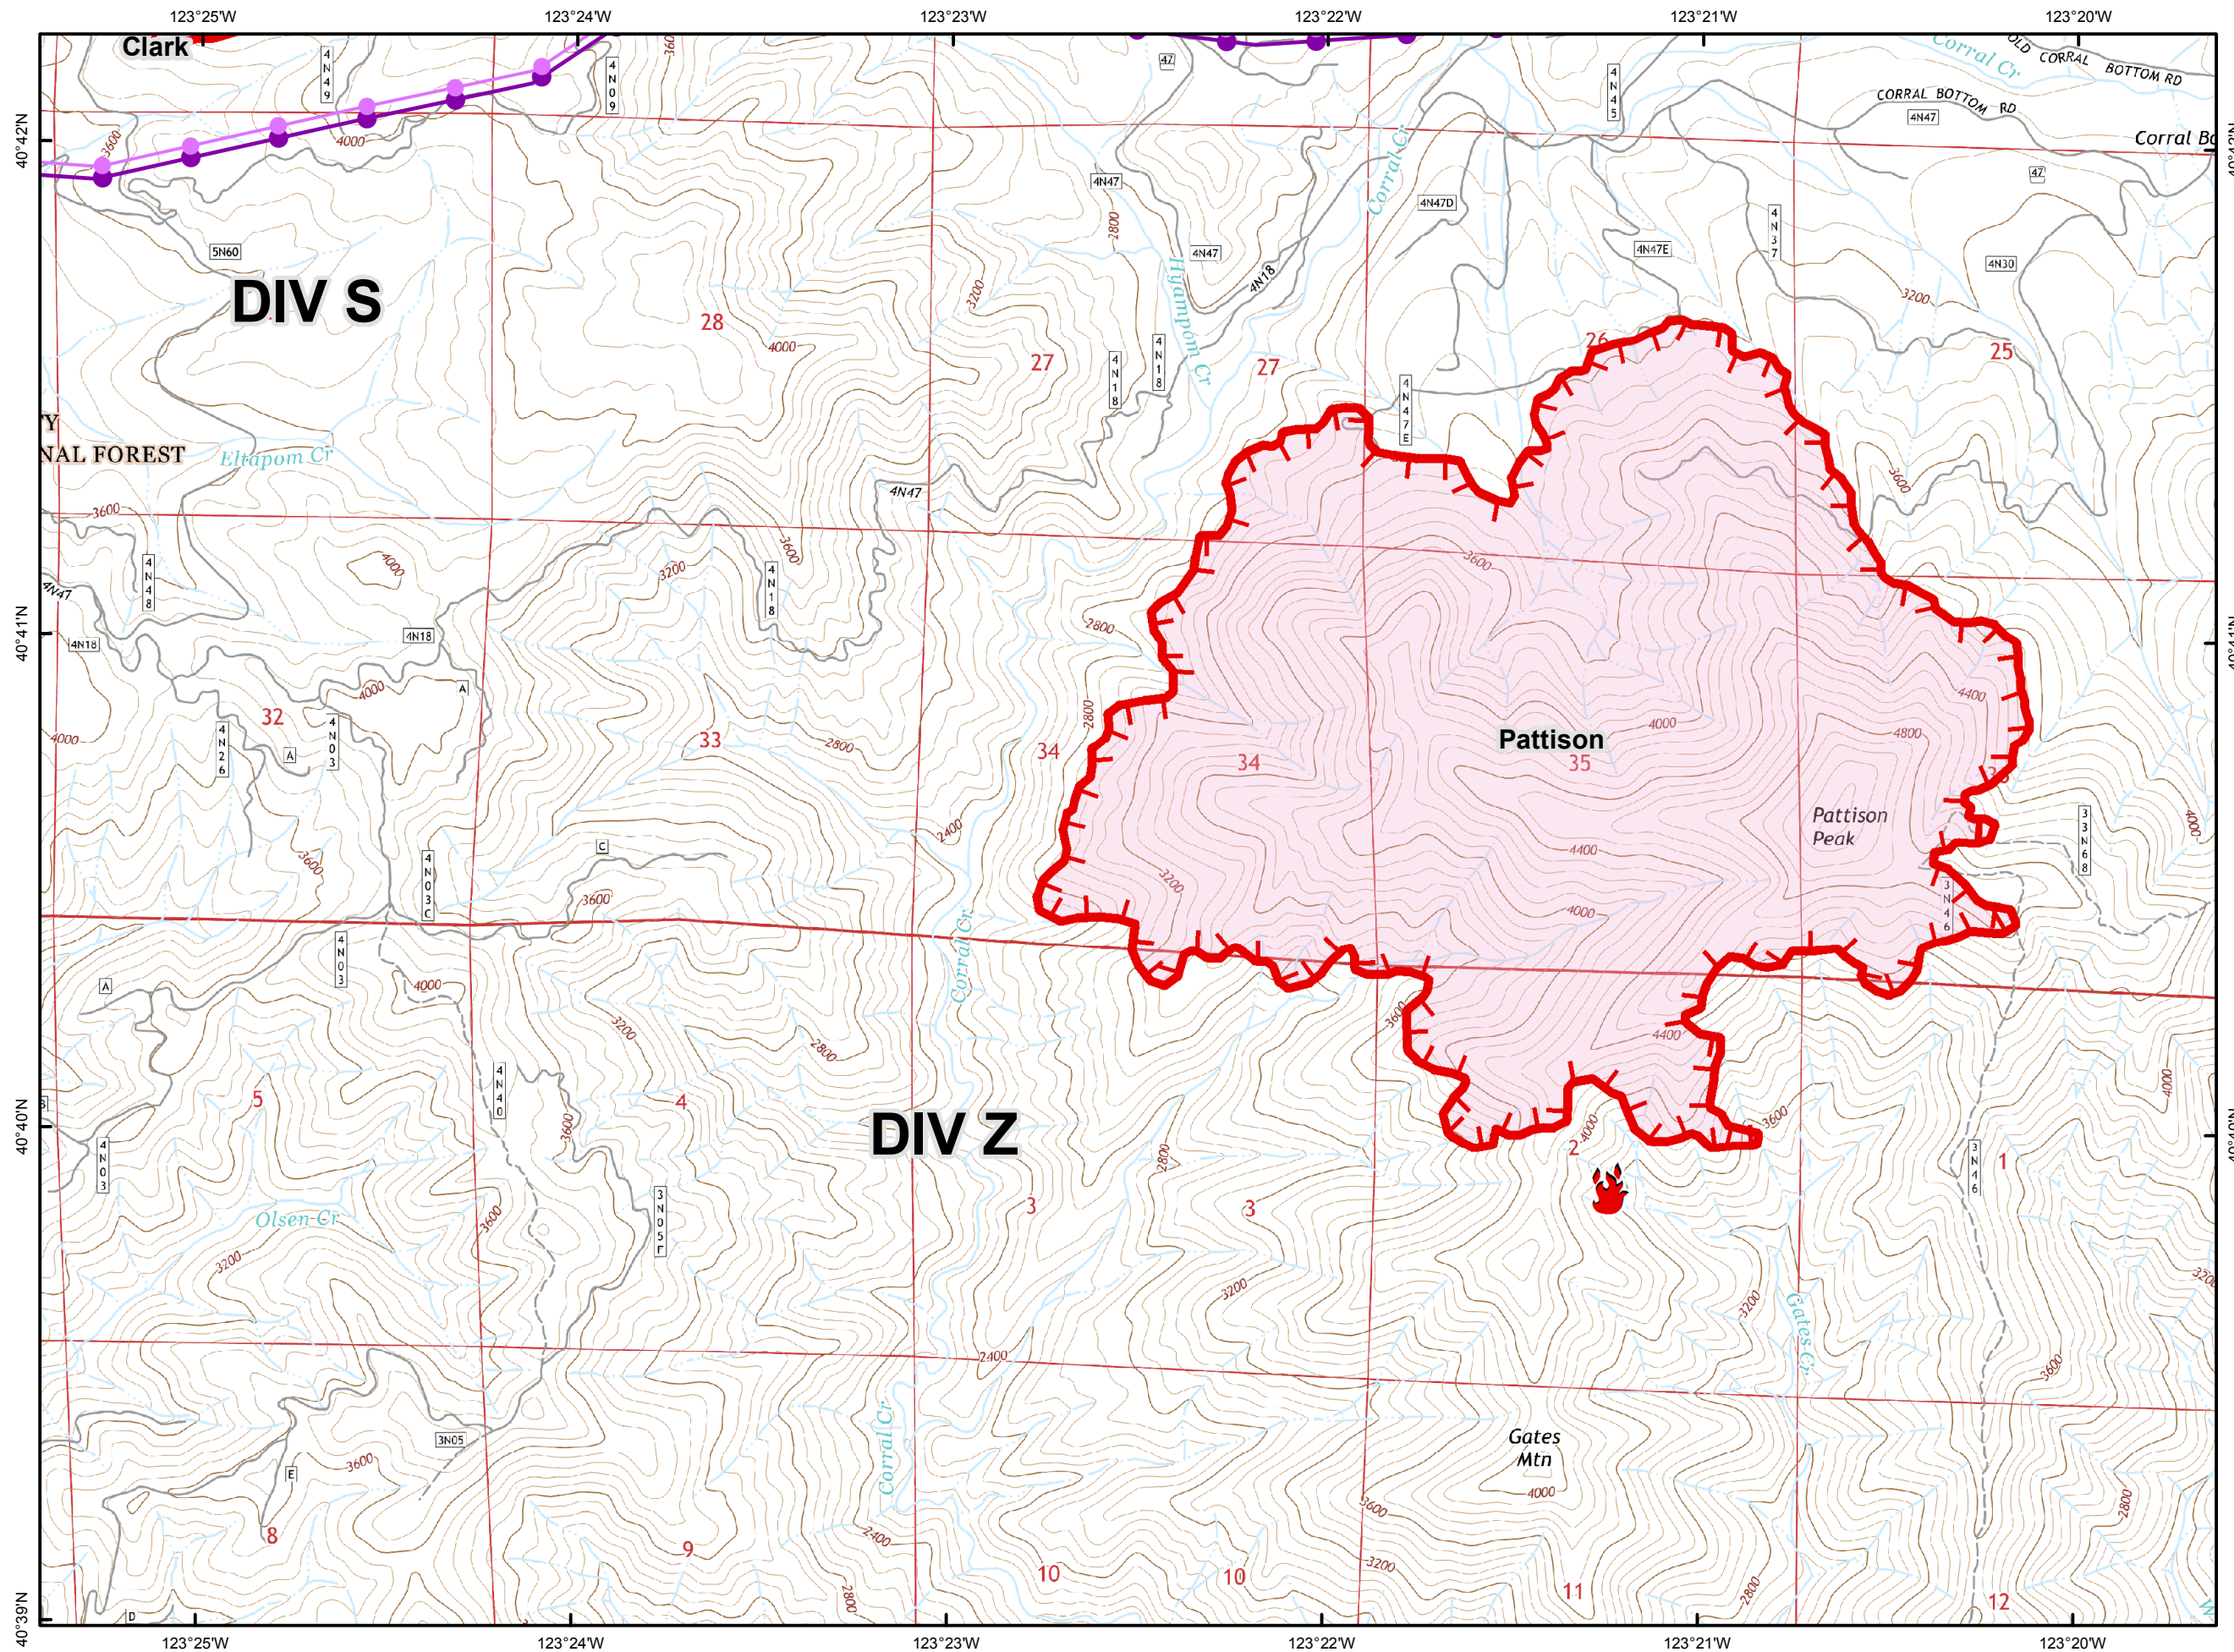
0 0.5 Miles








South Complex  
CA-SHF-002108

IAP Map  
August 3, 2015  
Day Shift

Page 6



-  Fire Location
-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)
-  100-161 KV Powerline
-  Under 100 KV Powerline



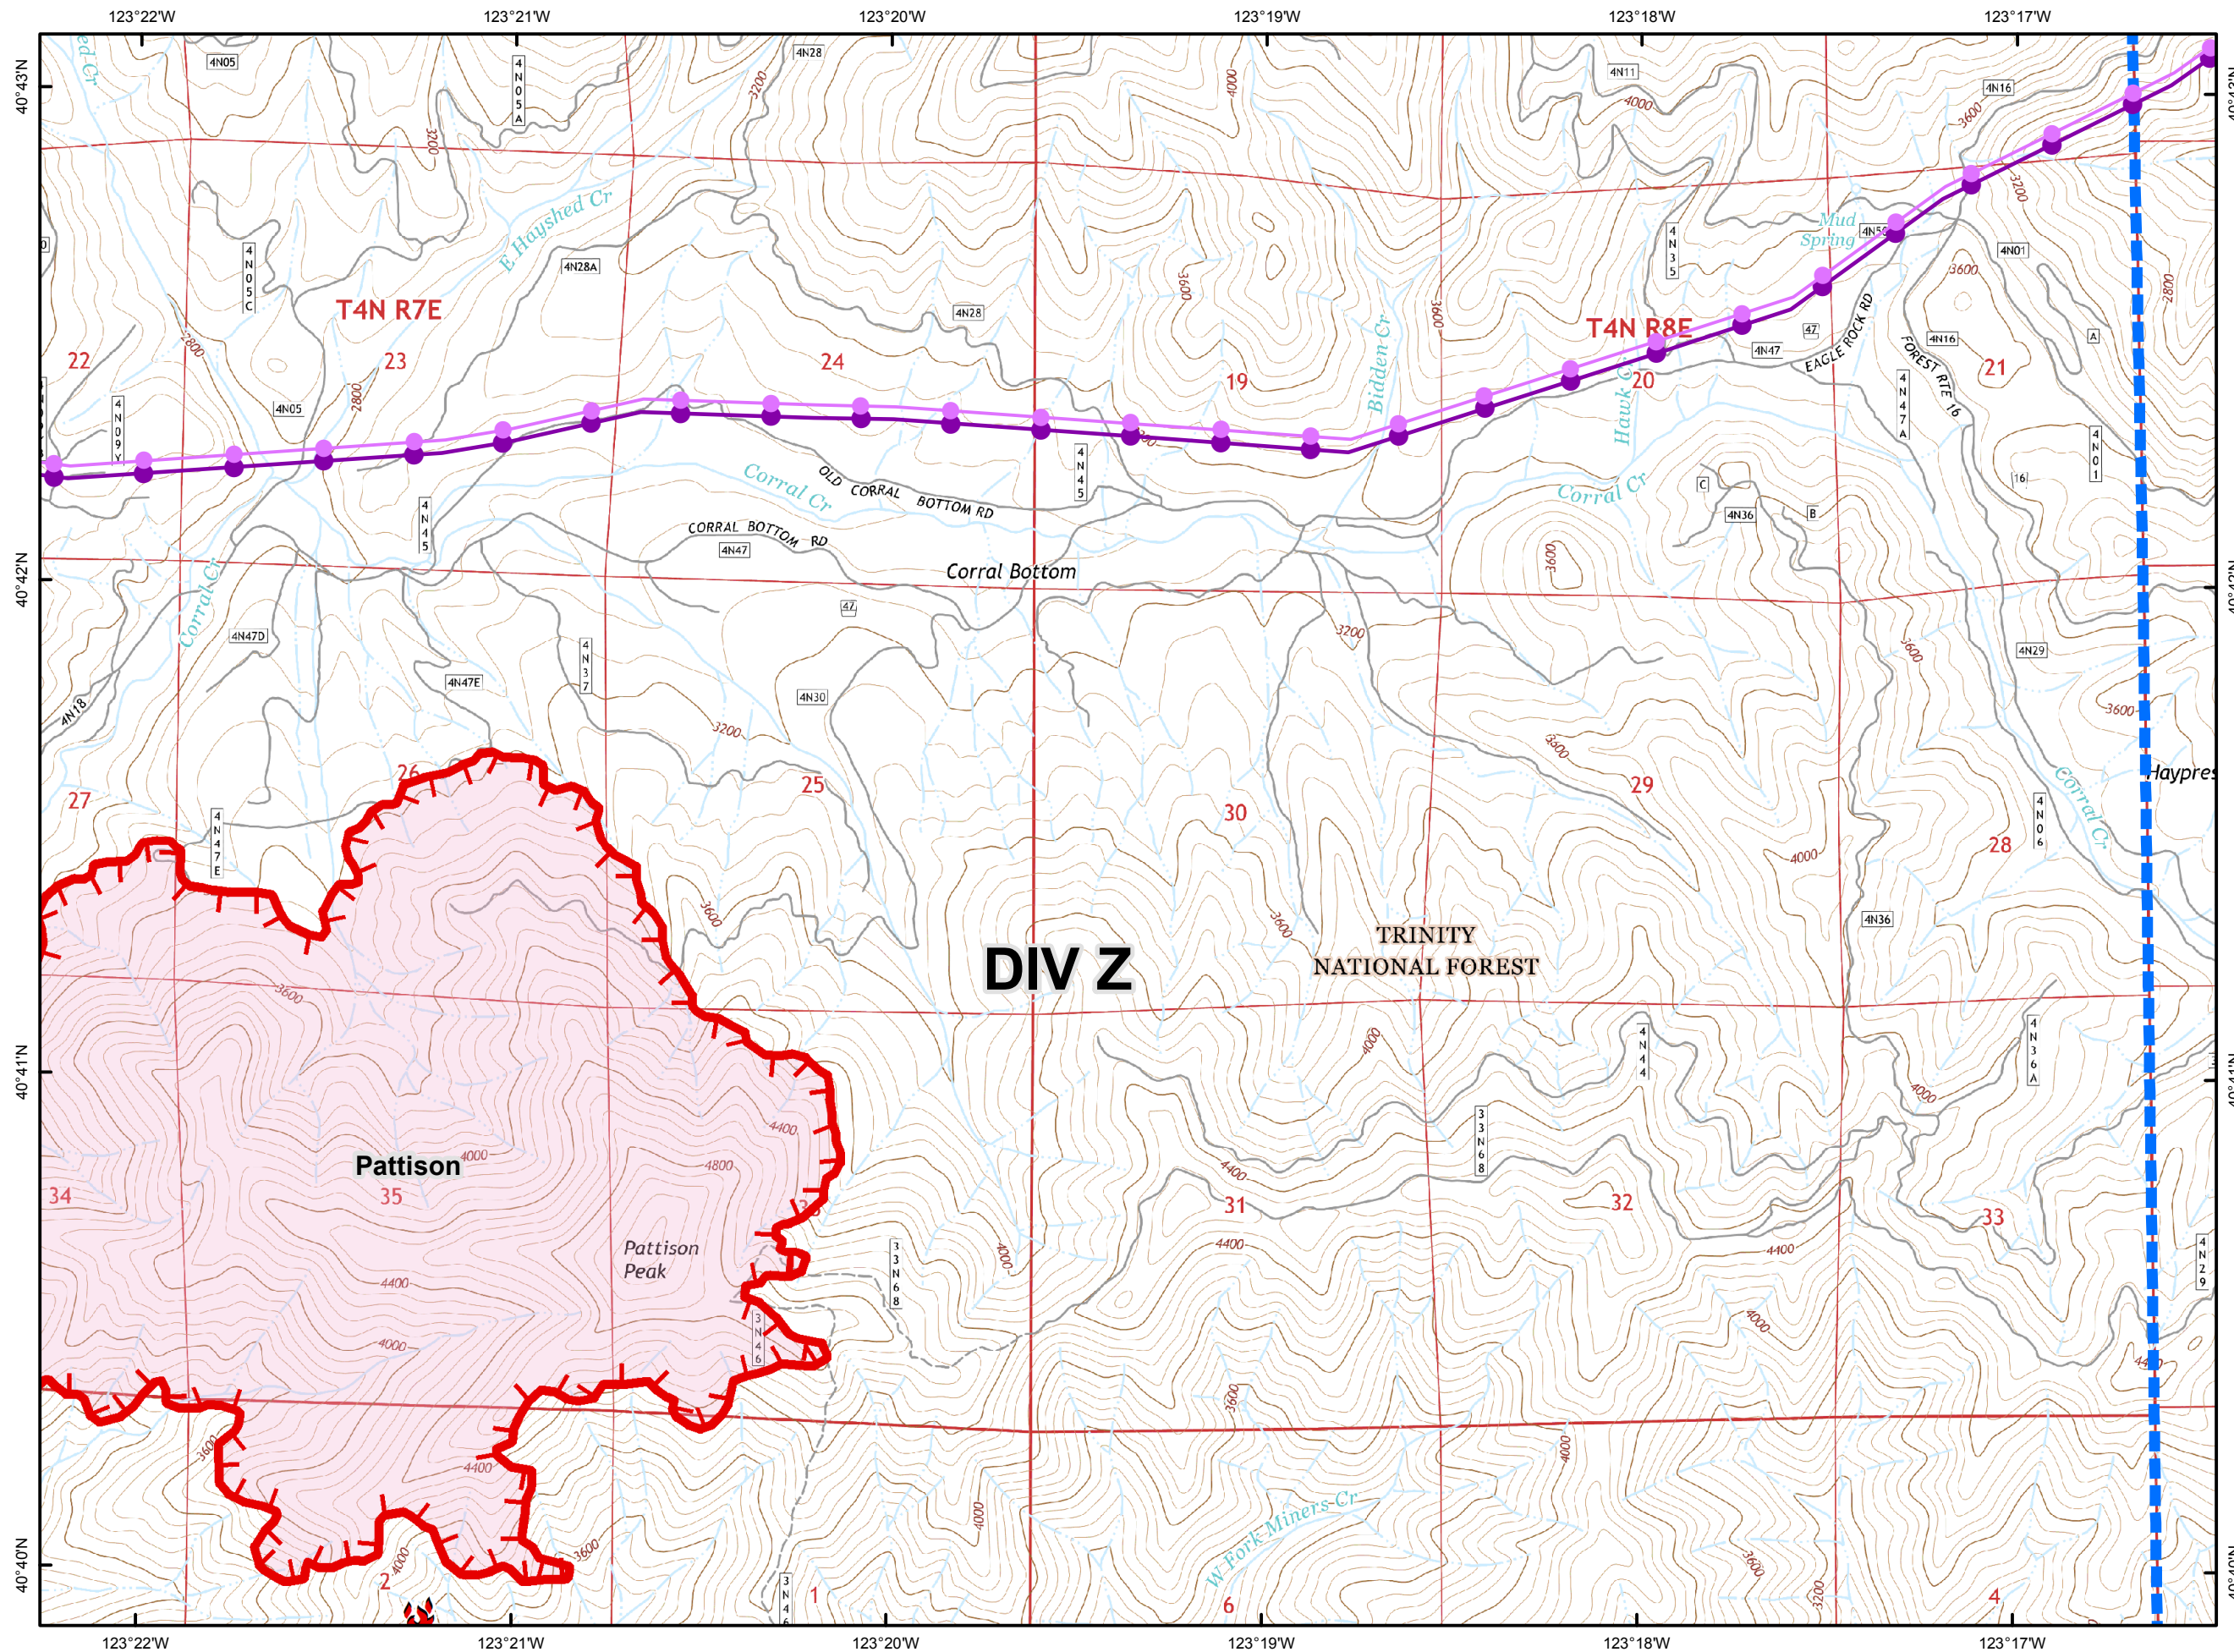
0 0.5 Miles








# South Complex CA-SHF-002108

IAP Map  
August 3, 2015  
Day Shift

Page 7



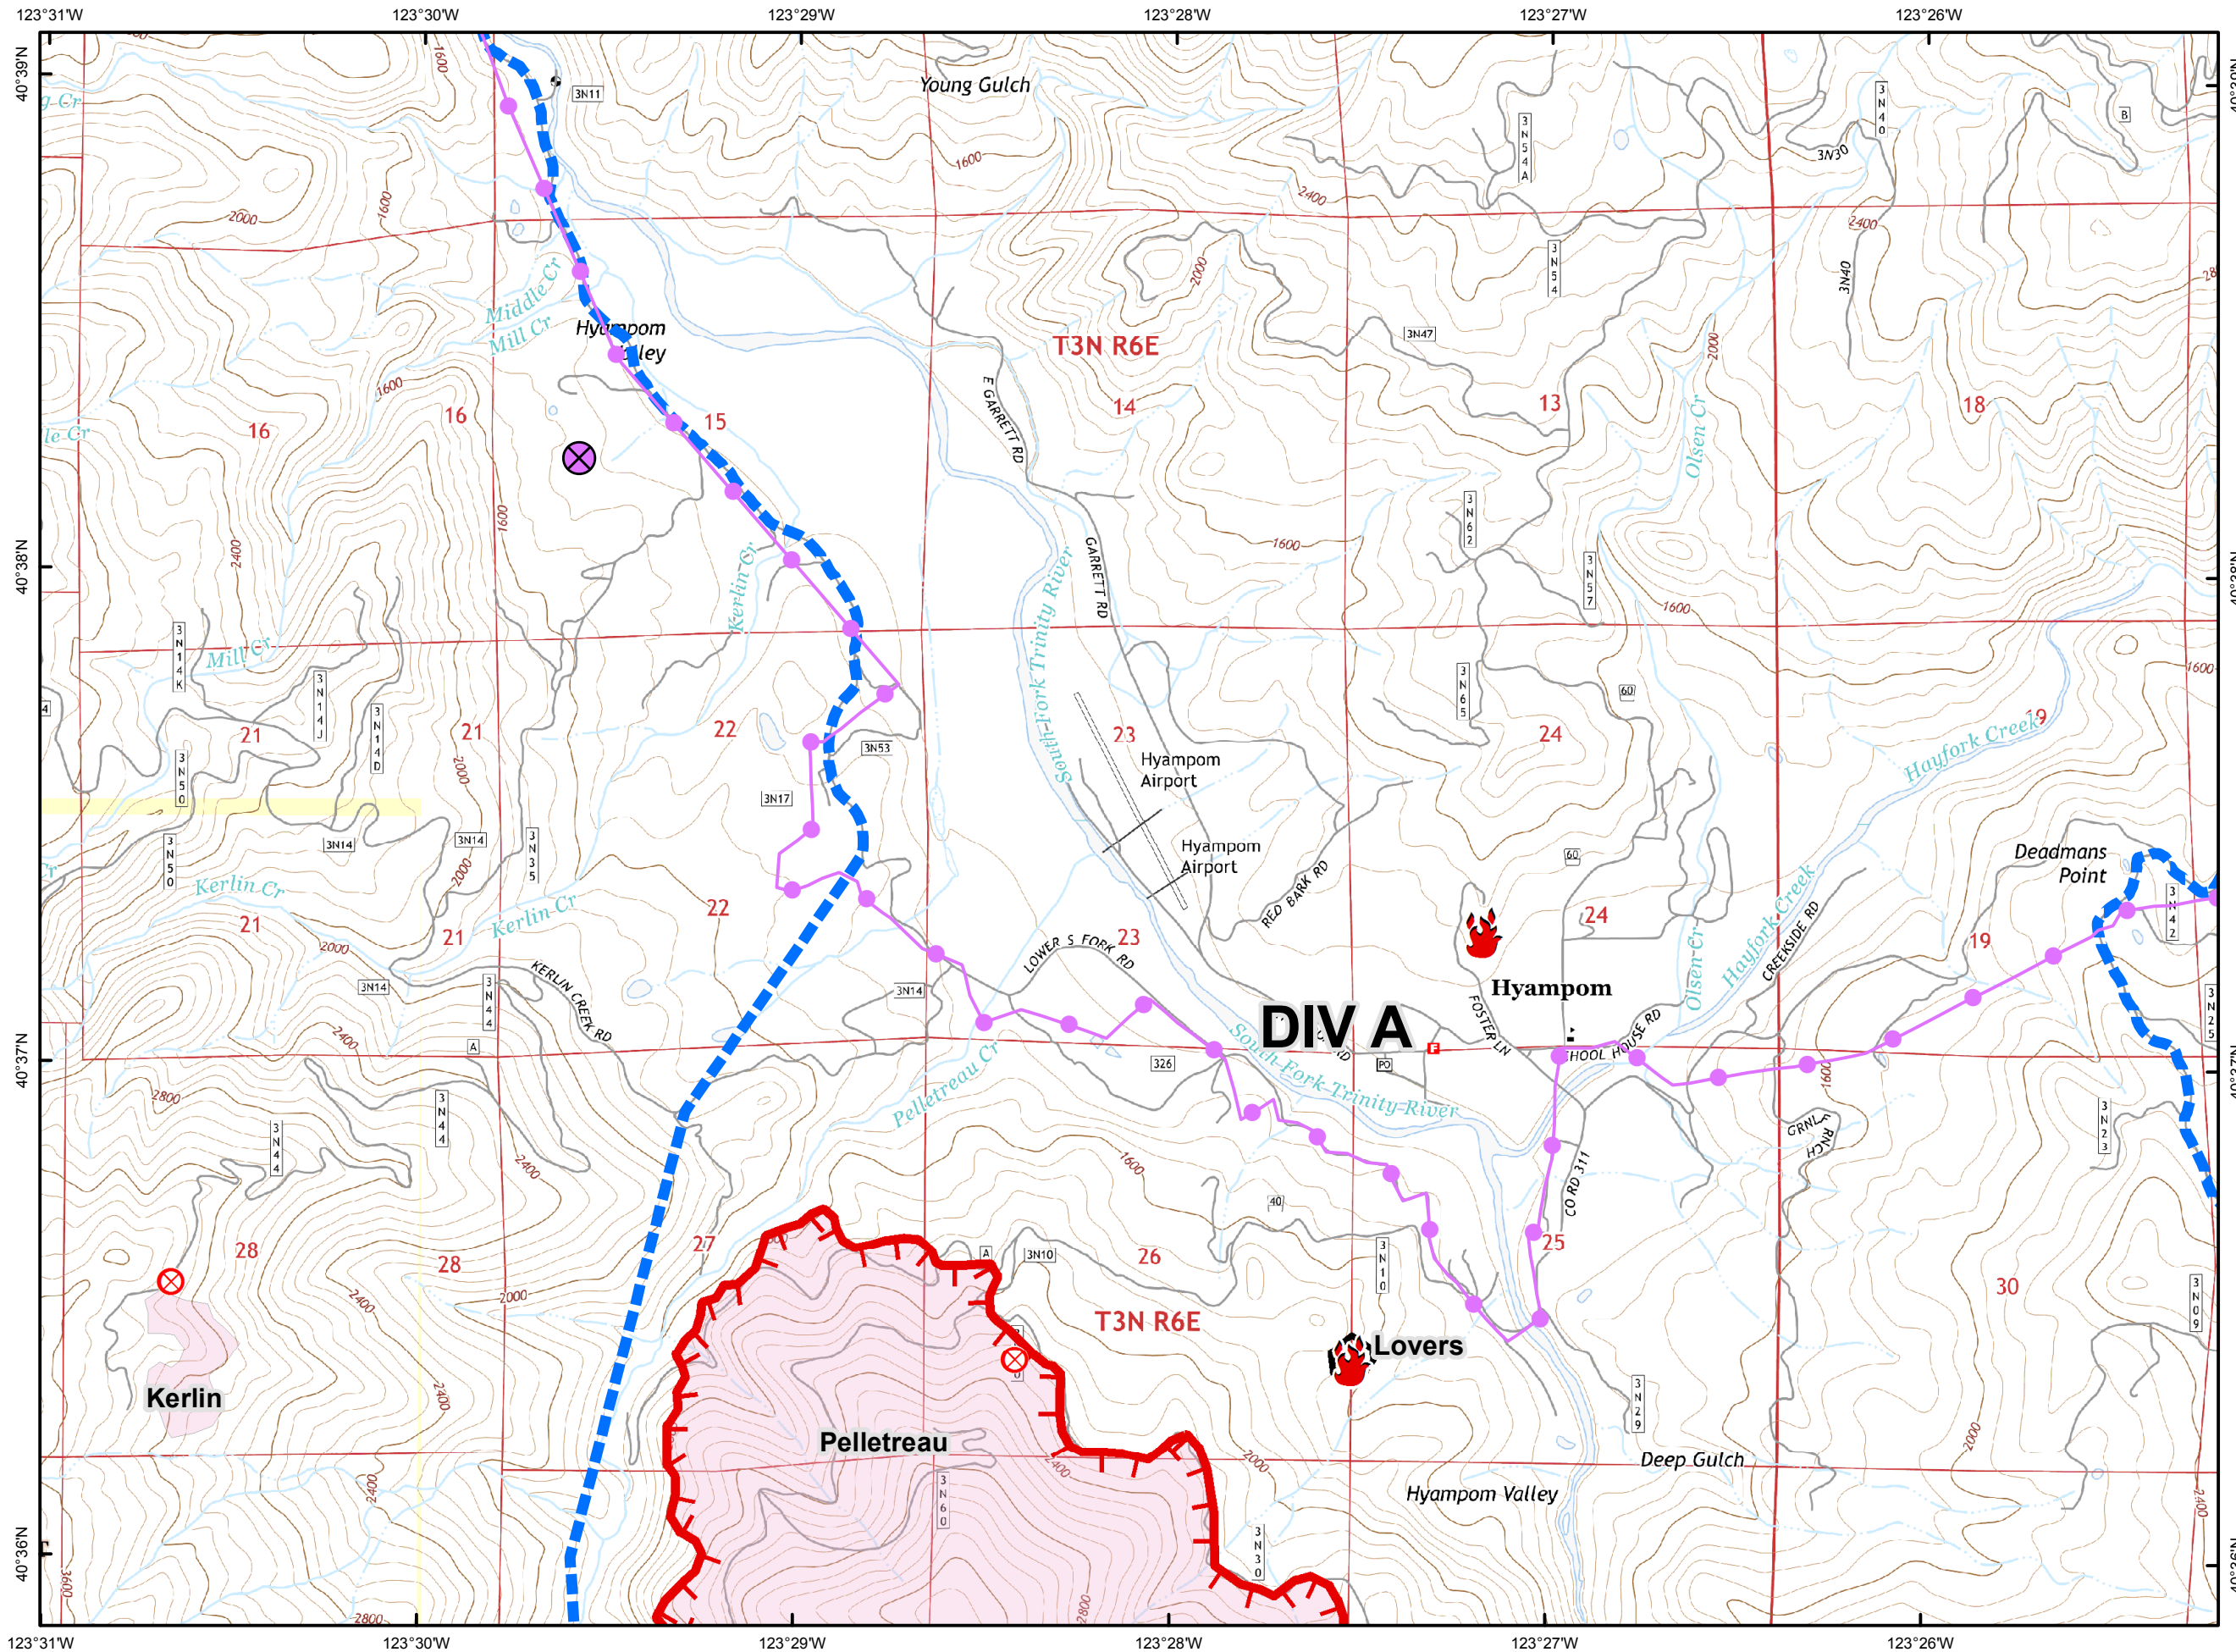
-  Fire Location
-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)
-  100-161 KV Powerline
-  Under 100 KV Powerline




0 0.5 Miles







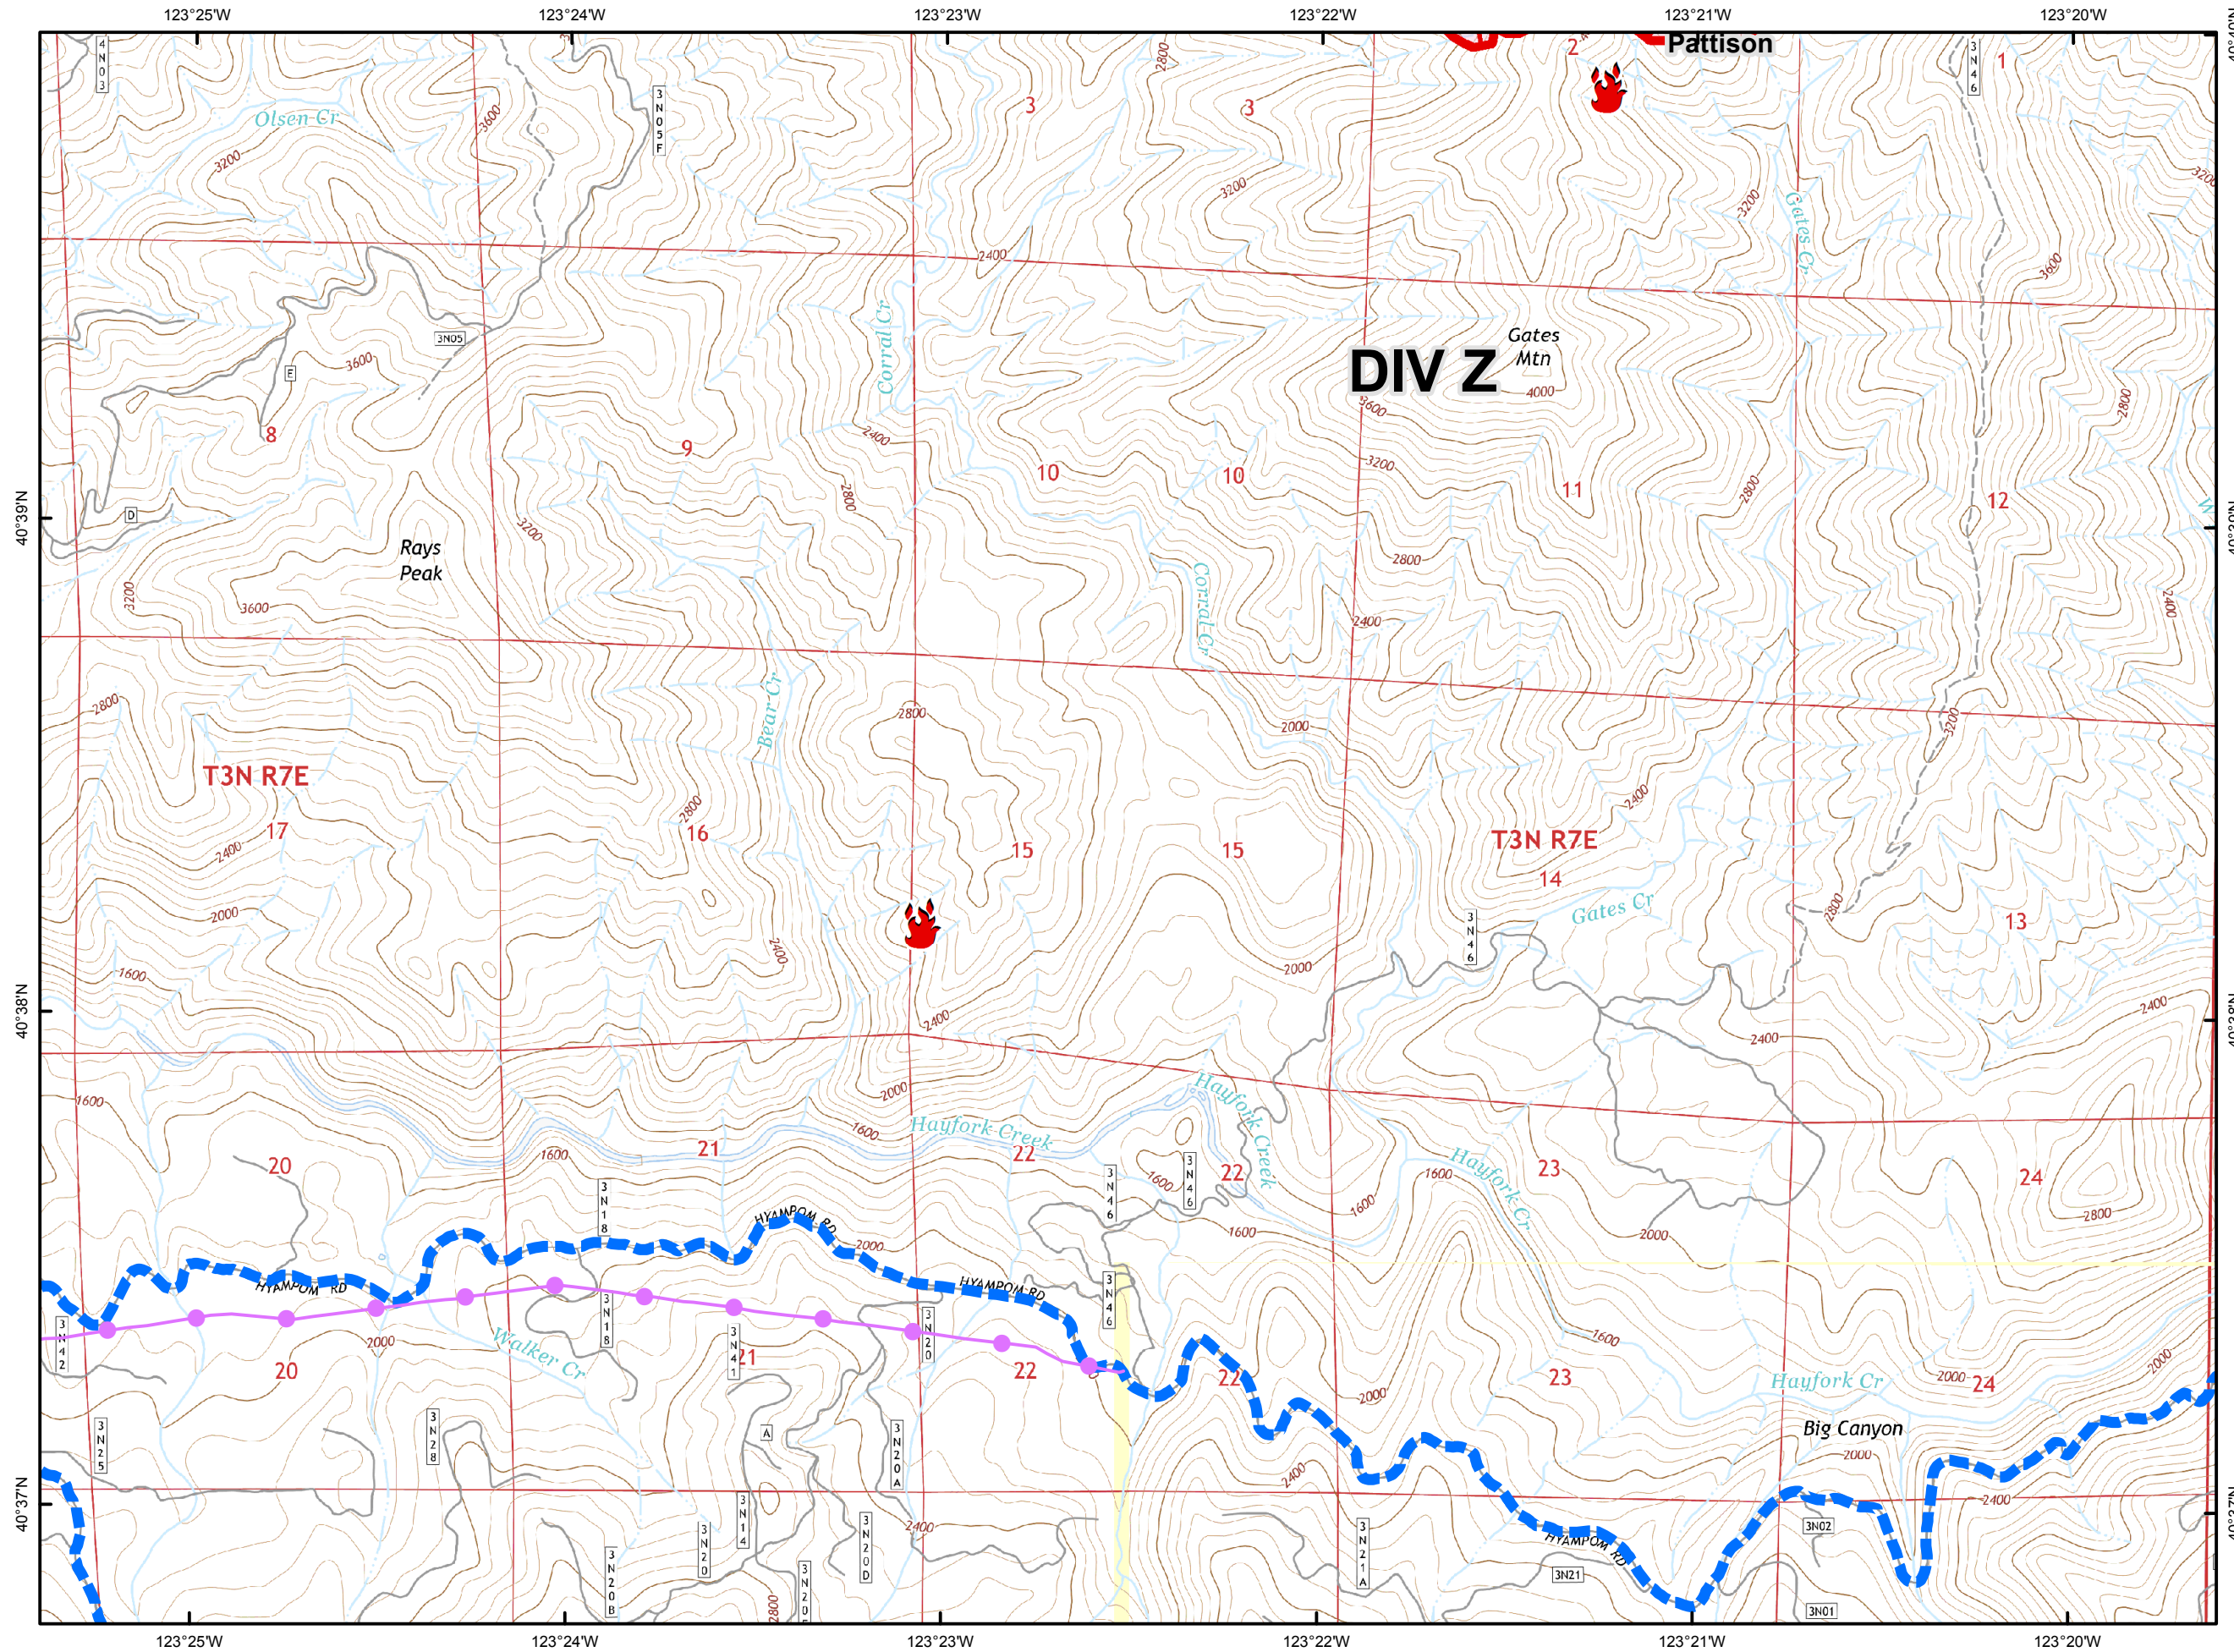
- Fire Location
- Fire Origin
- Uncontrolled Fire Edge
- Completed Line
- South Complex Boundary (Approximate)
- Under 100 KV Powerline
- Power Substation







South Complex  
CA-SHF-002108

IAP Map  
August 3, 2015  
Day Shift

Page 9



-  Fire Location
-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)
-  Under 100 KV Powerline



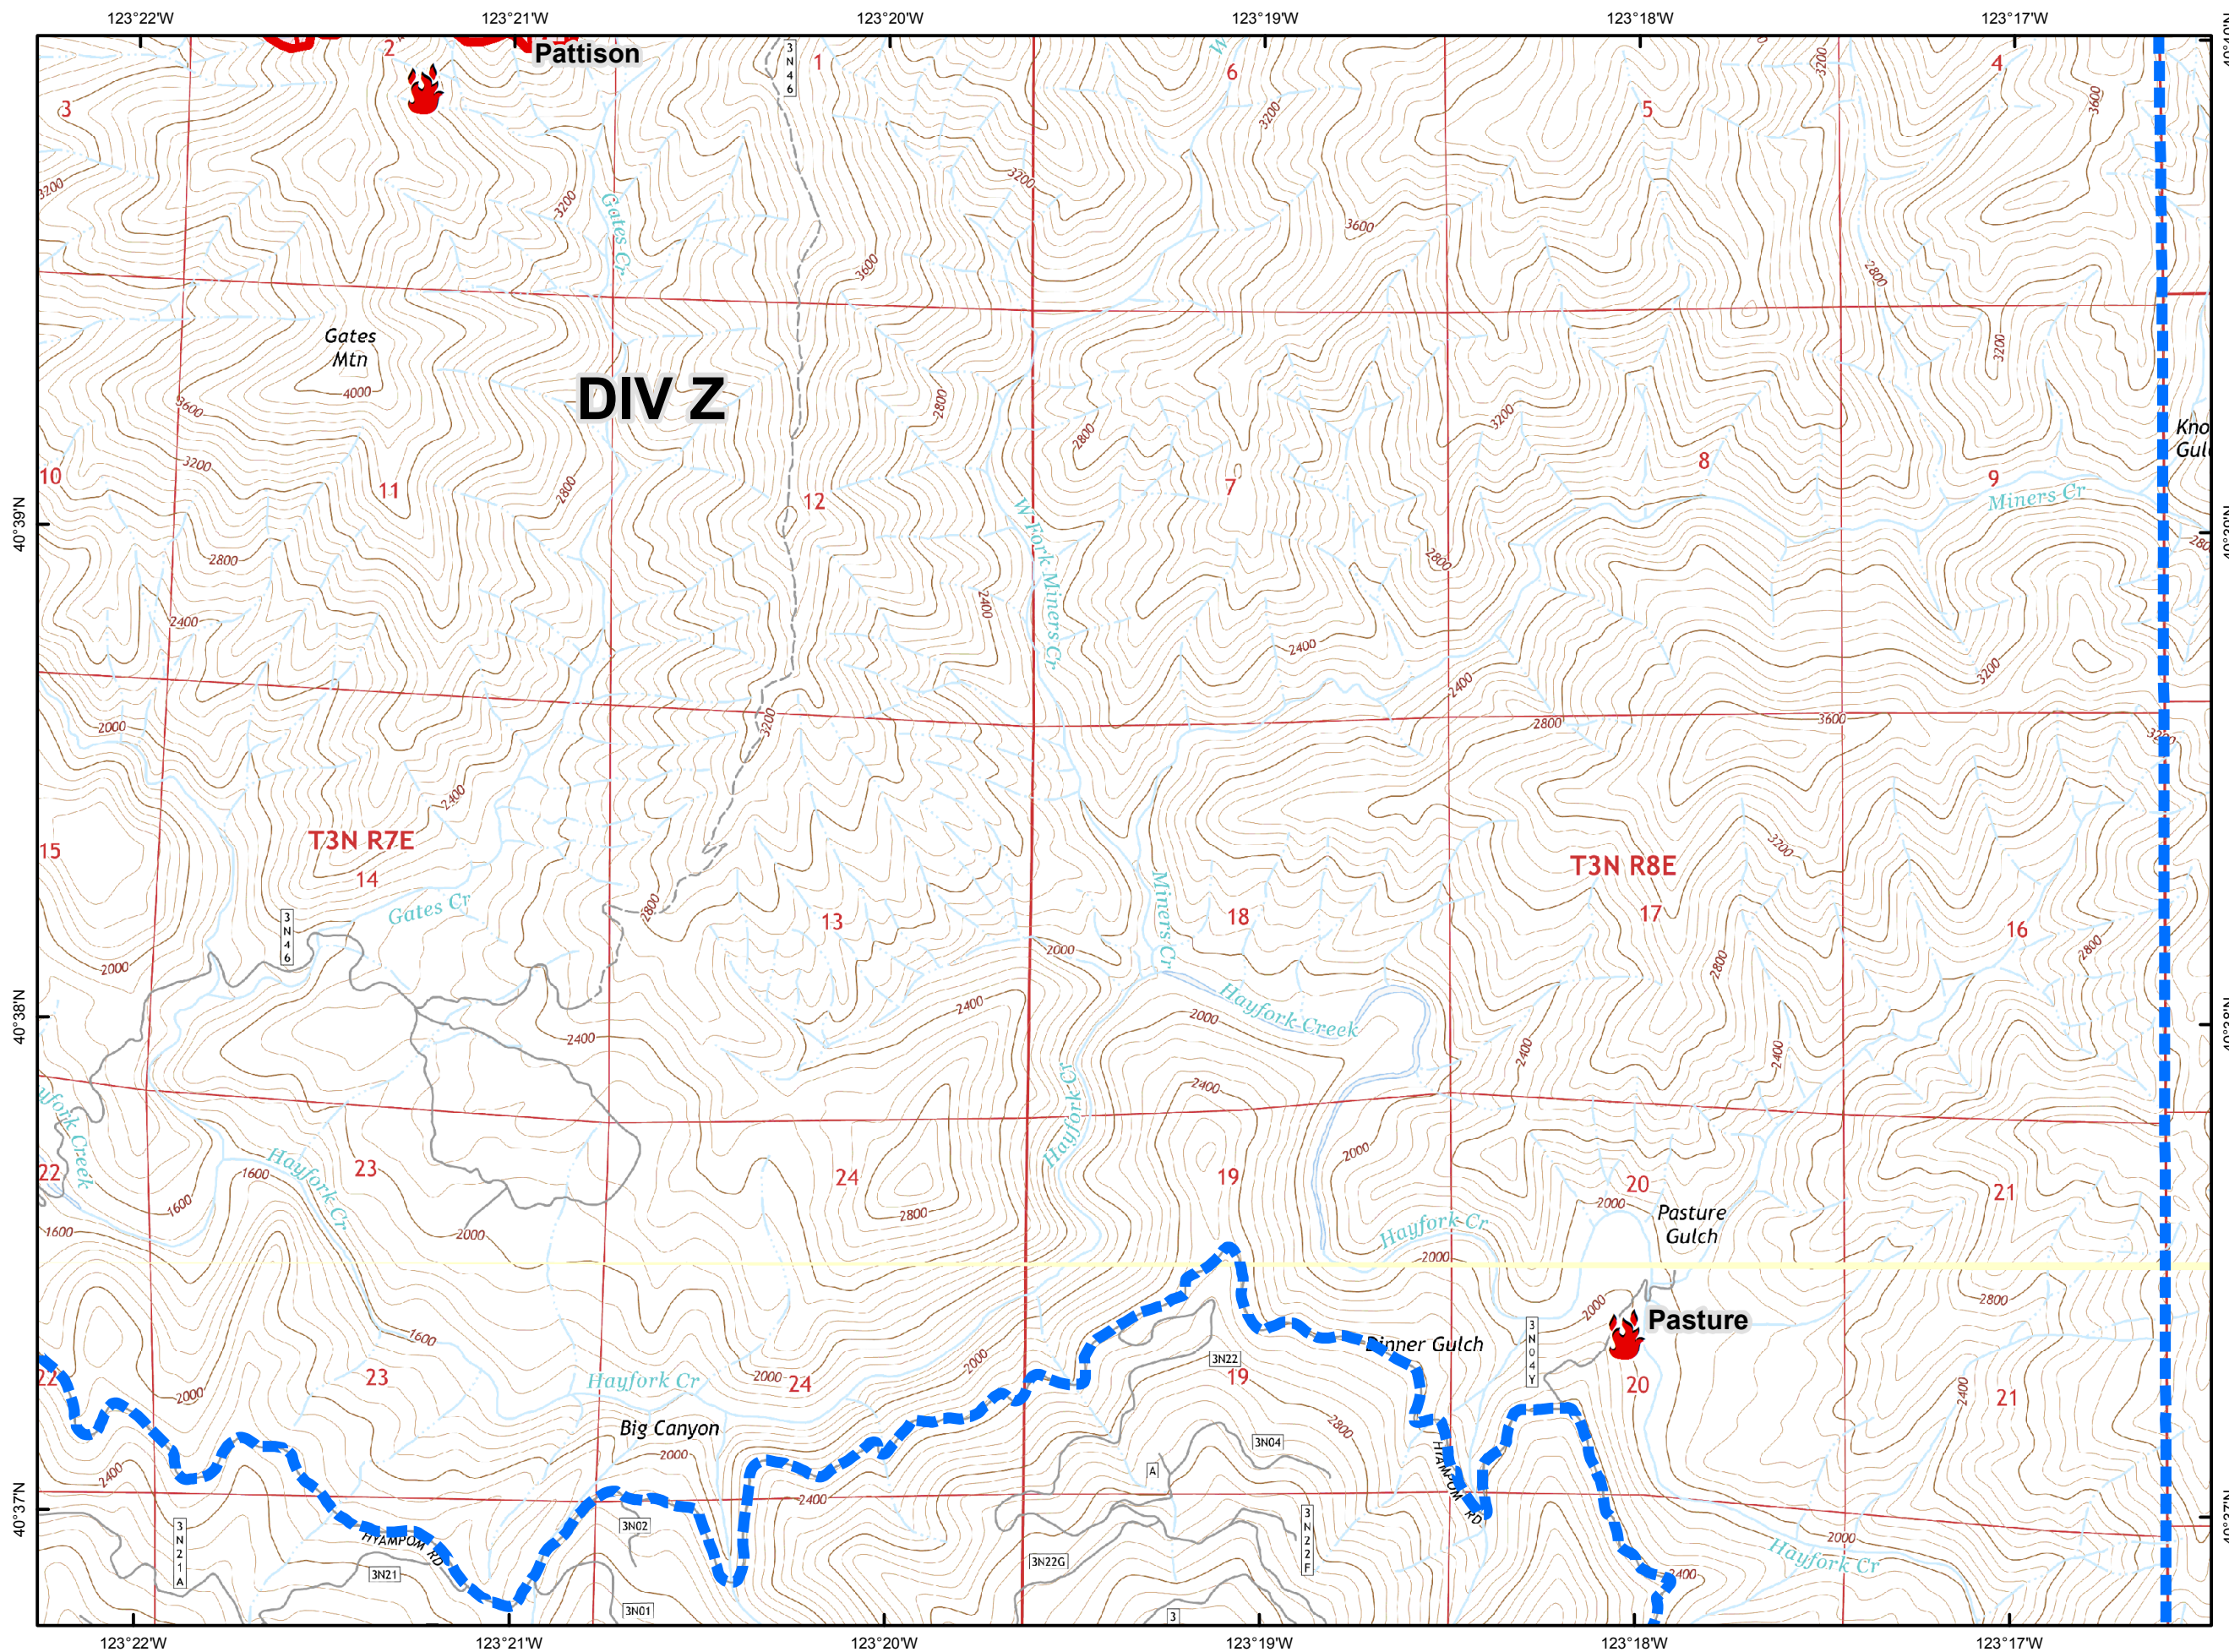
0 0.5 Miles







**South Complex  
CA-SHF-002108**

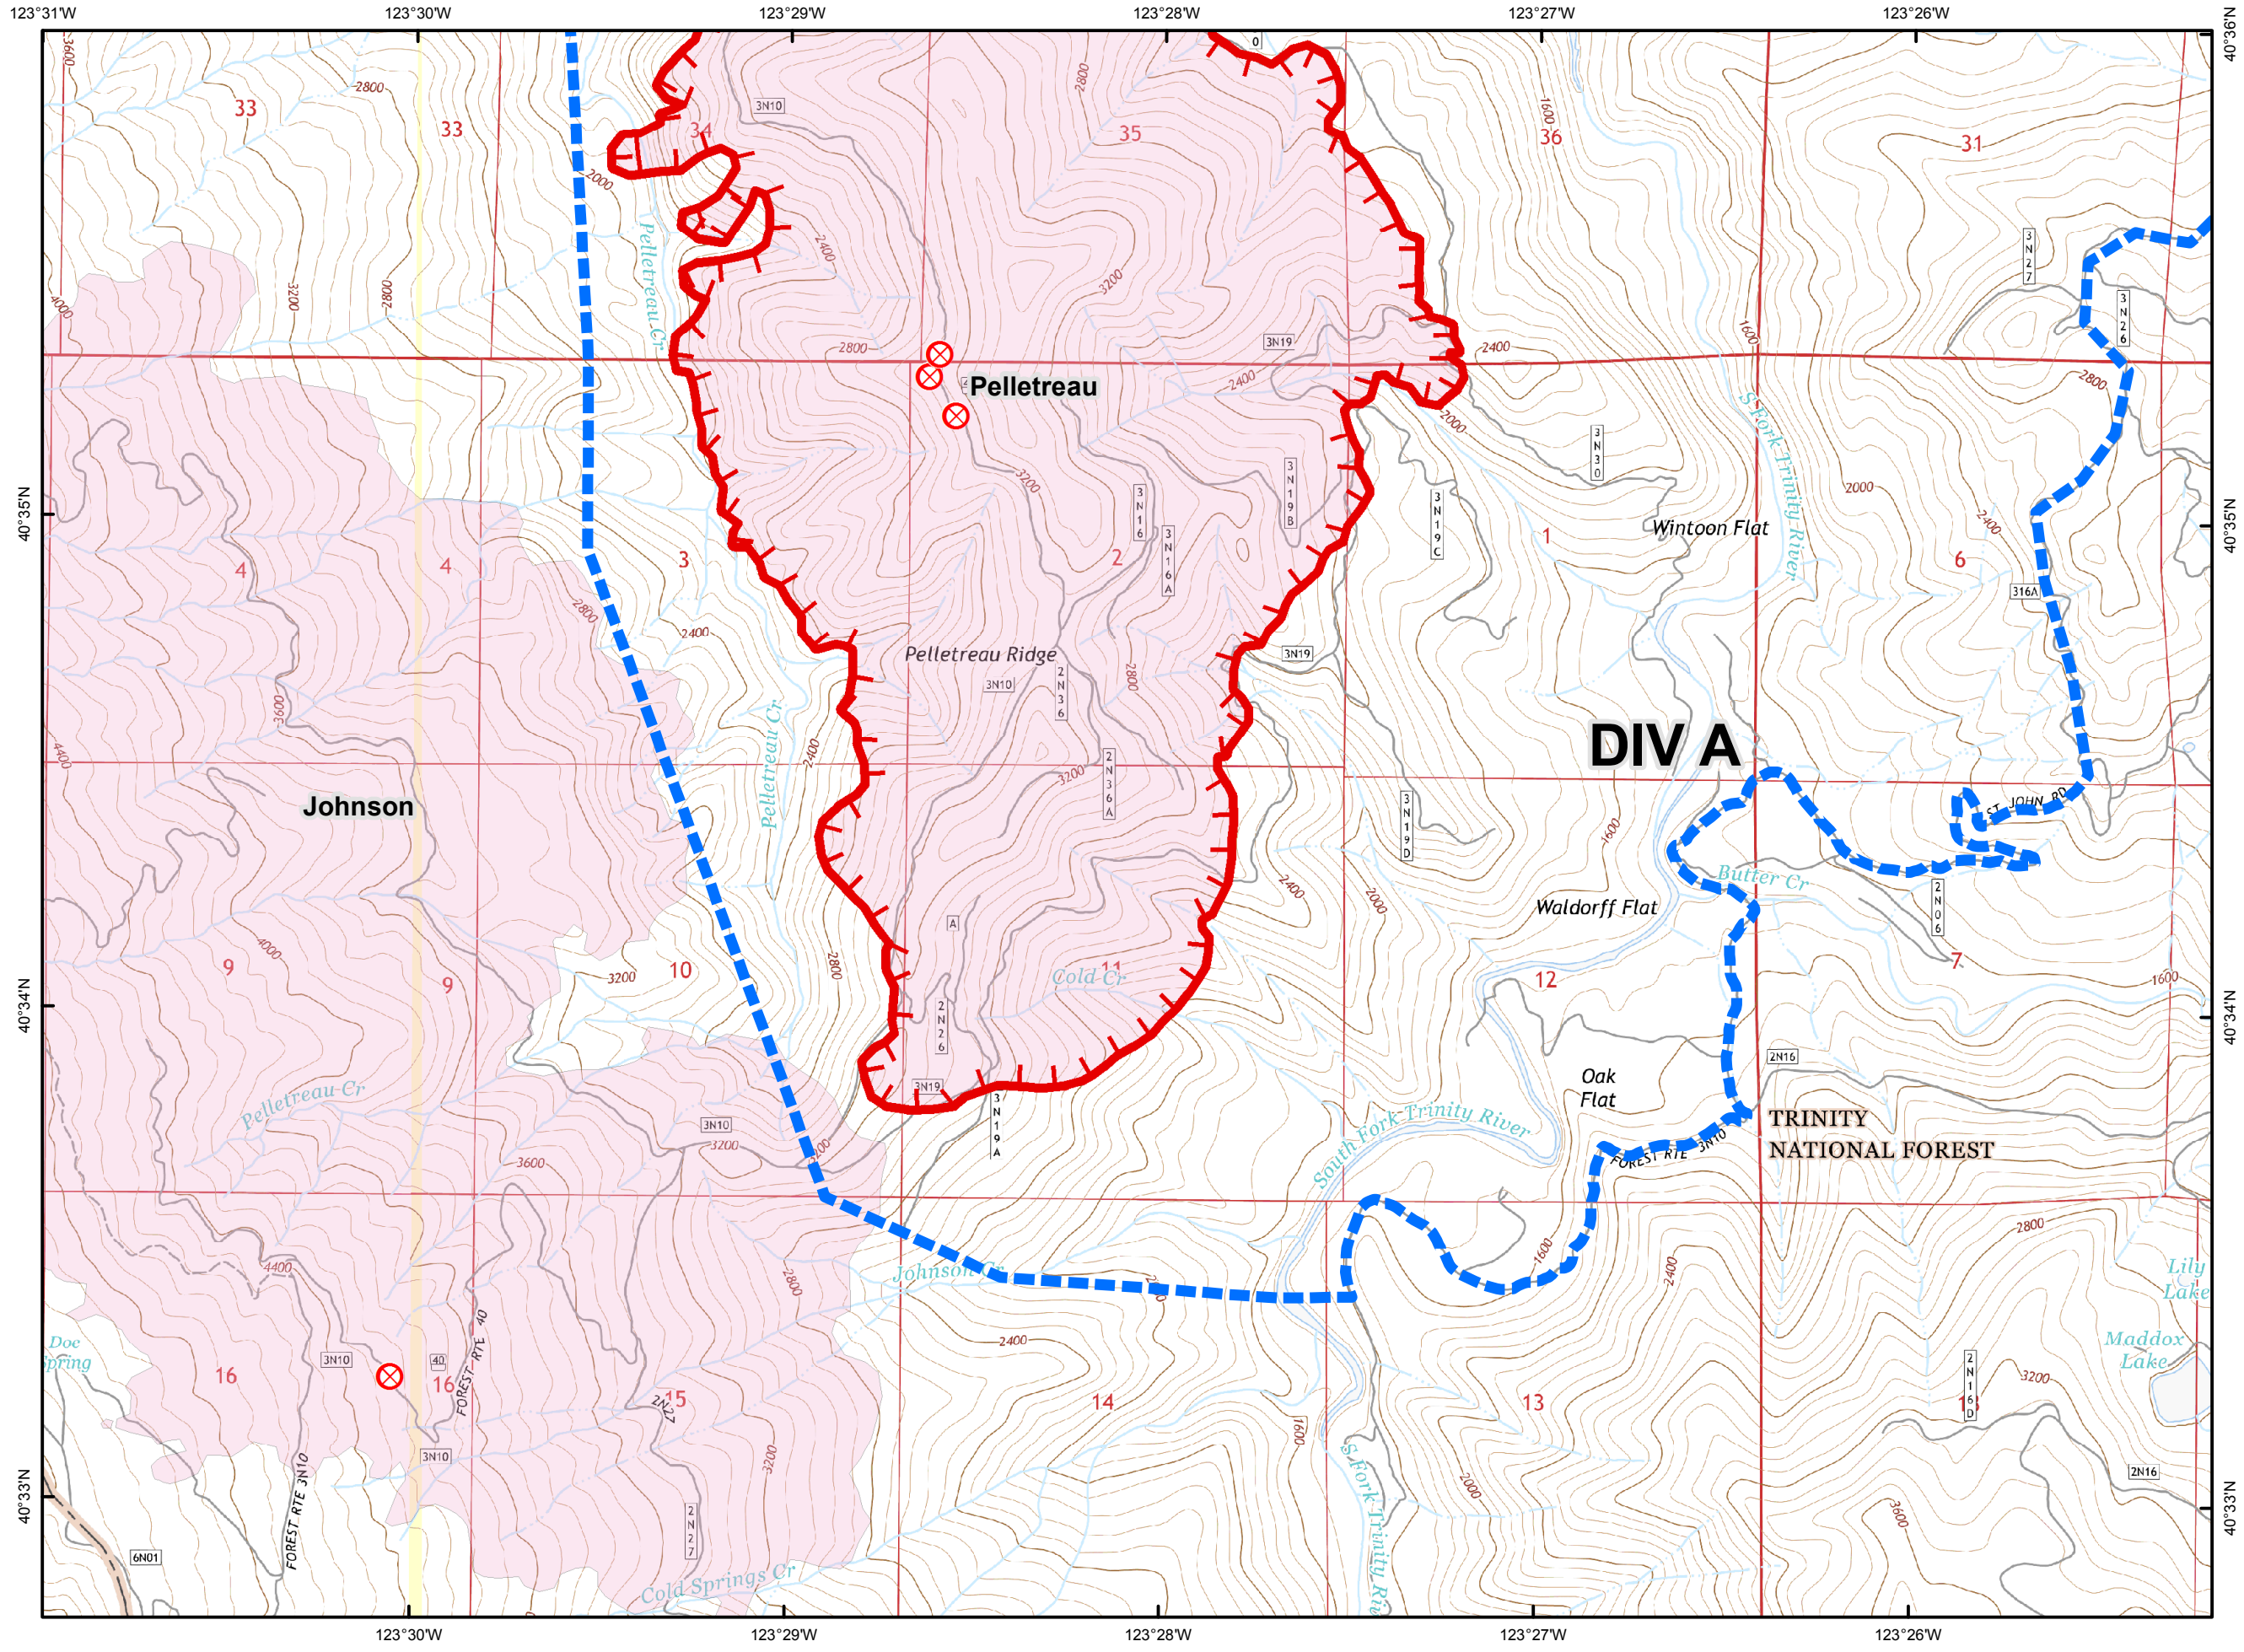
**IAP Map  
August 3, 2015  
Day Shift**

**Page 10**



-  Fire Location
-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)








**South Complex  
CA-SHF-002108**

**IAP Map  
August 3, 2015  
Day Shift**

**Page 11**

-  Fire Origin
-  Uncontrolled Fire Edge
-  South Complex Boundary (Approximate)



0 0.5 Miles

