


11/7/2020 AUGUST COMPLEX CA-MNF-000753



| Event Point | Event Line | Event Point - Repair Status |
|-----------------------|---|----------------------------------|
| Hilltop | Restricted Water Source | No Repair Needed |
| Incident Command Post | Value at Risk | Other - See Comments |
| Camp | Completed Doser Line | Repair Needed |
| Chains | Road or Completed Line | No Repair Needed |
| Drop Site | Zone Break | Unknown |
| Drop Point | Fireline | Completed - Inspected |
| Gate | Management Action Point | In Use - Fire Management |
| Hazard | Fireline | Completed - Ready for Inspection |
| Water Source | Other Fire Perimeter | In Use - Fire Management |
| | Aerial Retardant Drop | Repair Needed |
| | Access or Improved Road | |
| | Planned Fire Line | |
| | Proposed Doser Line | |
| | Transmission Line | |
| | Mendocino National Forest | |
| | Mendocino National Forest Wilderness Boundary | |
| | Zone Break | |
| | Uncontrolled Fire Edge | |
| | Other Fire Perimeter | |
| | Event Pinpoint | |
| | Proposed Doser Line | |
| | Transmission Line | |
| | Direct Protection Area | |
| | Direct Protection Area | |
| | STATE | |
| | FEDERAL | |
| | LOCAL | |
| | No Repair Needed | |
| | Other - See Comments | |
| | Repair Needed | |
| | No Repair Needed | |
| | Unknown | |
| | Completed - Inspected | |
| | In Use - Fire Management | |
| | Completed - Ready for Inspection | |
| | In Use - Fire Management | |
| | Repair Needed | |

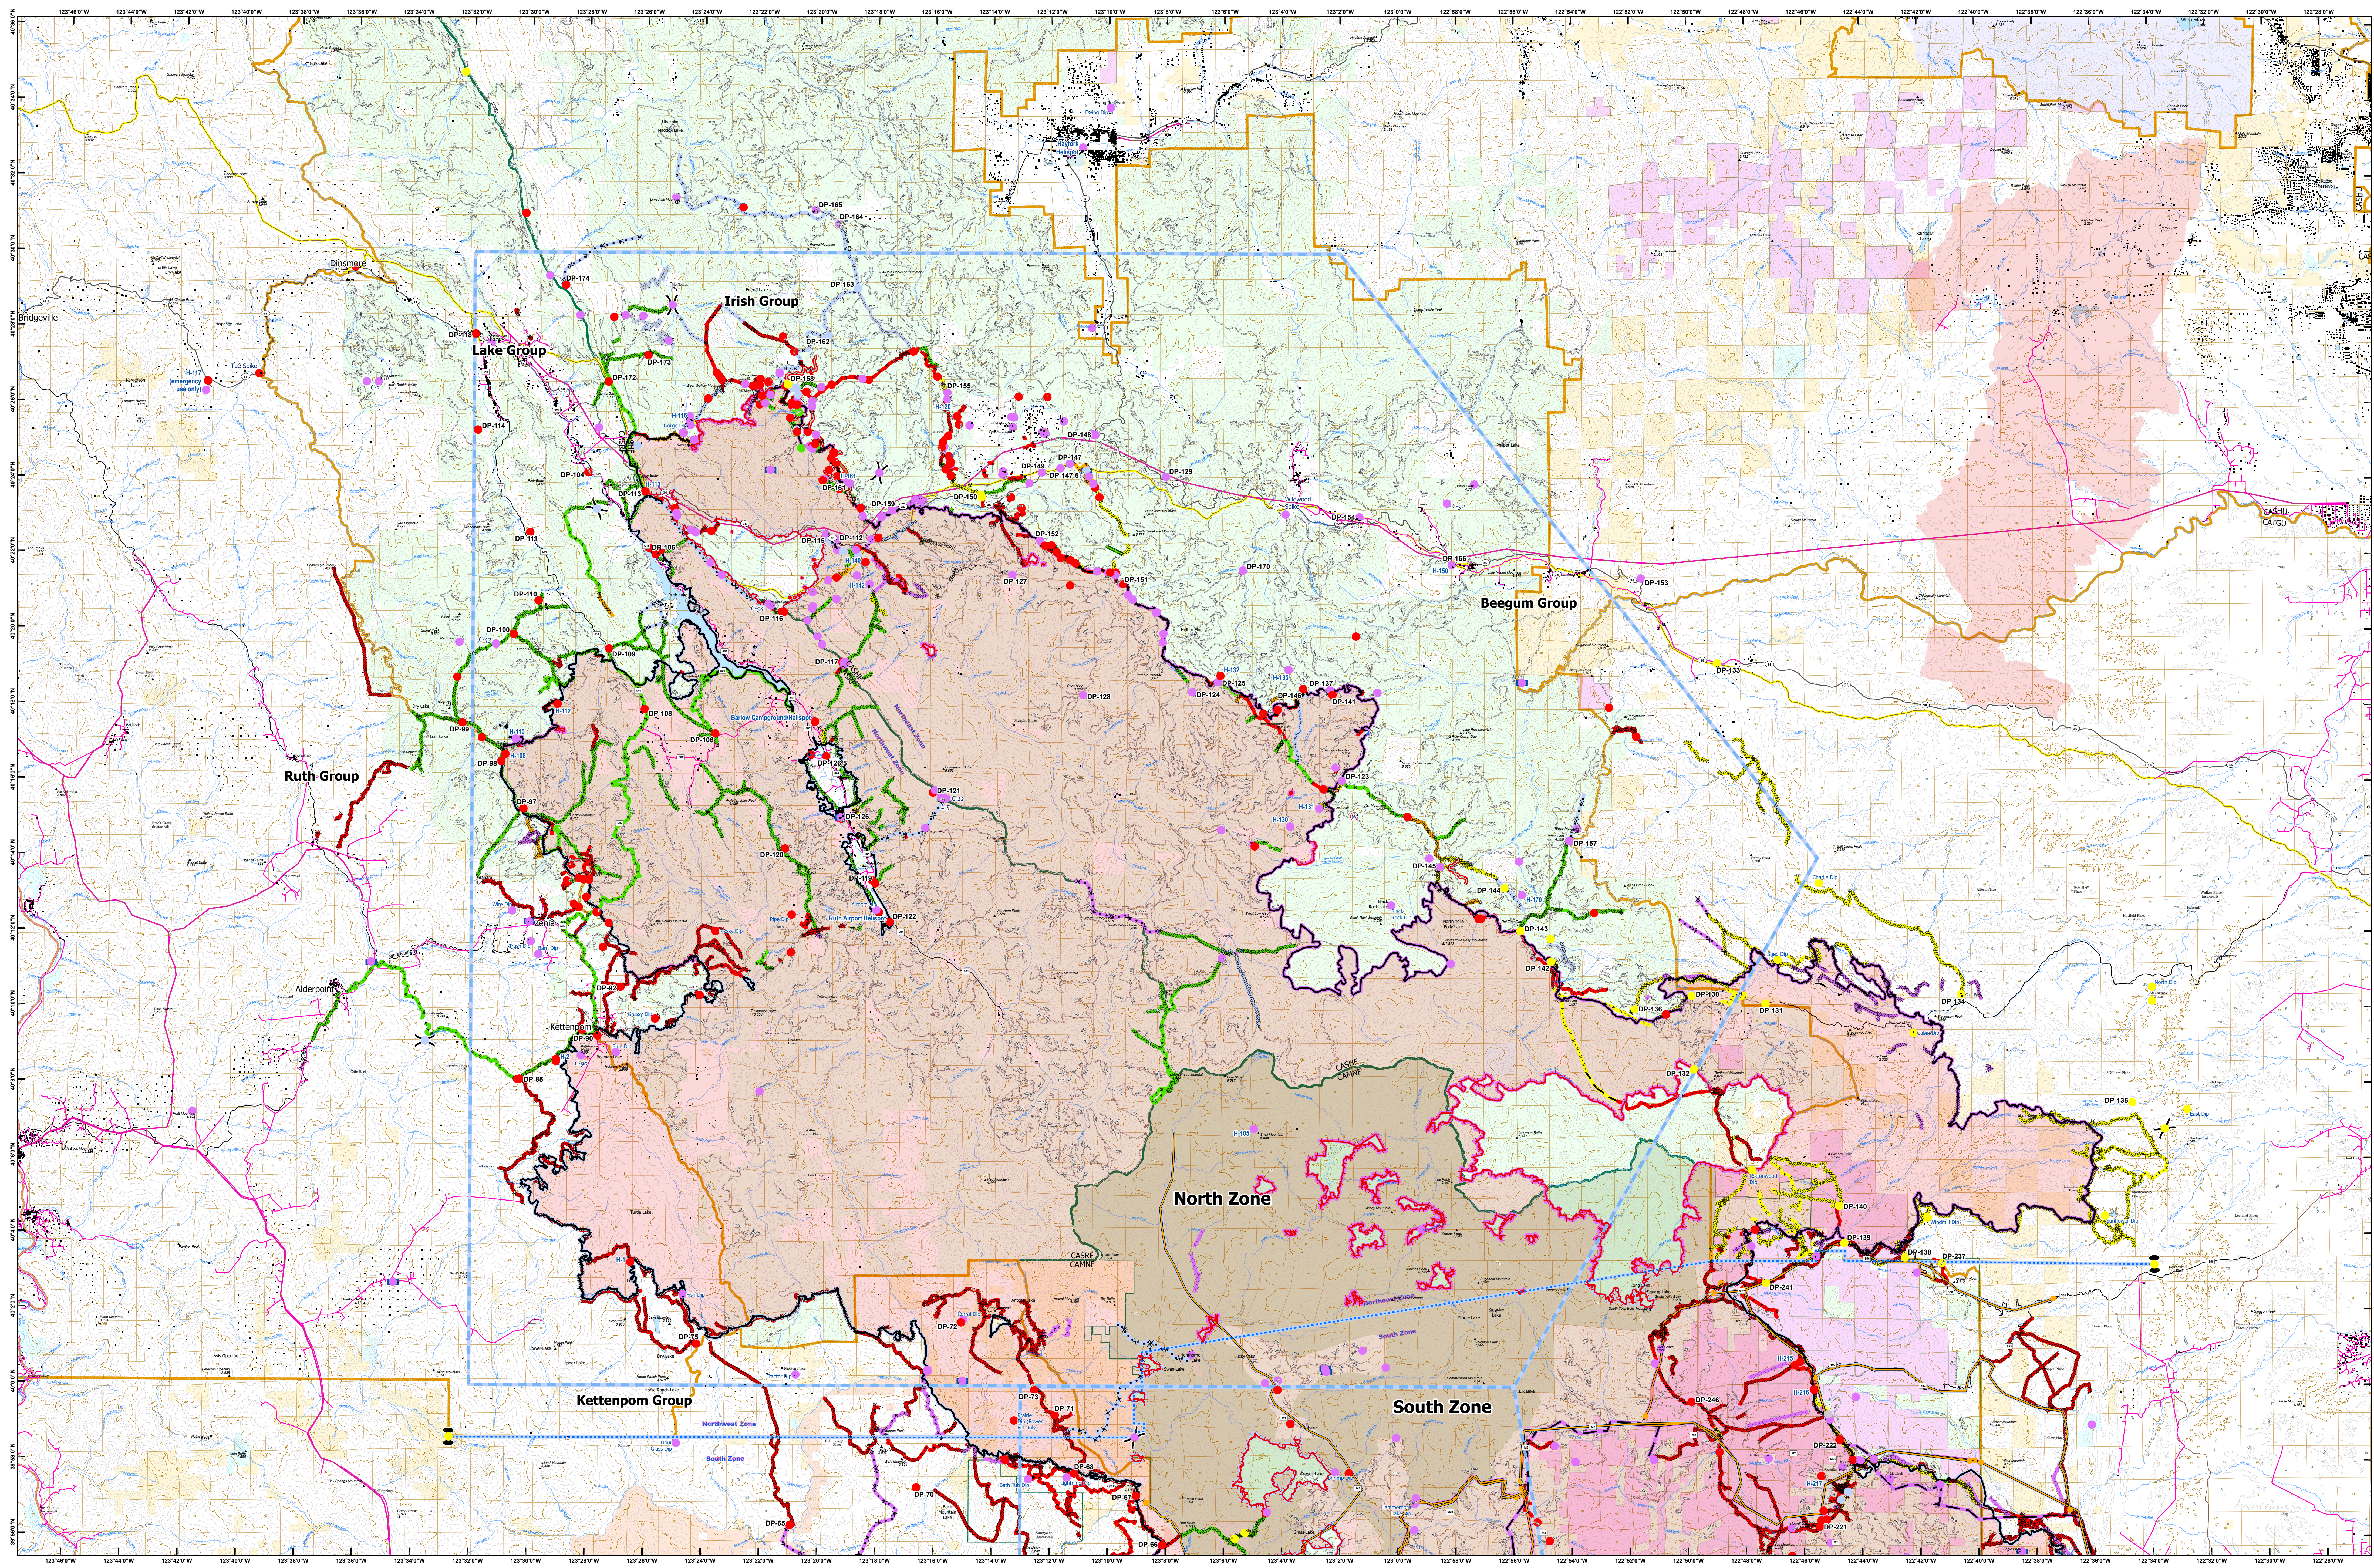