




Peterson, CA

24 June 2008 T1_A_080624_jk

Major Values-at-Risk per
FSPro Fire Spread Probabilities:
7 days as of 24 June 2008

- Current Fire Perimeter 24 June AM
- Past Fires 1994-2006
- FSPro Fire Spread Probabilities**
- > 80 %
- 60 - 80 %
- 40 - 60 %
- 20 - 40 %
- 5 - 20 %
- 1 - 5 %
- < 1 %
- # Building Clusters
- Z RAWs Stations
- Water: Dams > 100af
- Water Supply: Intakes
- Water Treatment Plants
- Water Pipeline - Aqueduct - Canal
- Powerlines
- D Industrial Plant
- * Power Pylon
- Power or Pumping Substation
- X Communication Towers
- Oil & Gas Transmission Lines
- Airports
- Airport Runways
- Ski Resort Cables
- Hospitals
- Schools
- HAZMAT: Mines
- W HAZMAT: Hazardous Waste
- Other Landmarks
- Interstates
- Major Roads
- Railways
- County Boundary
- Jurisdiction**
- Private
- State
- BLM
- USFS
- Inventoried Roadless
- Designated Wilderness
- Primitive RNA

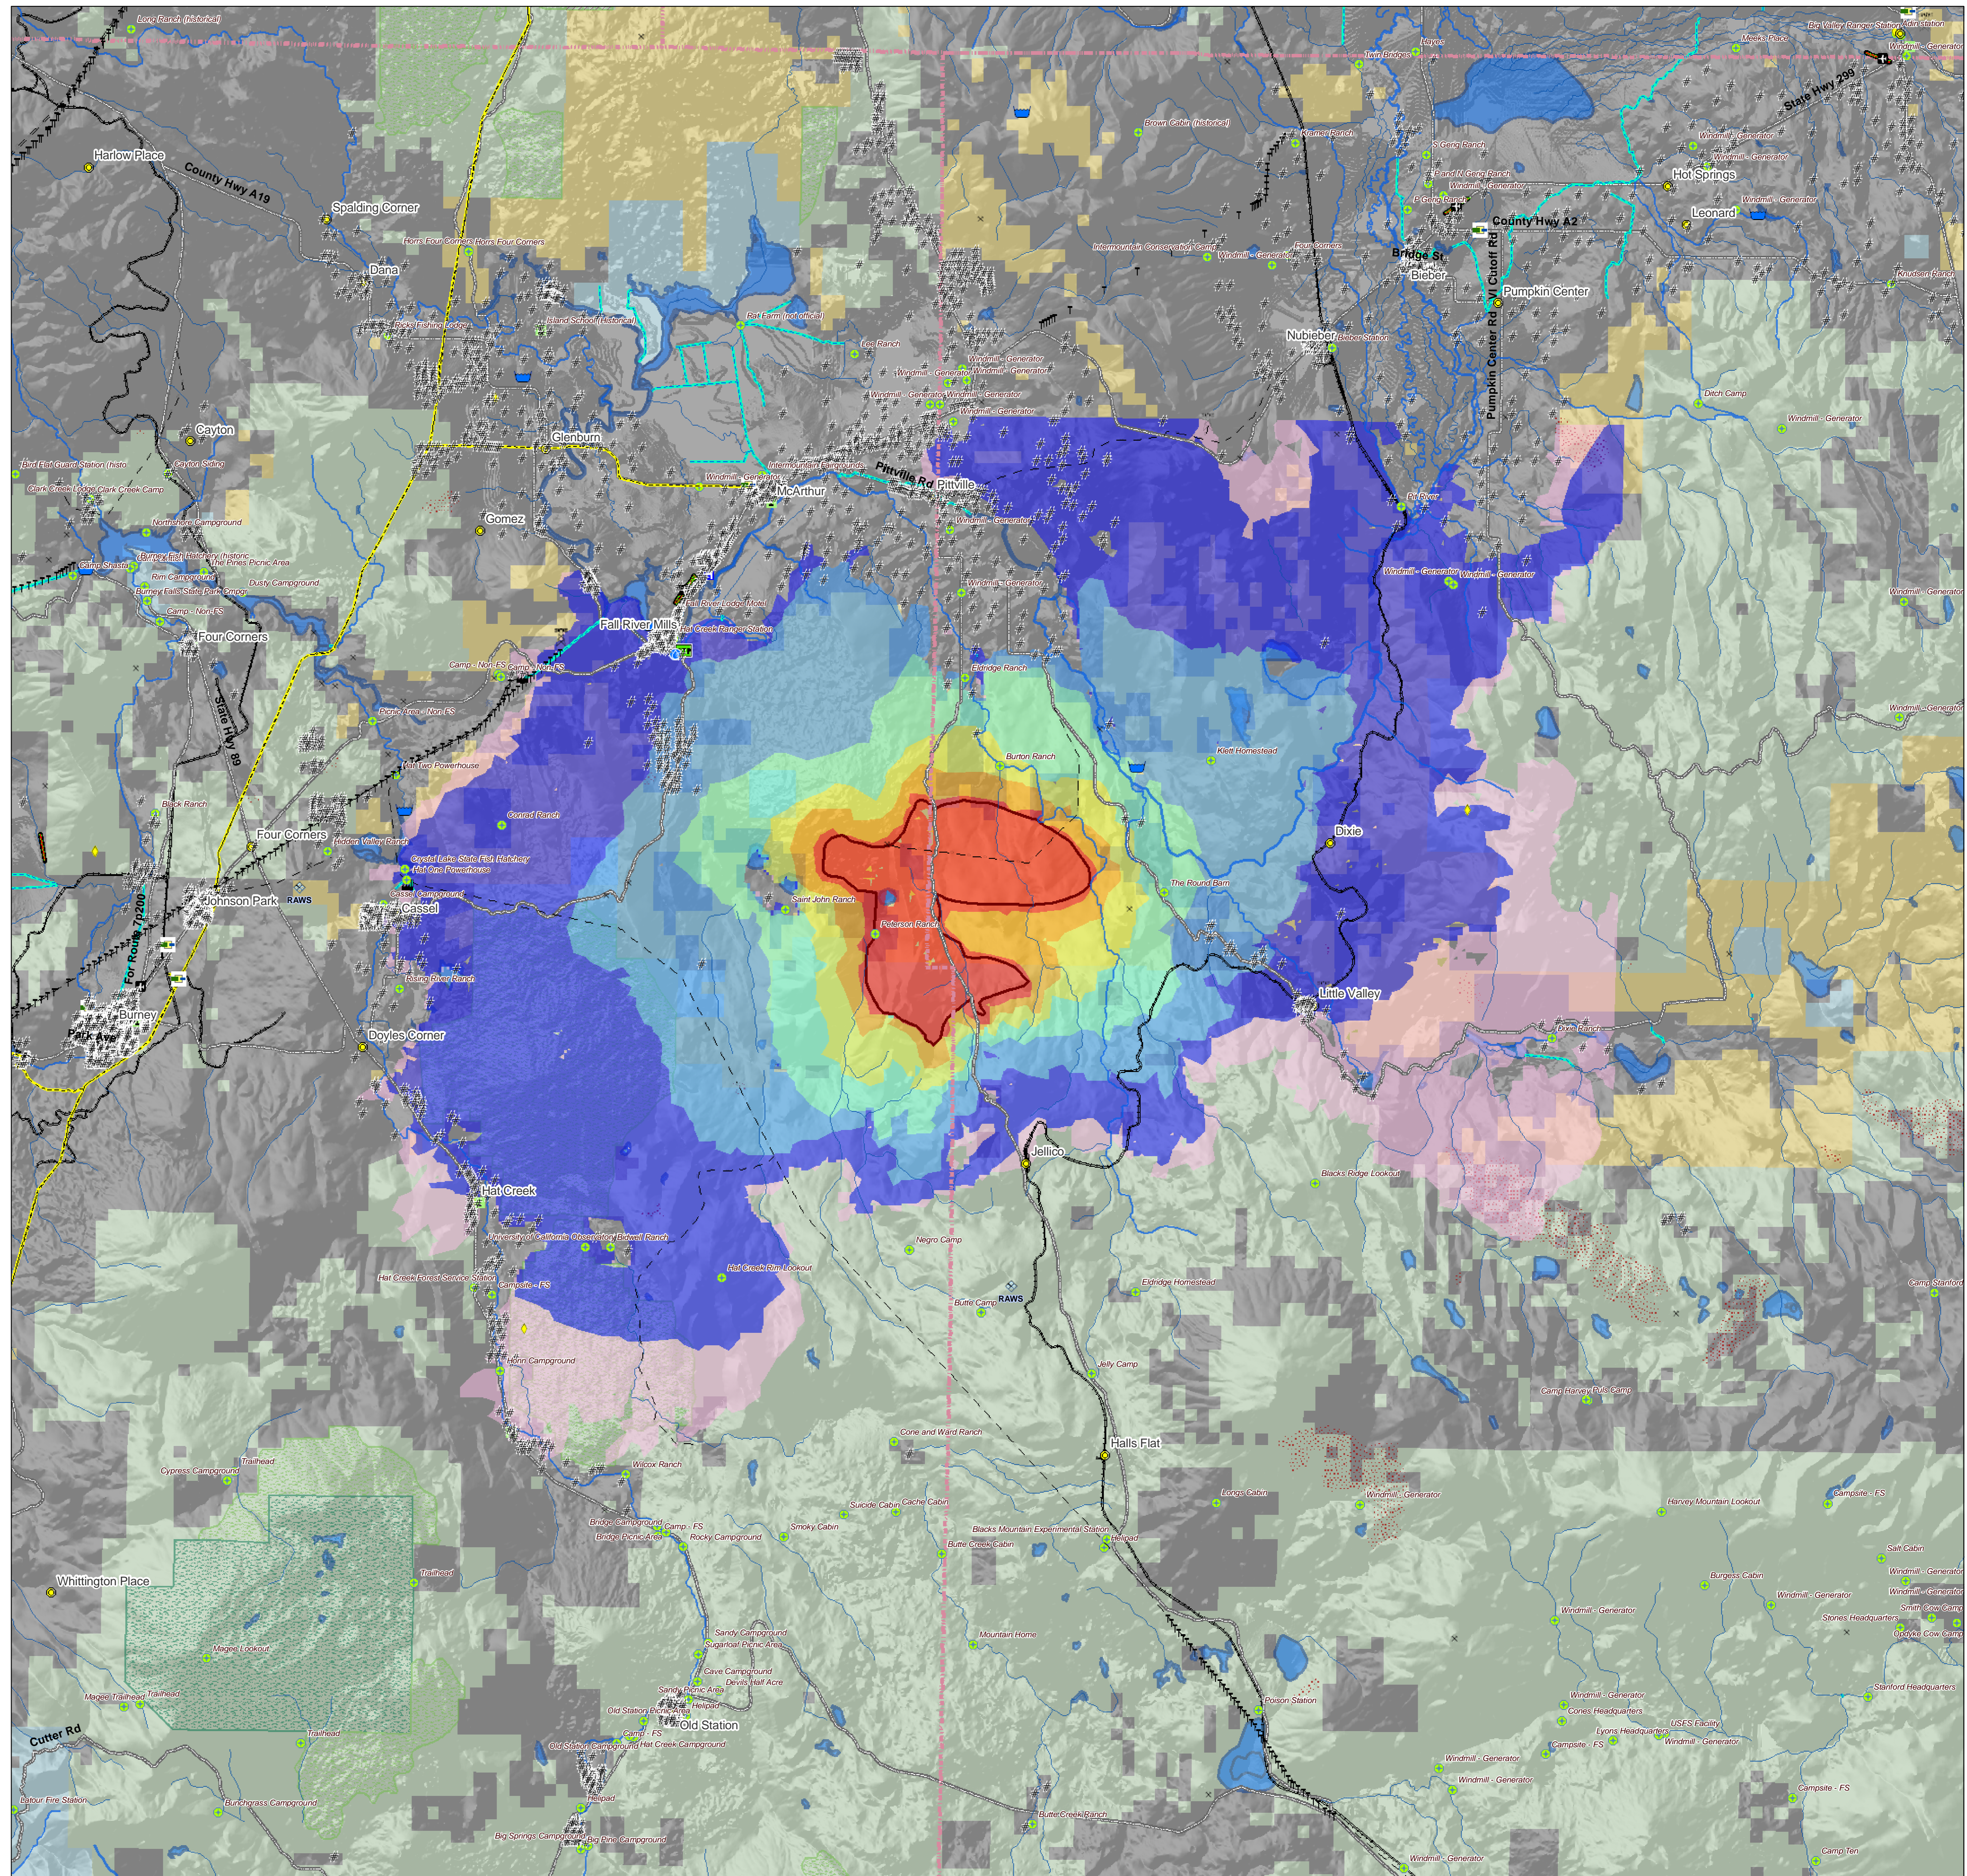

*Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

CAUTION: Defer to air photos or local knowledge for exact structure and other feature locations.

**Recreation residences and special use structures data are not available from USFS and are not identified or analyzed in this report.

1:80,000

