




### Cold, CA

23 June 2008 T1\_A\_080623\_jd

Major Values-at-Risk per  
FSPRO Fire Spread Probabilities:  
7 days as of 23 June 2008

**MAP REVISION:**  
**USGS Structure Points Added**

- FS Pro Fire Perimeter: 23 June
- Past Fires 1994-2007
- FSPRO Fire Spread Probabilities**
- > 80 %
- 60 - 80 %
- 40 - 60 %
- 20 - 40%
- 5 - 20 %
- 1 - 5 %
- < 1 %
- # Building Clusters: Plumas County\*
- # Structure Points USGS\*\*
- Z RAWs Stations
- [ Water Supply: Intakes
- Q Water Treatment Plants
- Water Pipeline - Aqueduct - Canal
- Powerlines
- D Industrial Plant
- Power Pylon
- X Communication Towers
- Æ Airports
- Airport Runways
- Ski Resort Cables
- V Hospitals
- n Schools
- ⚡ HAZMAT: Mines
- W HAZMAT: Hazardous Waste
- Other Landmarks
- Interstates
- Major Roads
- Railways
- County Boundary
- Jurisdiction**
- Private
- State
- BIA
- BLM
- USFS
- Inventoried Roadless
- Designated Wilderness
- Wild-Scenic-Rec Rivers

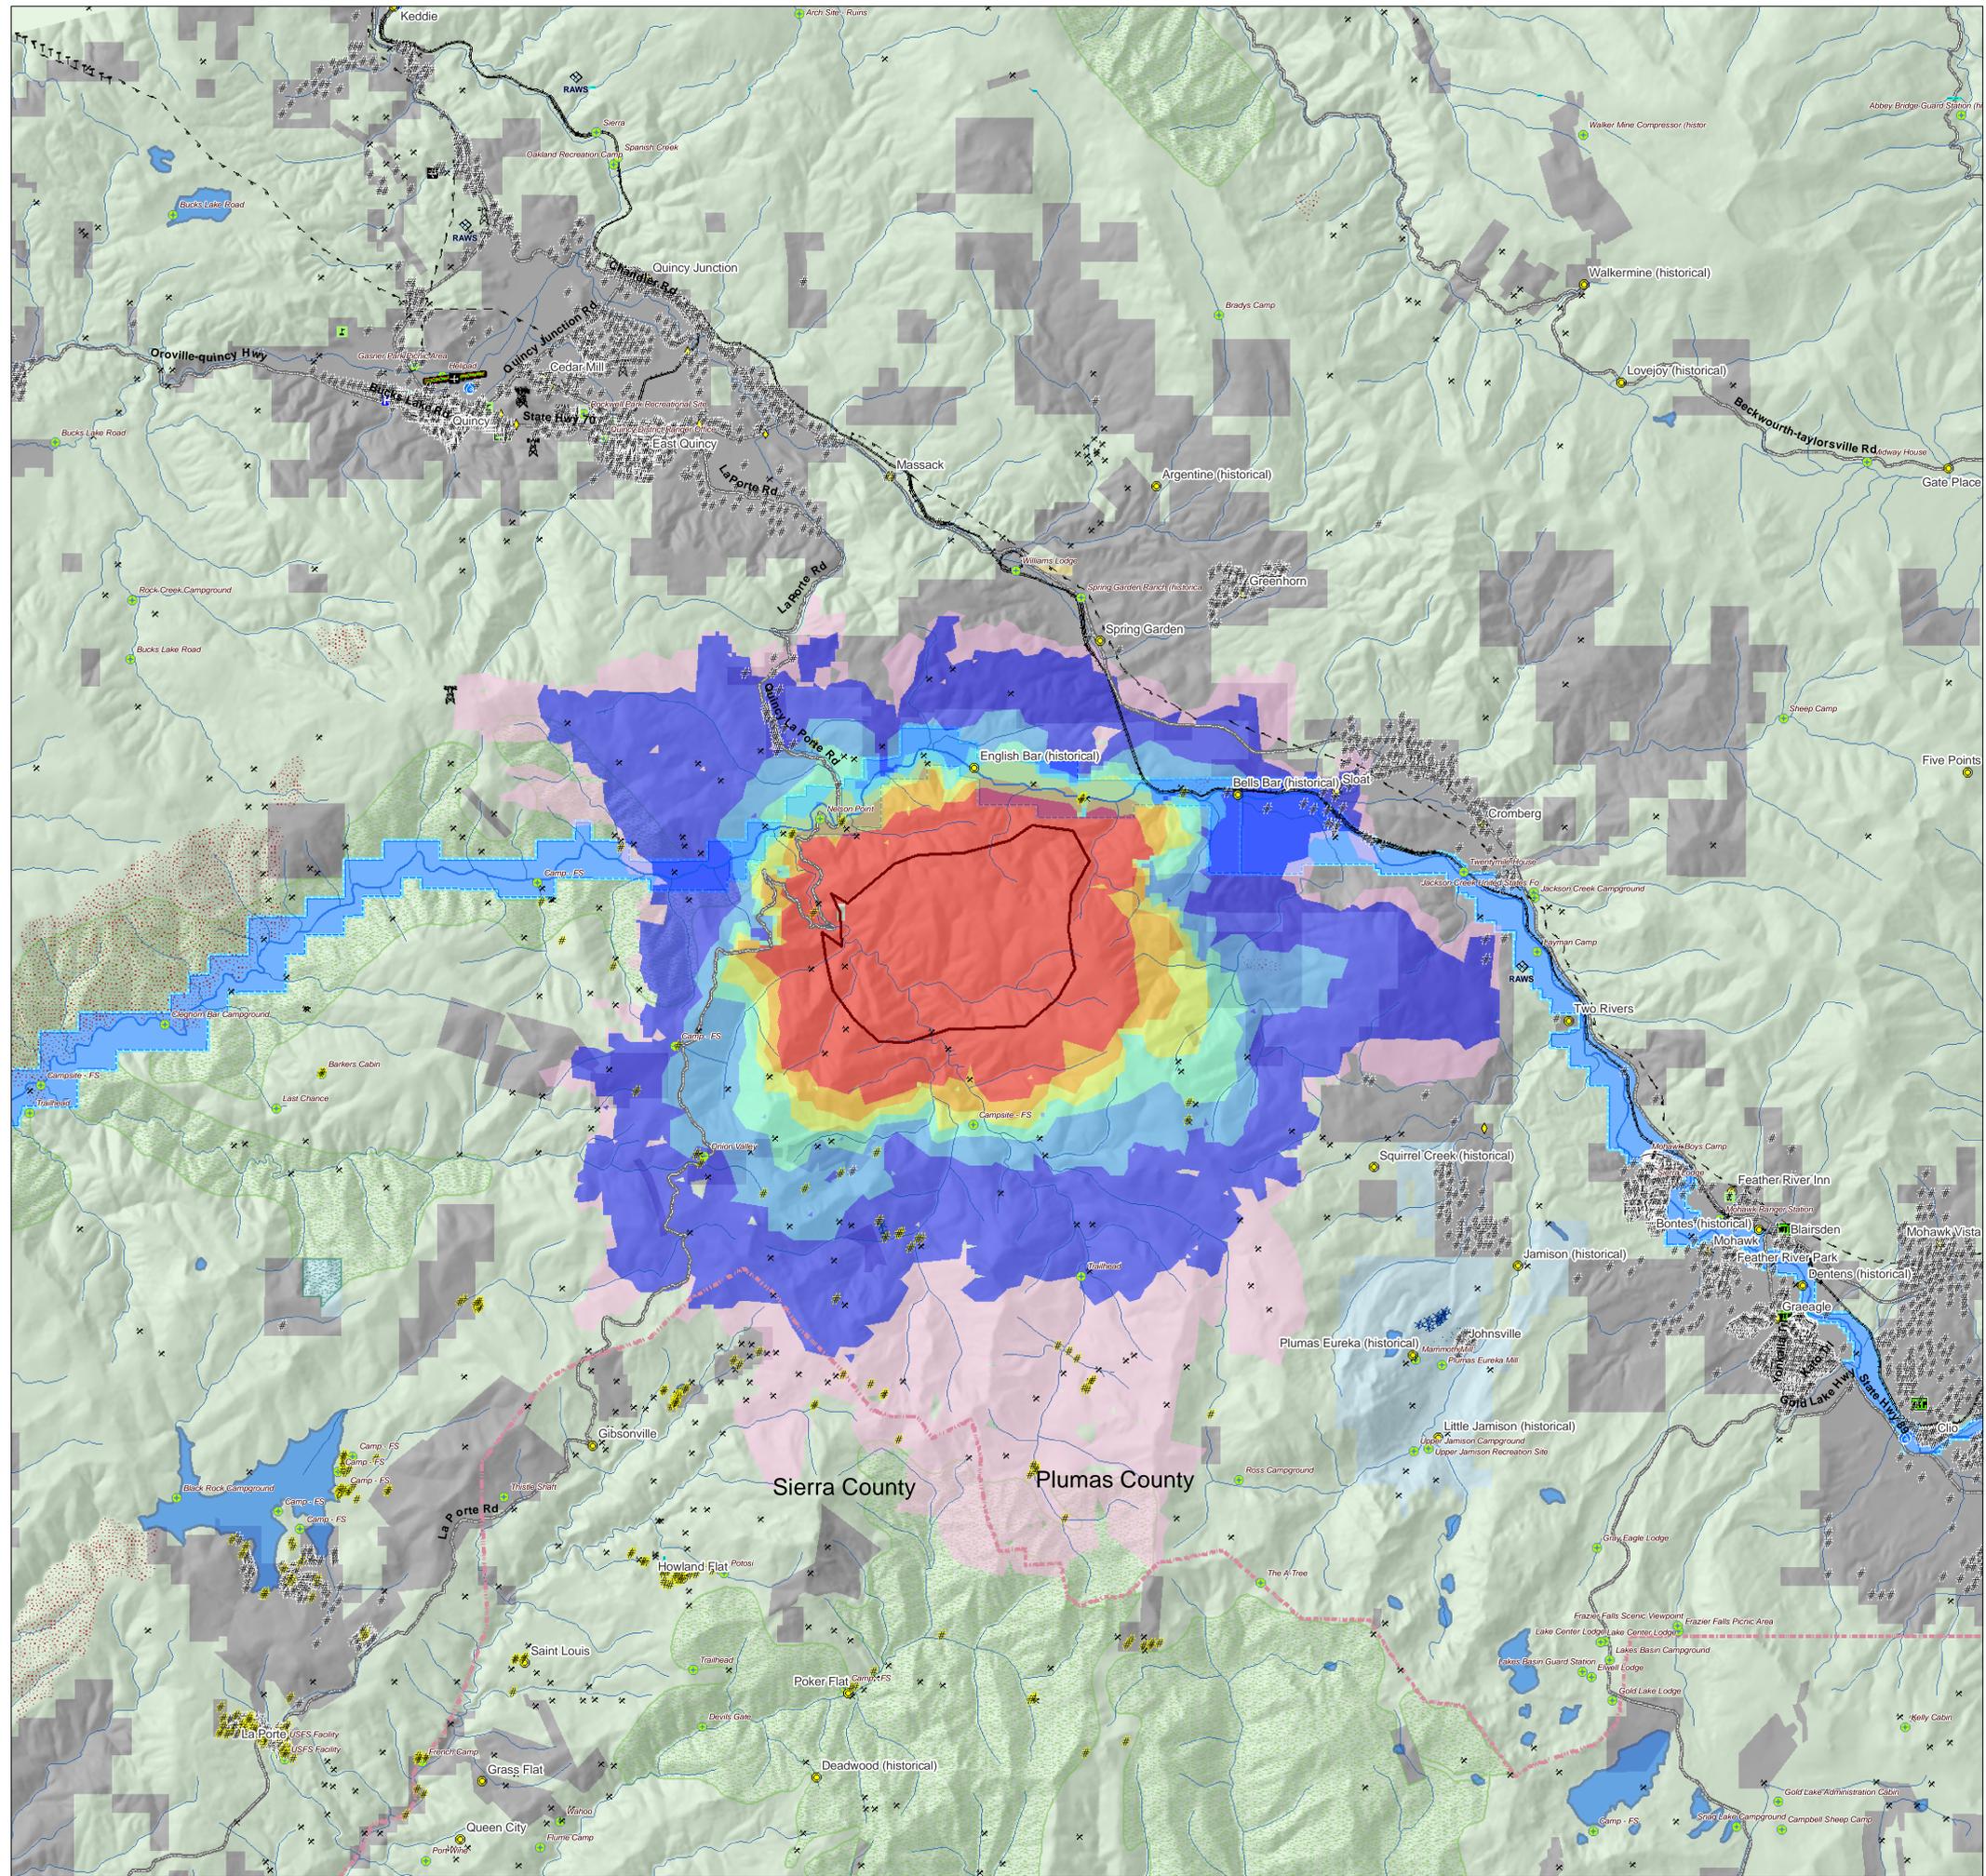

\*Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

\*\* Structure points are derived by the USGS through supervised analysis of high resolution aerial photography. Structures within dense canopy may not be mapped.

**CAUTION:** Defer to air photos or local knowledge for exact structure and other feature locations.

1:50,000

