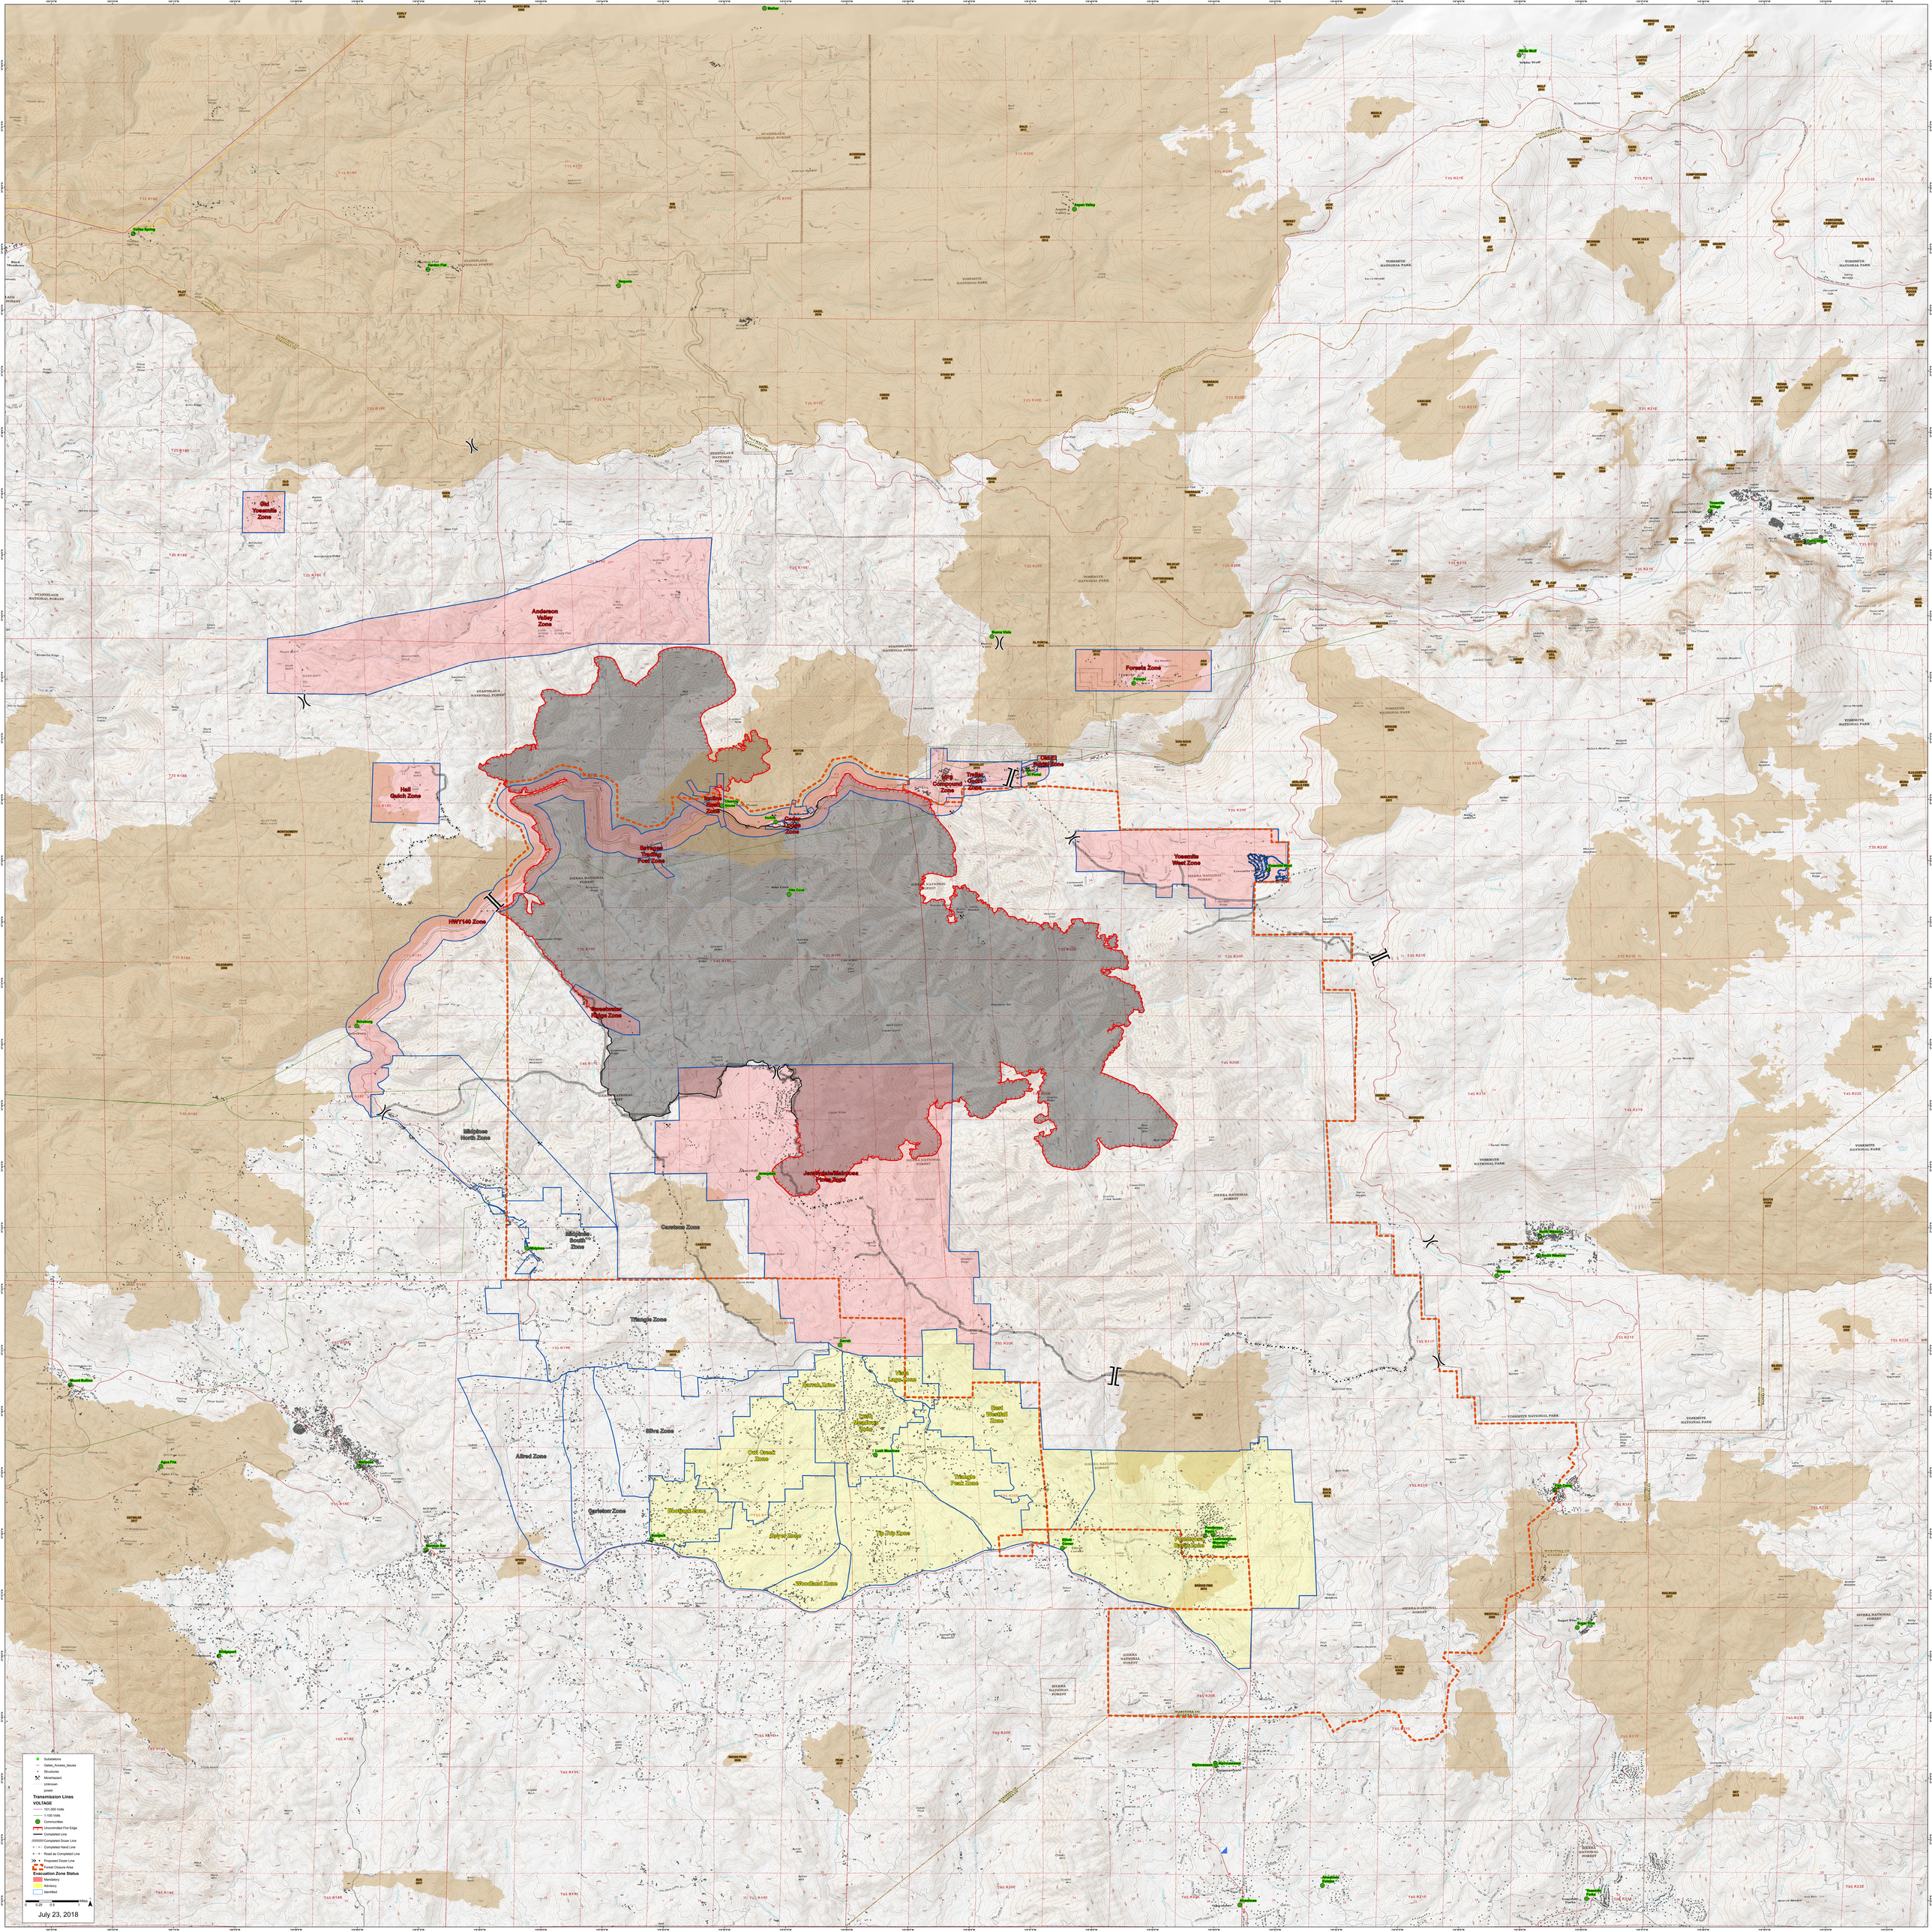

Old Yosemite Zone
Anderson Valley Zone
Forests Zone
Hall Gulch Zone
Yosemite West Zone
HWY140 Zone
Midpines North Zone
Midpines South Zone
Carstens Zone
Triangle Zone
Silva Zone
Allred Zone
Carleton Zone
Substations
Gates_Access_Issues
Structures
Minimized
Unknown
power
Transmission Lines
VOLTAGE
101-300 Volts
5-100 Volts
Communities
Uncontrolled Fire Edge
Completed Line
Completed Dozer Line
Completed Hand Line
Road as Completed Line
Proposed Dozer Line
Forced Closure Area
Evacuation Zone Status
Mandatory
Advisory
Identified
0 0.25 0.5 1 Miles
July 23, 2018