



Butler II Fire, CA

15 September 2007 - T1_A_070915_kh

Tier I: Major Values-at-Risk per FSPRO Fire Spread Probabilities: 7 days as of 15 September 2007


MODIS Heat Points: 15 September

- ! 15 September
- ! 14 September
- ! Prior 6 days
- Past Fires 1994-2006

FSPRO Fire Spread Probability

- > 80 %
- 60 - 80 %
- 40 - 60 %
- 20 - 40 %
- 5 - 20 %
- 1 - 5 %
- < 1 %

- Z RAWs Stations
- # Building Clusters: San Bernardino Co.
- Water: Dams > 100af
- Water Supply: Intakes
- Water Treatment Plants
- Water Pipeline - Aqueduct - Canal
- Powerlines
- D Industrial Plant
- * Power Pylon
- Power or Pumping Substation
- X Communication Towers
- Oil & Gas Transmission Lines
- ✈ Airports
- ✈ Airport Runways
- Ski Resort Cables
- Hospitals
- n Schools
- HAZMAT: Mines
- W HAZMAT: Hazardous Waste
- Other Landmarks
- Interstates
- Major Roads
- Local Roads (USFS)
- Railways
- County Boundary
- Jurisdiction**
- Private
- State
- BLM
- USFS
- Inventoried Roadless
- Designated Wilderness
- Experimental RNA
- Primitive RNA

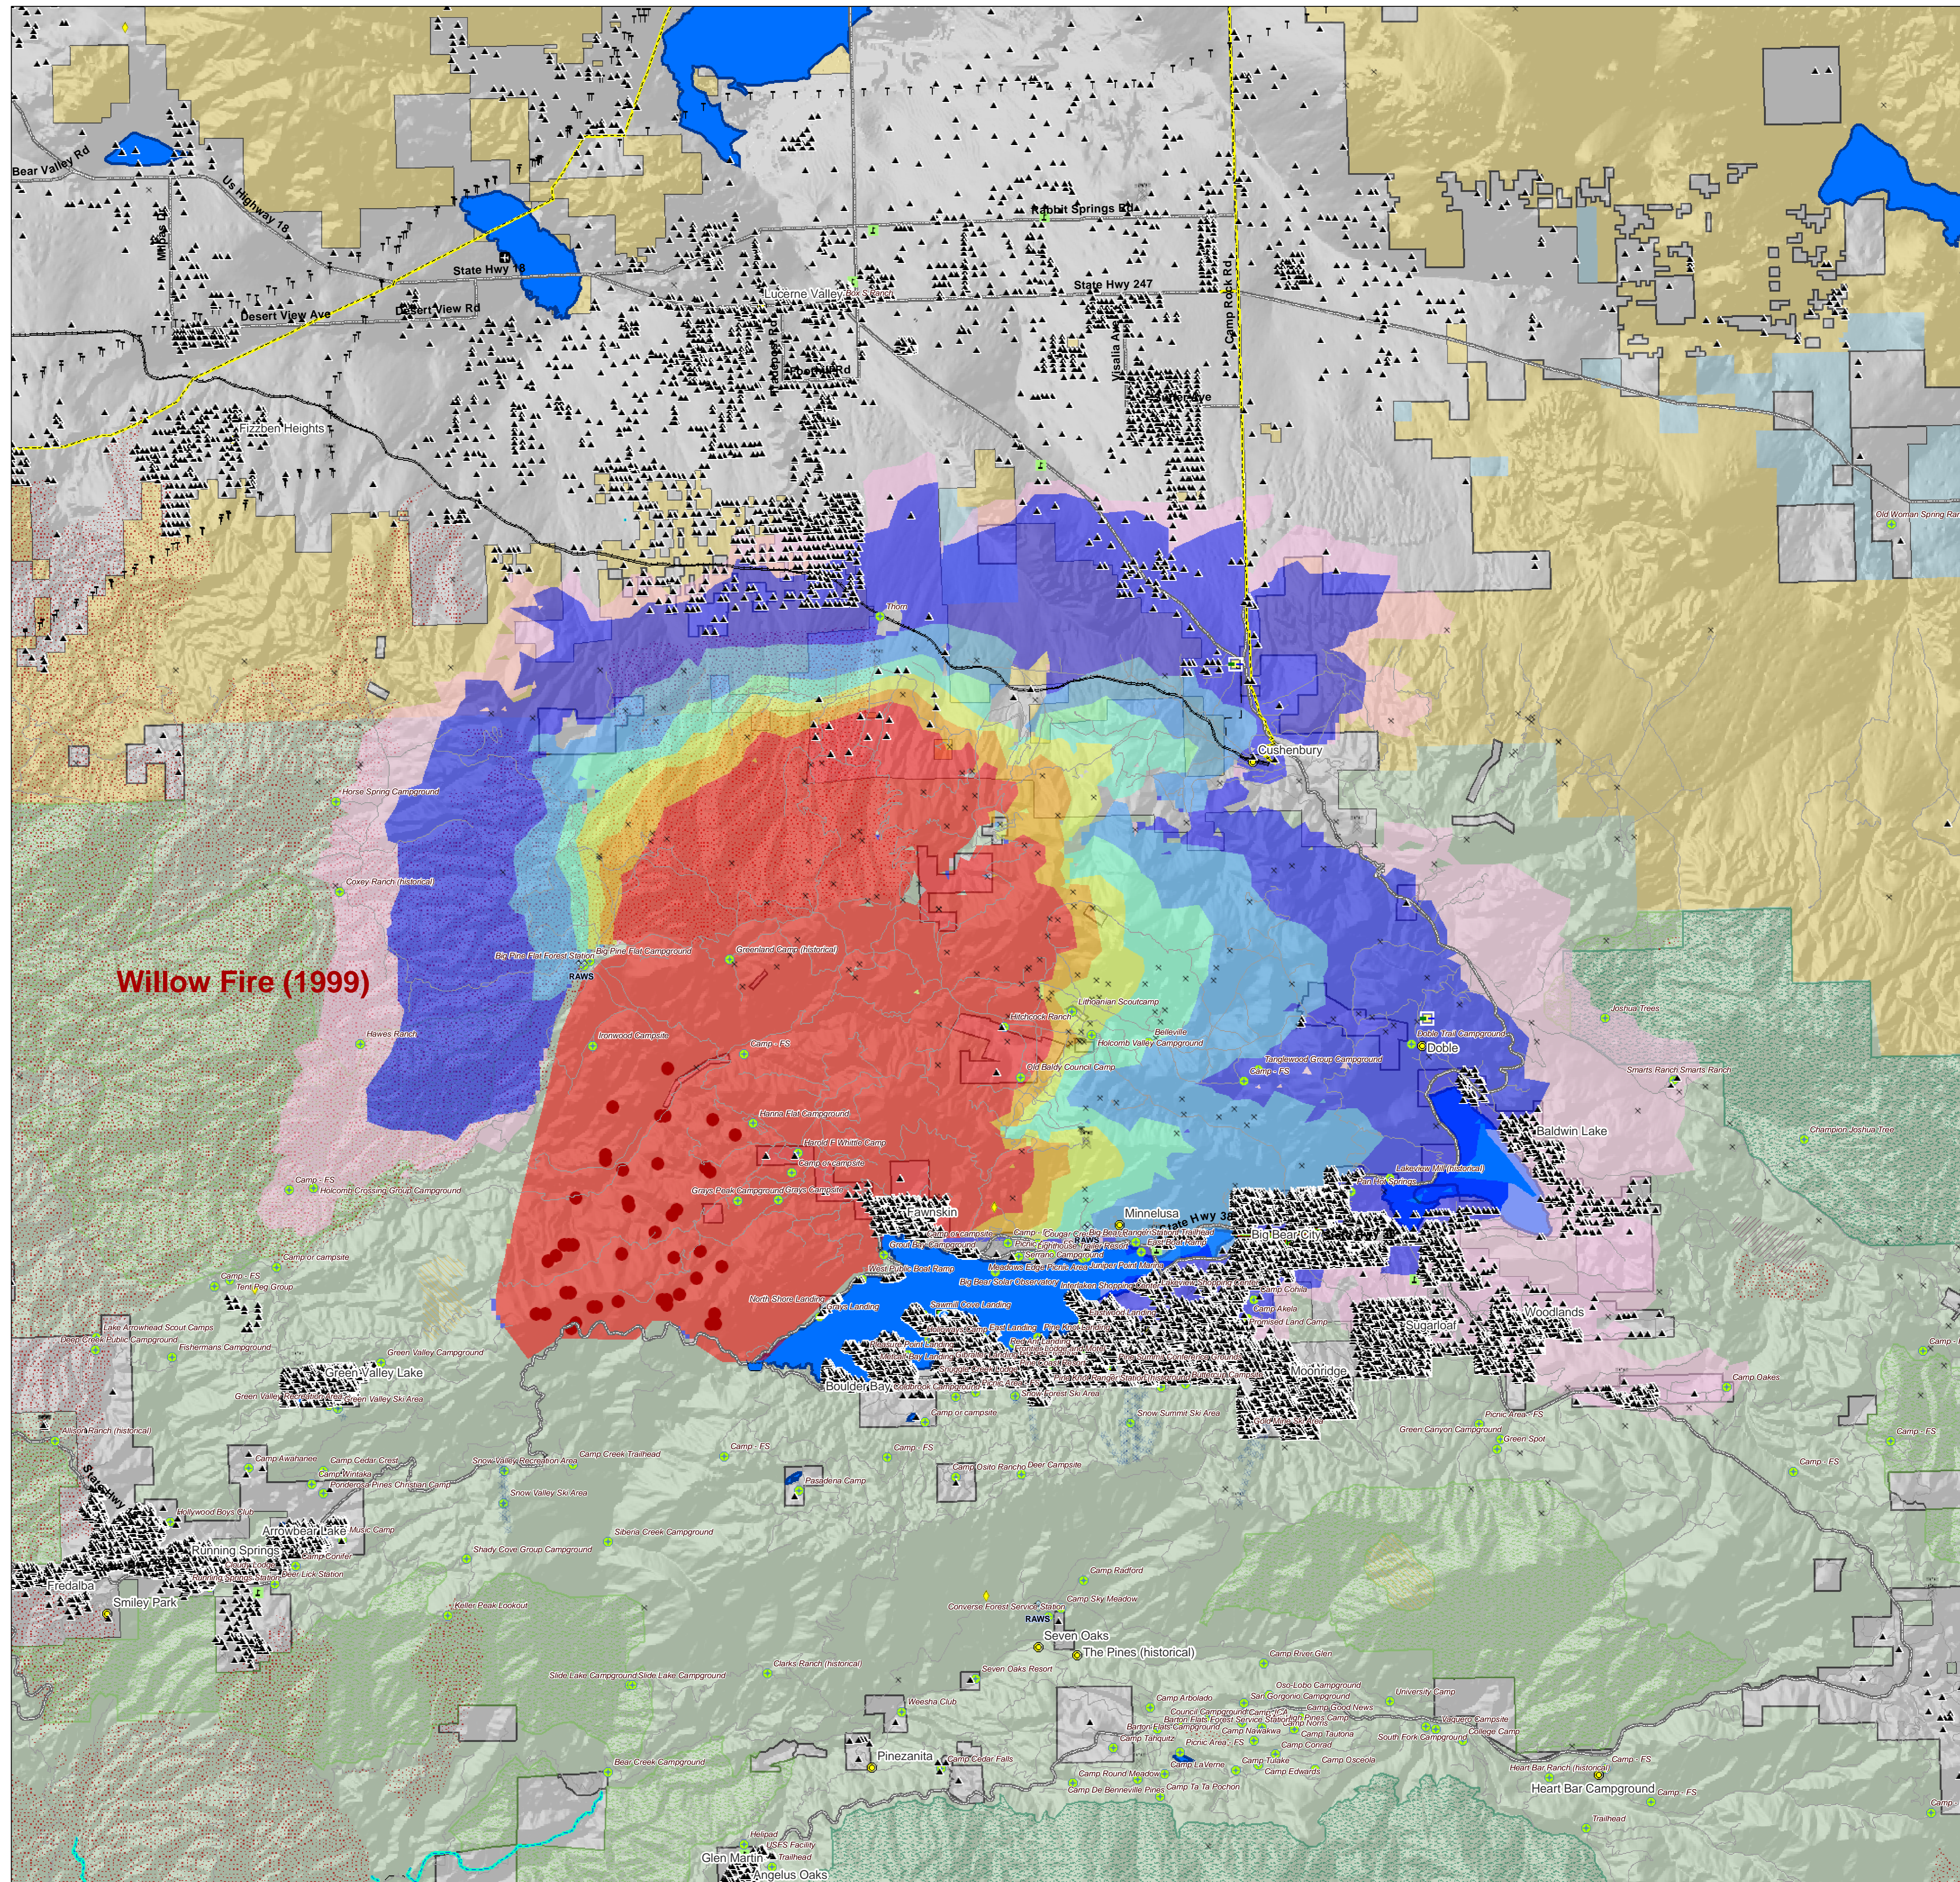

*Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

CAUTION: Defer to air photos or local knowledge for exact structure and other feature locations.

1:50,000

