



Santiago Fire, CA

T3_A_071024-1A_jk 24 October 2007

Major Values-at-Risk per
FSPRO Fire Spread Probabilities:
14 days as of 25 October 2007

Fire Perimeter: 24 Oct AM

MODIS Points: 24 Oct AM

- ! 24 October 2007
- ! 23 October 2007
- ! Prior 6 days
- ! Past Fires 2000-2006

FSPRO Fire Spread Probabilities

- > 80 %
- 60 - 80 %
- 40 - 60 %
- 20 - 40 %
- 5 - 20 %
- 1 - 5 %
- < 1 %

Z RAWs Stations

Building Clusters: County Provided Data

* Building Clusters: Orange County USGS

W Water: Dams > 100af

W Water Supply: Intakes

W Water Treatment Plants

W Water Pipeline - Aqueduct - Canal

--- Powerlines

D Industrial Plant

* Power Pylon

--- Power or Pumping Substation

X Communication Towers

--- Oil & Gas Transmission Lines

A Airports

--- Airport Runways

--- Ski Resort Cables

V Hospitals

n Schools

W HAZMAT: Mines

W HAZMAT: Superfund Sites

W HAZMAT: Hazardous Waste

W Other Landmarks

--- Interstates

--- Major Roads

--- Railways

--- County Boundary

Jurisdiction

Private

State

BLM


Other Federal

DOD

USFS

Inventoried Roadless

Designated Wilderness

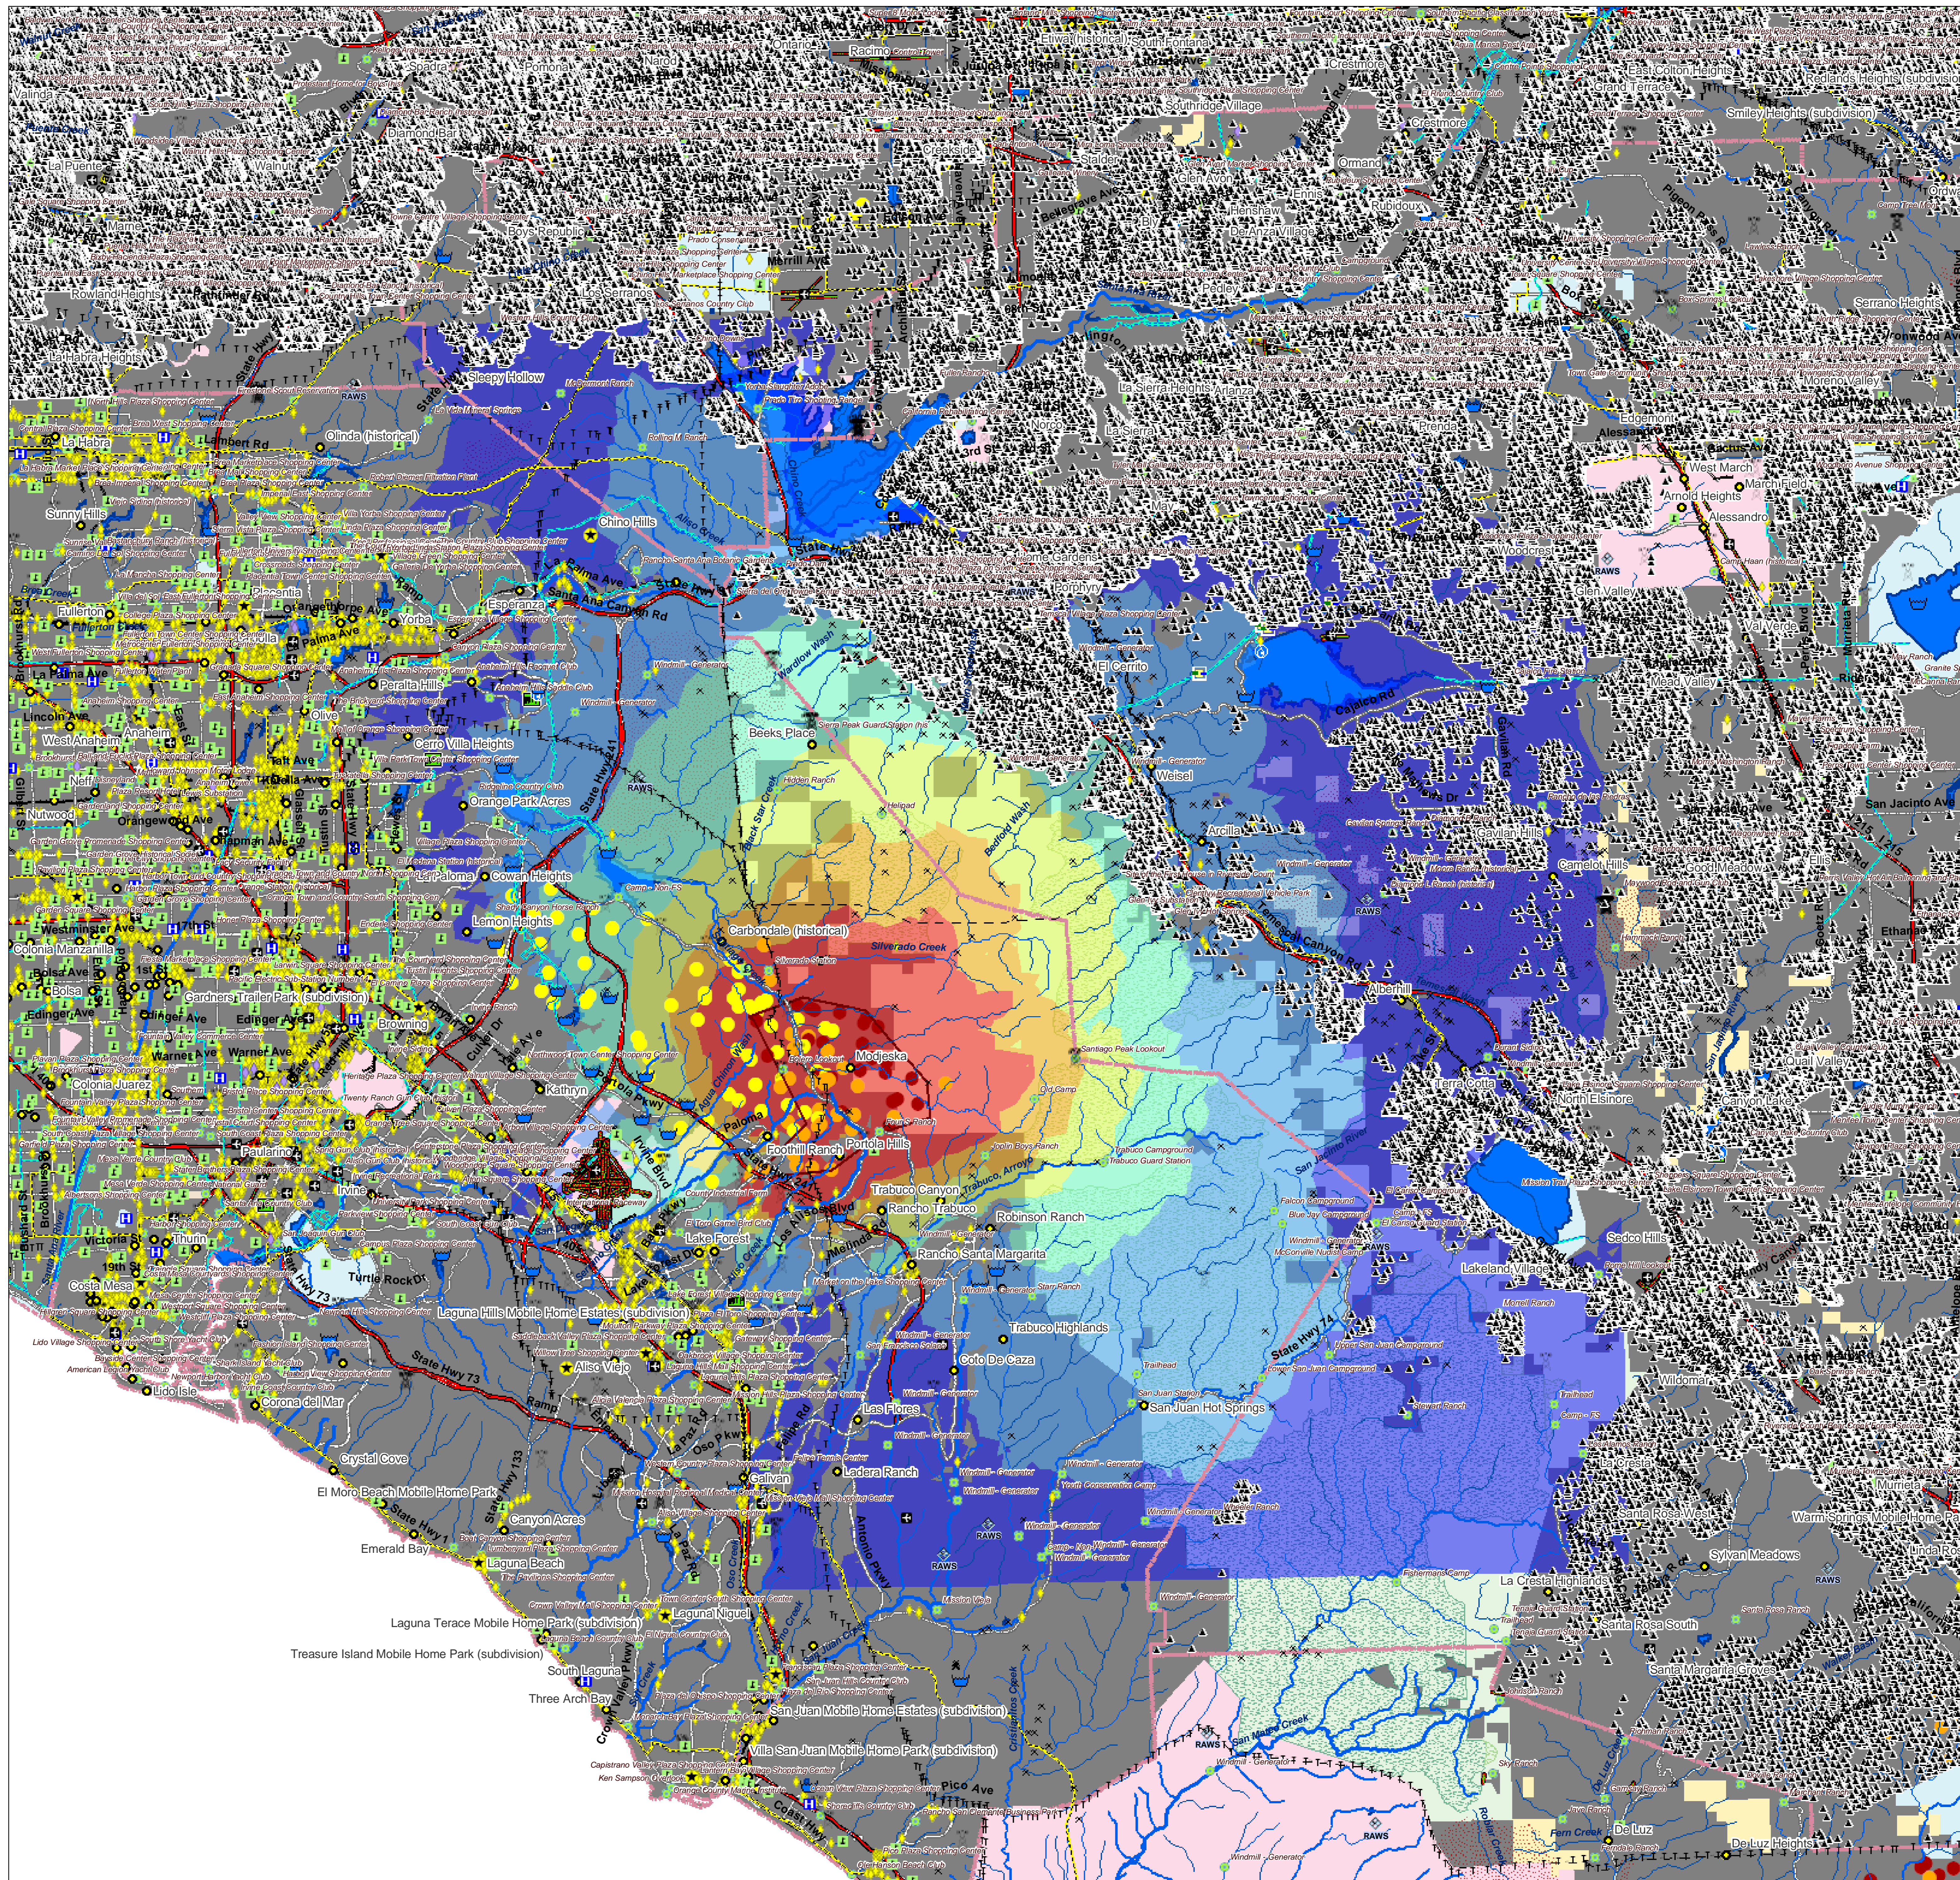

*Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

CAUTION: Defer to air photos or local knowledge for exact structure and other feature locations.

