



### Santiago Fire, CA

T3\_A\_071024-1A\_jk 24 October 2007

Major Values-at-Risk per FSPRO Fire Spread Probabilities: 14 days as of 25 October 2007

Fire Perimeter: 24 Oct AM

MODIS Points: 24 Oct AM

24 October 2007

23 October 2007

Prior 6 days

Past Fires 2000-2006

FSPRO Fire Spread Probabilities

> 80 %

60 - 80 %

40 - 60 %

20 - 40 %

5 - 20 %

1 - 5 %

< 1 %

Z RAWs Stations

# Building Clusters: County Provided Data

▲ Building Clusters: Orange County USGS

W Water: Dams > 100af

U Water Supply: Intakes

Q Water Treatment Plants

Water Pipeline - Aqueduct - Canal

Powerlines

D Industrial Plant

\* Power Pylon

Power or Pumping Substation

X Communication Towers

Oil & Gas Transmission Lines

Æ Airports

Airport Runways

Ski Resort Cables

Hospitals

n Schools

HAZMAT: Mines

W HAZMAT: Superfund Sites

W HAZMAT: Hazardous Waste

Other Landmarks

Interstates

Major Roads

Railways

County Boundary

Jurisdiction

Private

State

BLM


Other Federal

DOD

USFS

Inventoried Roadless

Designated Wilderness

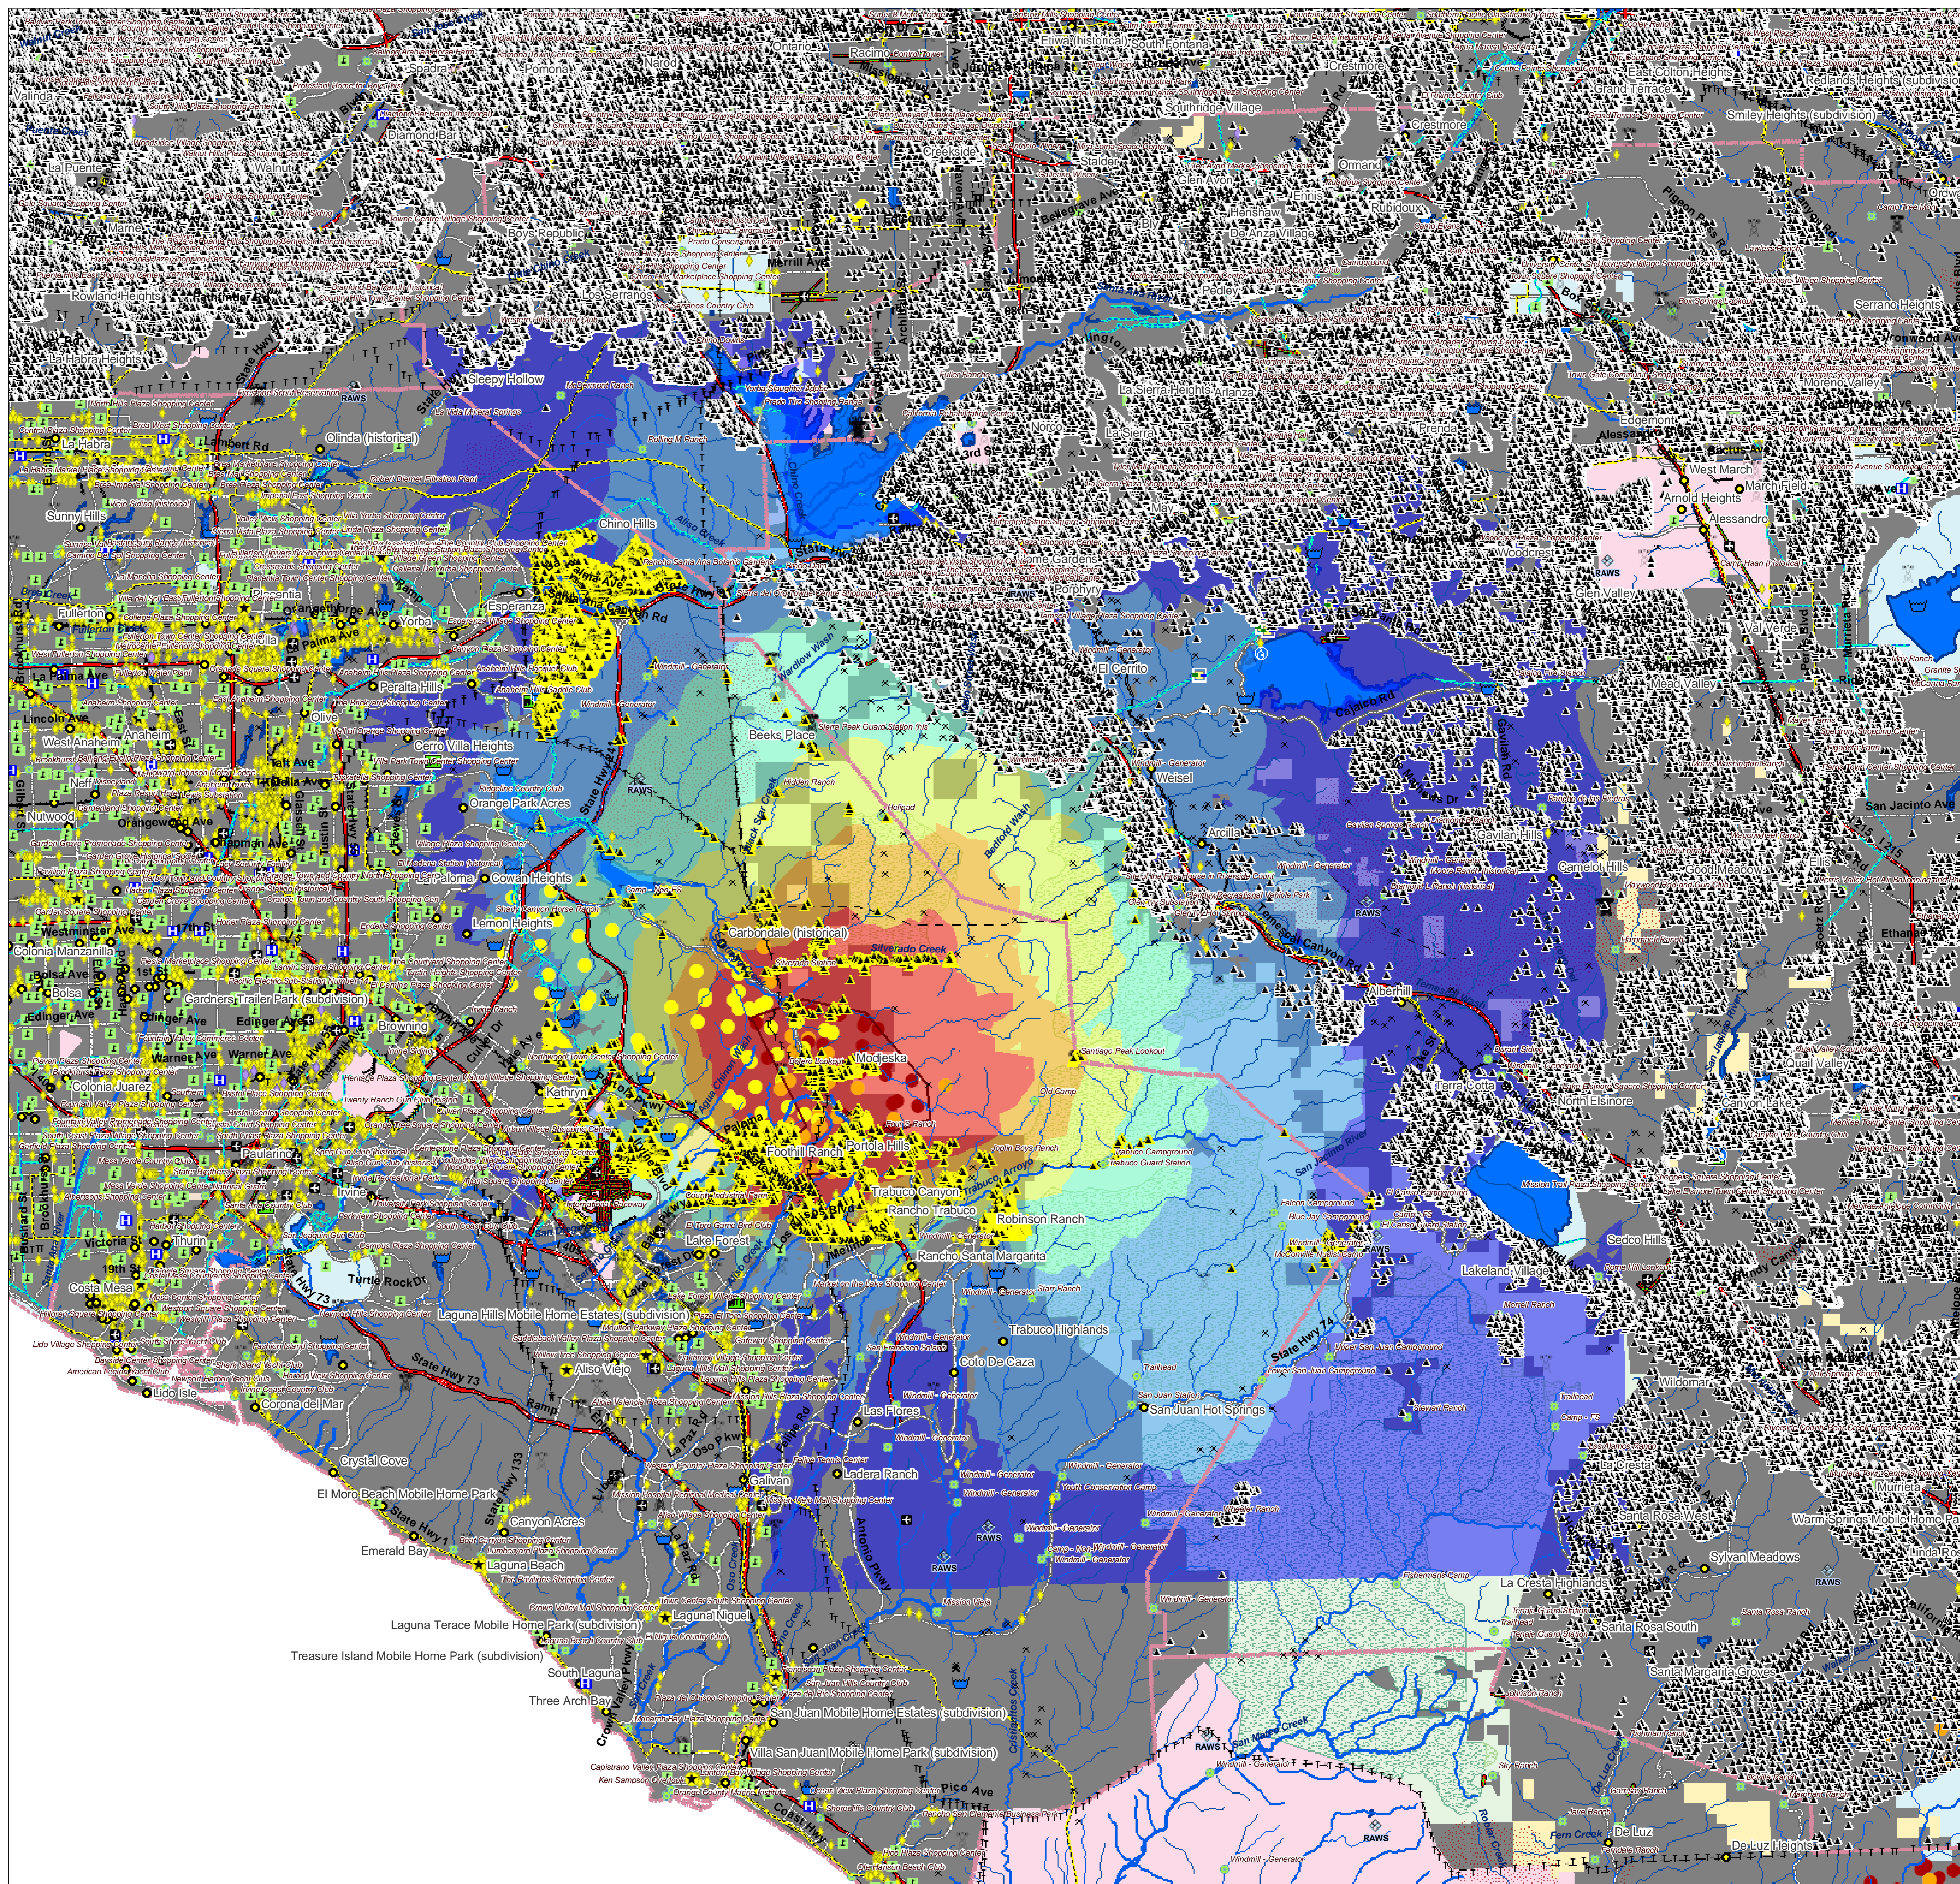

\*Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

CAUTION: Defer to air photos or local knowledge for exact structure and other feature locations.

1:90,000

0 2.5 5 10 Miles