




Prescribed Burning LMR Determinations

Last Approved Year:
2023

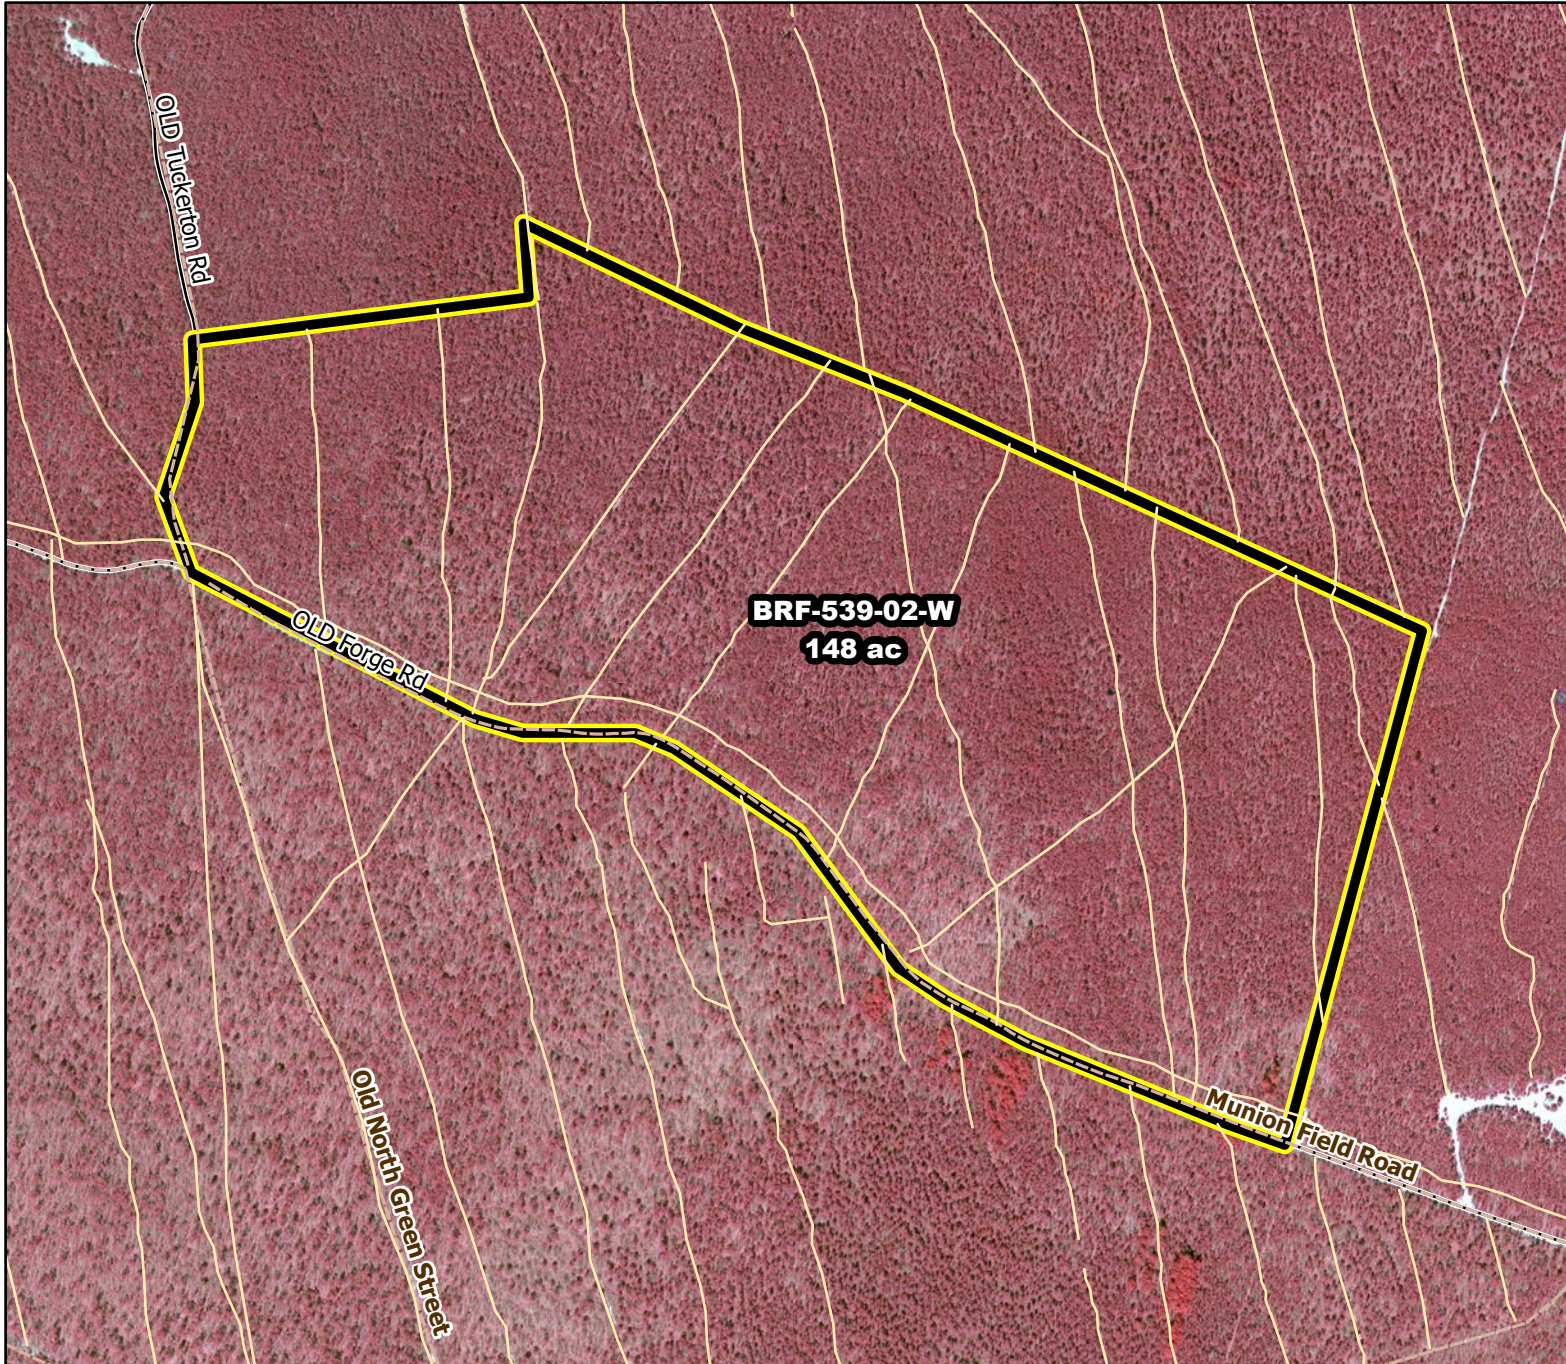

BRF-539-02-W
148 ac

BRF-539-02-W


**Conditionally
Approved**

ONLM COMMENTS:
2018: Mixed intensity burn recommended to maintain Pb4/5; Growing season burn approved for testing

ENSP COMMENTS:
Herp concerns - Burn 11/15 through 3/15, with possible extension until 3/31 with an ecological justification

HPO COMMENTS:
no comment

SFS COMMENTS:
Other LMR constraints are met

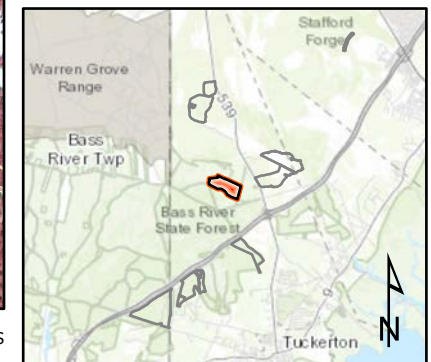

1,200 ft

MTC, NJFFS
2021.01.06