




# Prescribed Burning LMR Determinations

Last Approved Year:  
**2024**

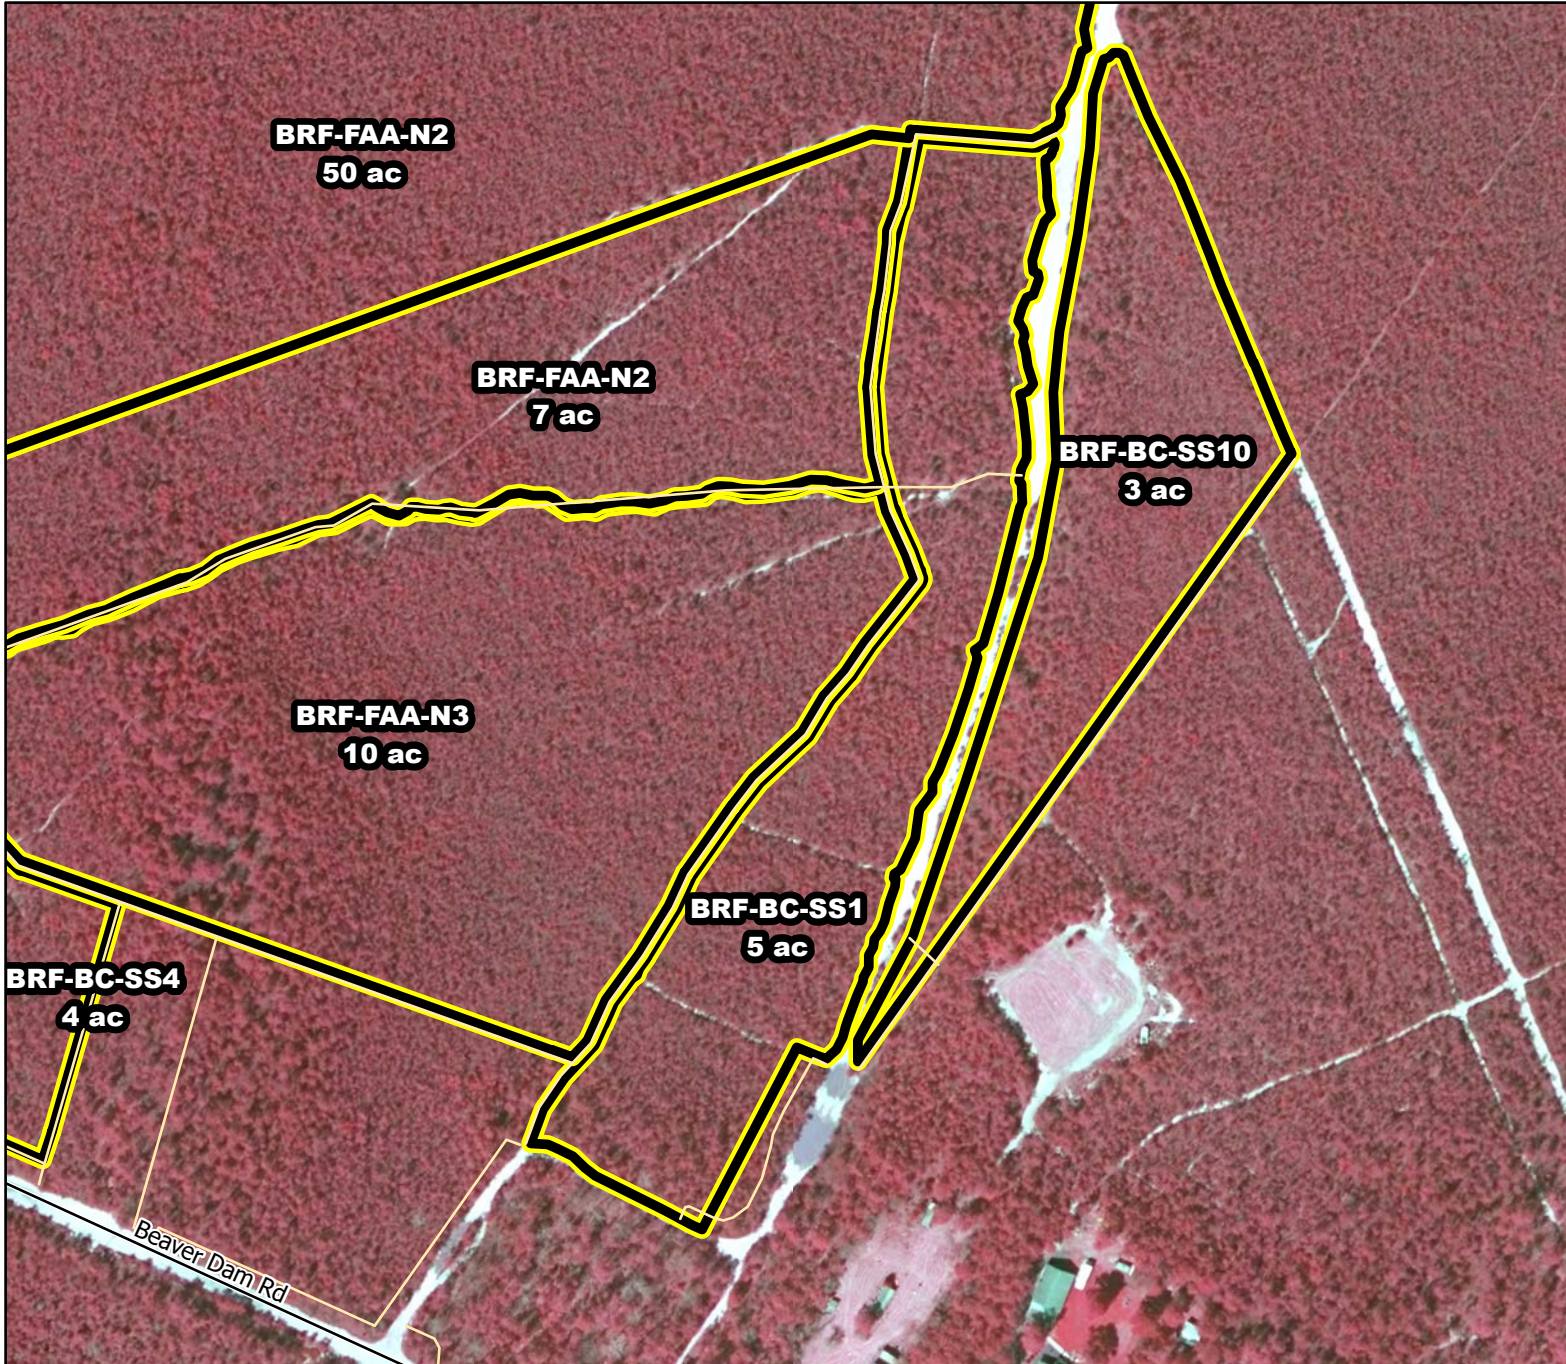

## **BRF-BC-SS1**

**Conditionally  
Approved**

**ONLM COMMENTS:**  
Contingent on completion of recommended fire control lines in BCMP, exclusion of broom crowberry site (revised bdry) and burning with back fire

**ENSP COMMENTS:**  
no comment

**HPO COMMENTS:**  
no comment

**SFS COMMENTS:**  
no comment

Proposed units Existing lines

180 ft

MTC, NJFFS  
20210105

