




Prescribed Burning LMR Determinations

Last Approved Year:
2023

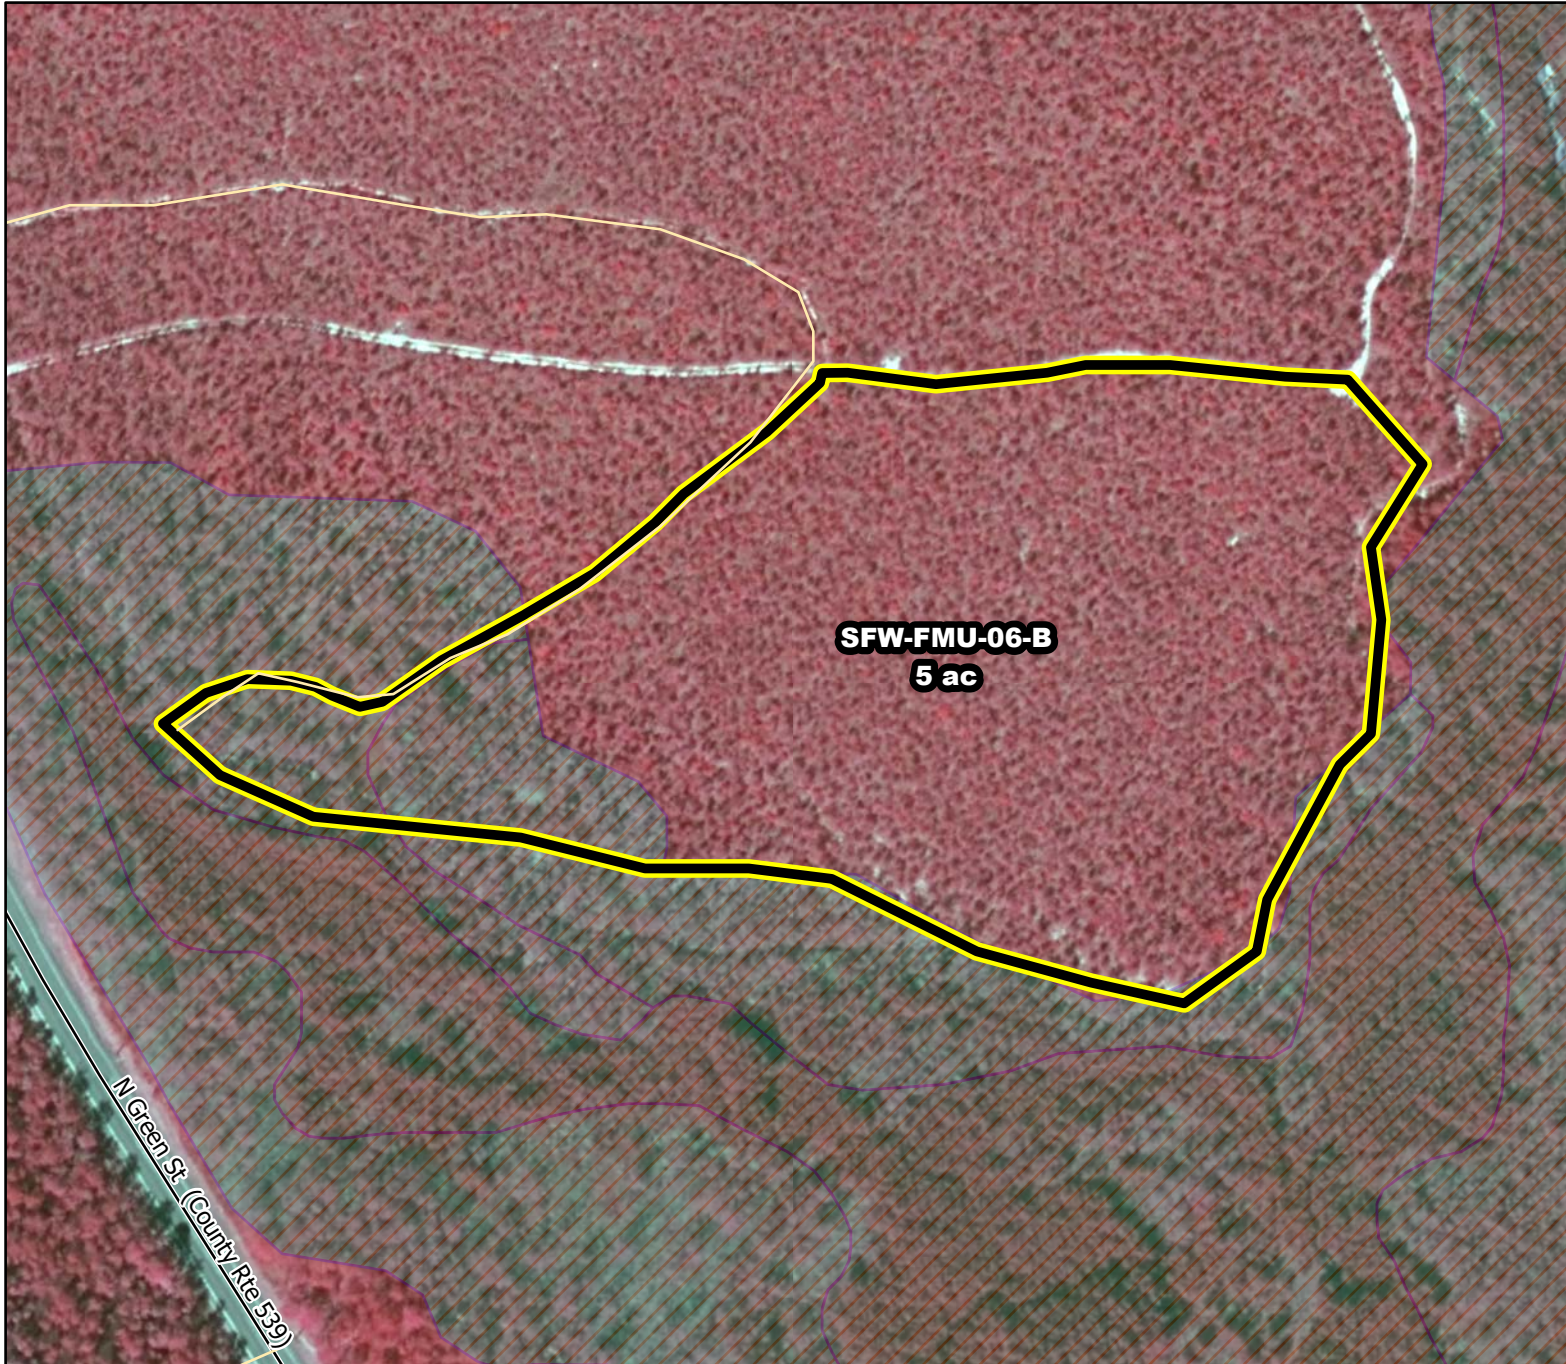

SFW-FMU-06-B
5 ac

SFW-FMU-06-B

**Conditionally
Approved**

ONLM COMMENTS:
2018: See comments
document for details

ENSP COMMENTS:
no comment

HPO COMMENTS:
no comment

SFS COMMENTS:
no comment



Proposed units



Existing lines



Wetlands

180 ft

MTC, NJFFS
2021.01.06