



IAP


Rabbit Foot Fire

30,331 Acres


ID-SCF-018152

8/17/2018

Page 13 of 14



- Uncontrolled Fire Edge
- Completed Dozer Line
- Completed Hand Line
- Access or Improved Road
- Proposed Dozer Line
- Drop Point
- Hellsport
- Lookout
- Pump
- Staging Area
- Water Tank
- Value at Risk
- Division Break

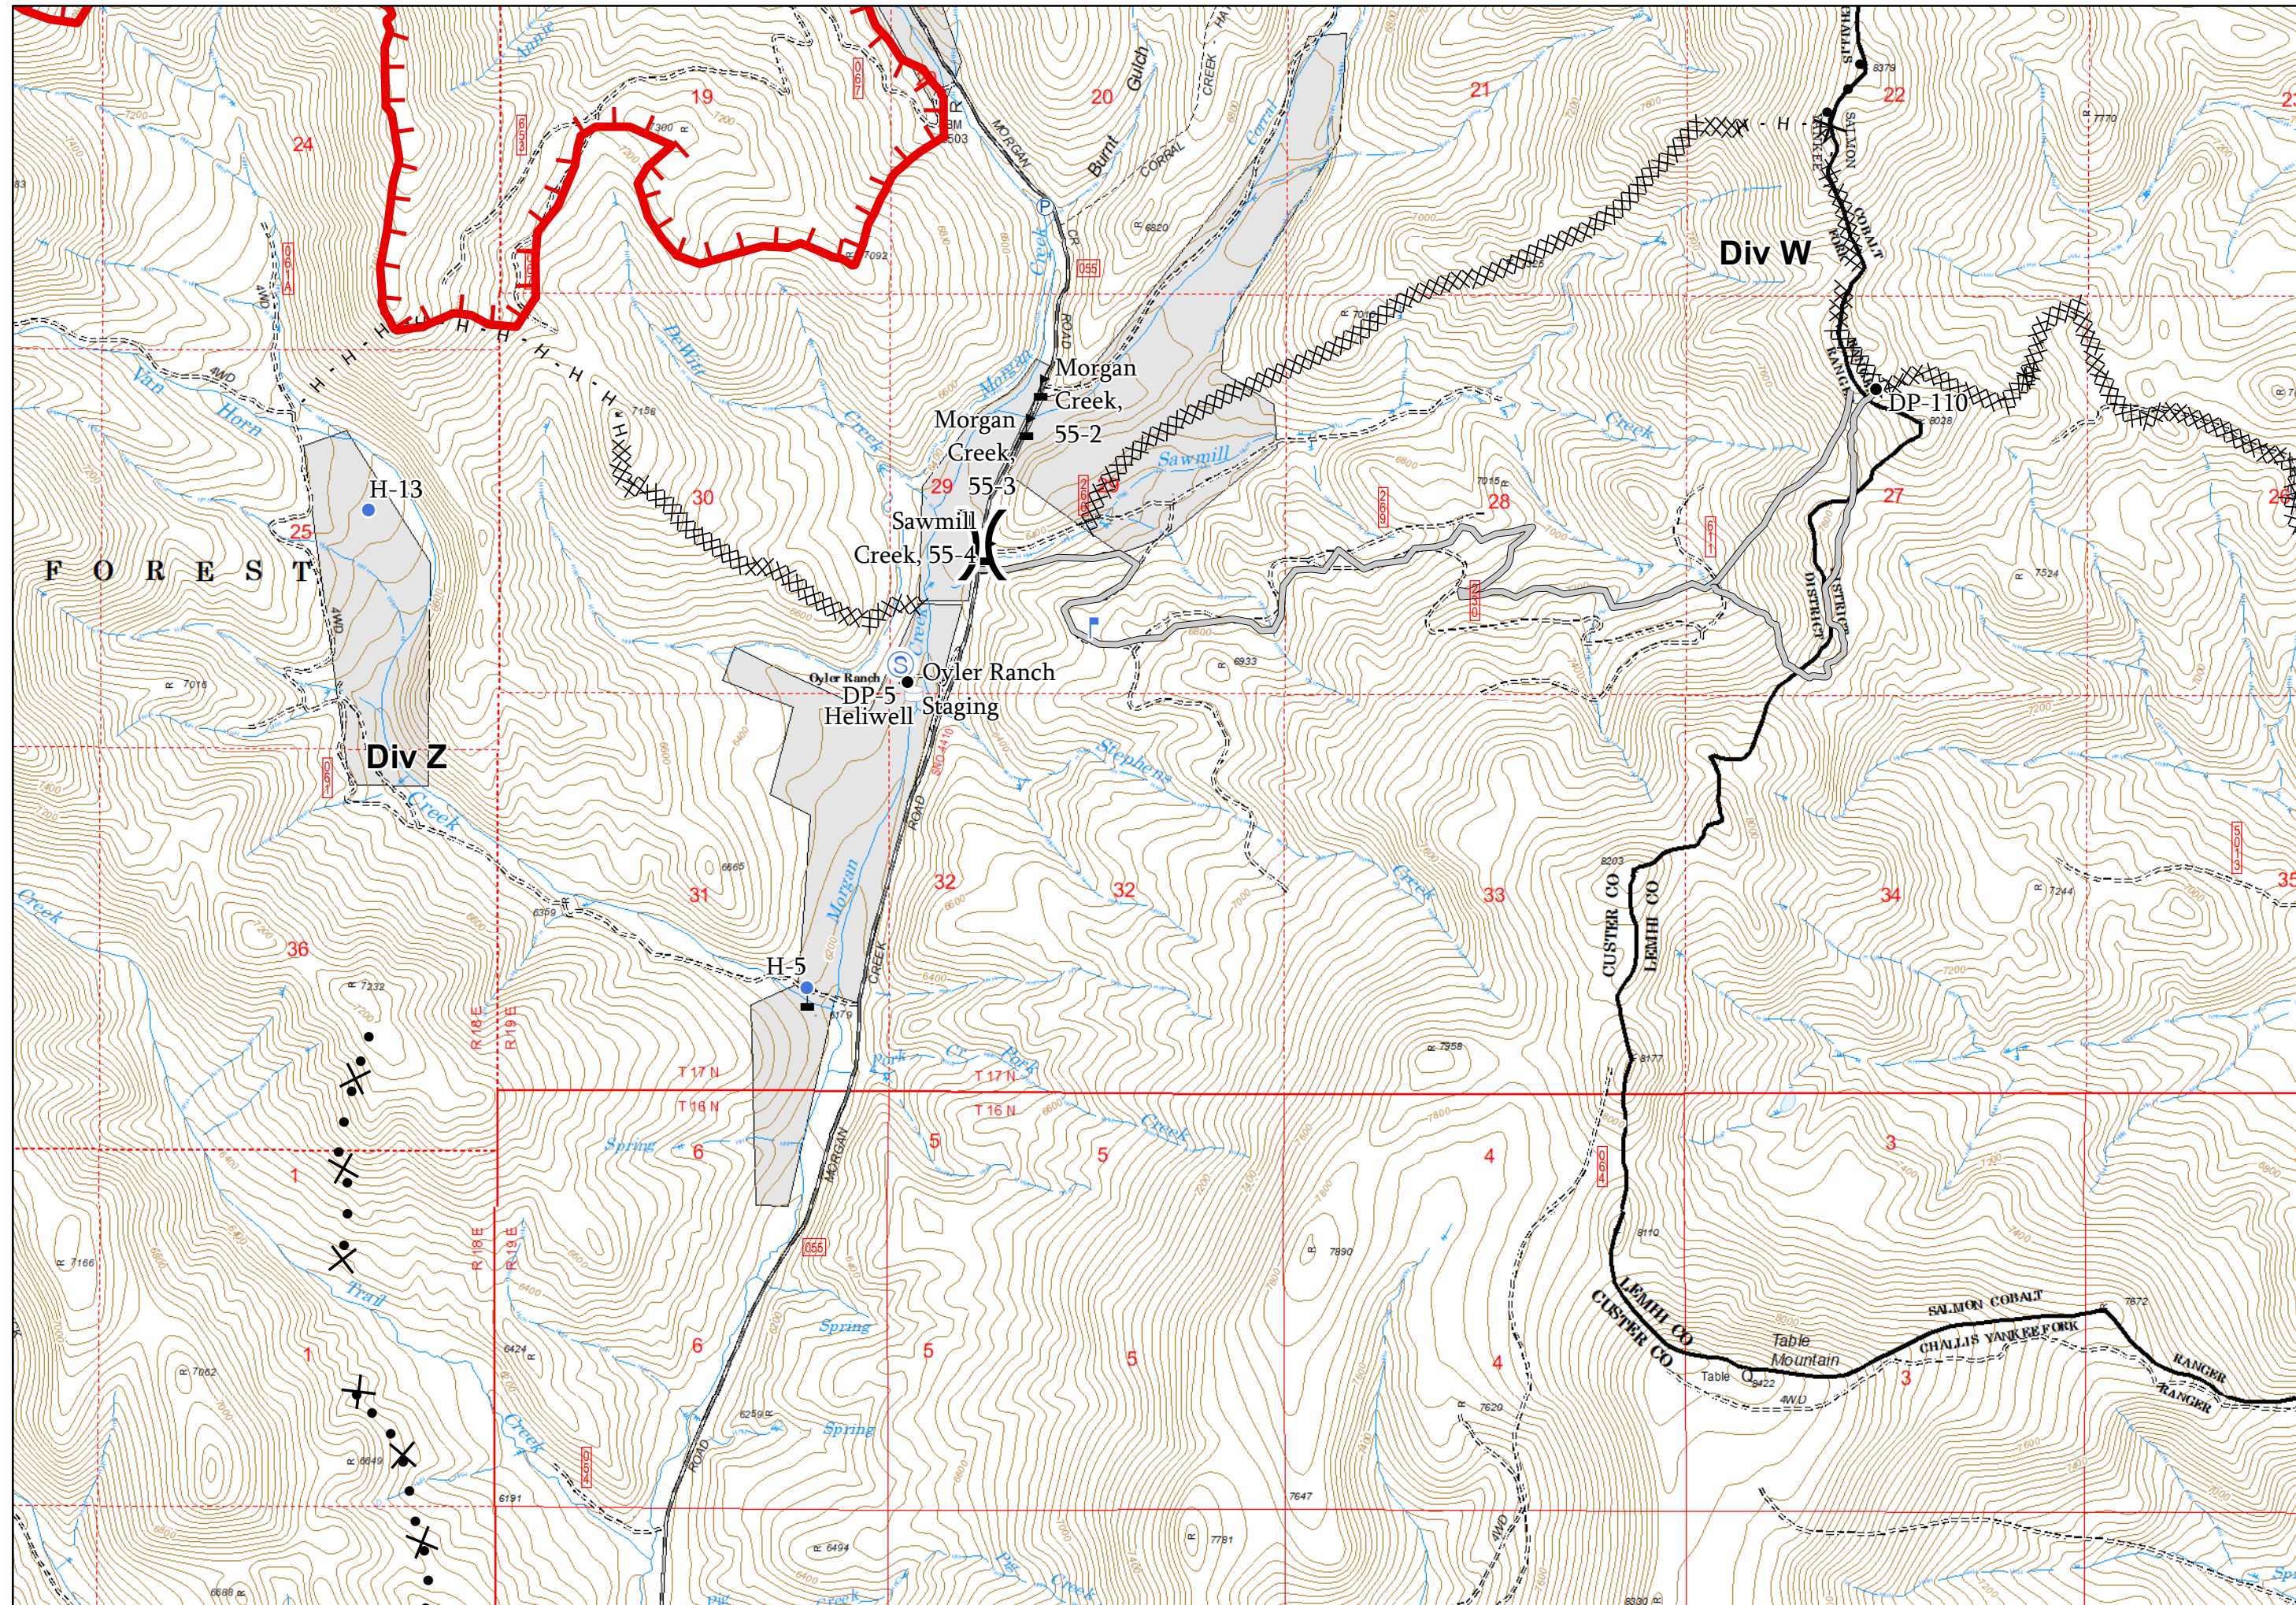

1 in = 0.4 miles

NAD 1983 UTM Zone 12N