




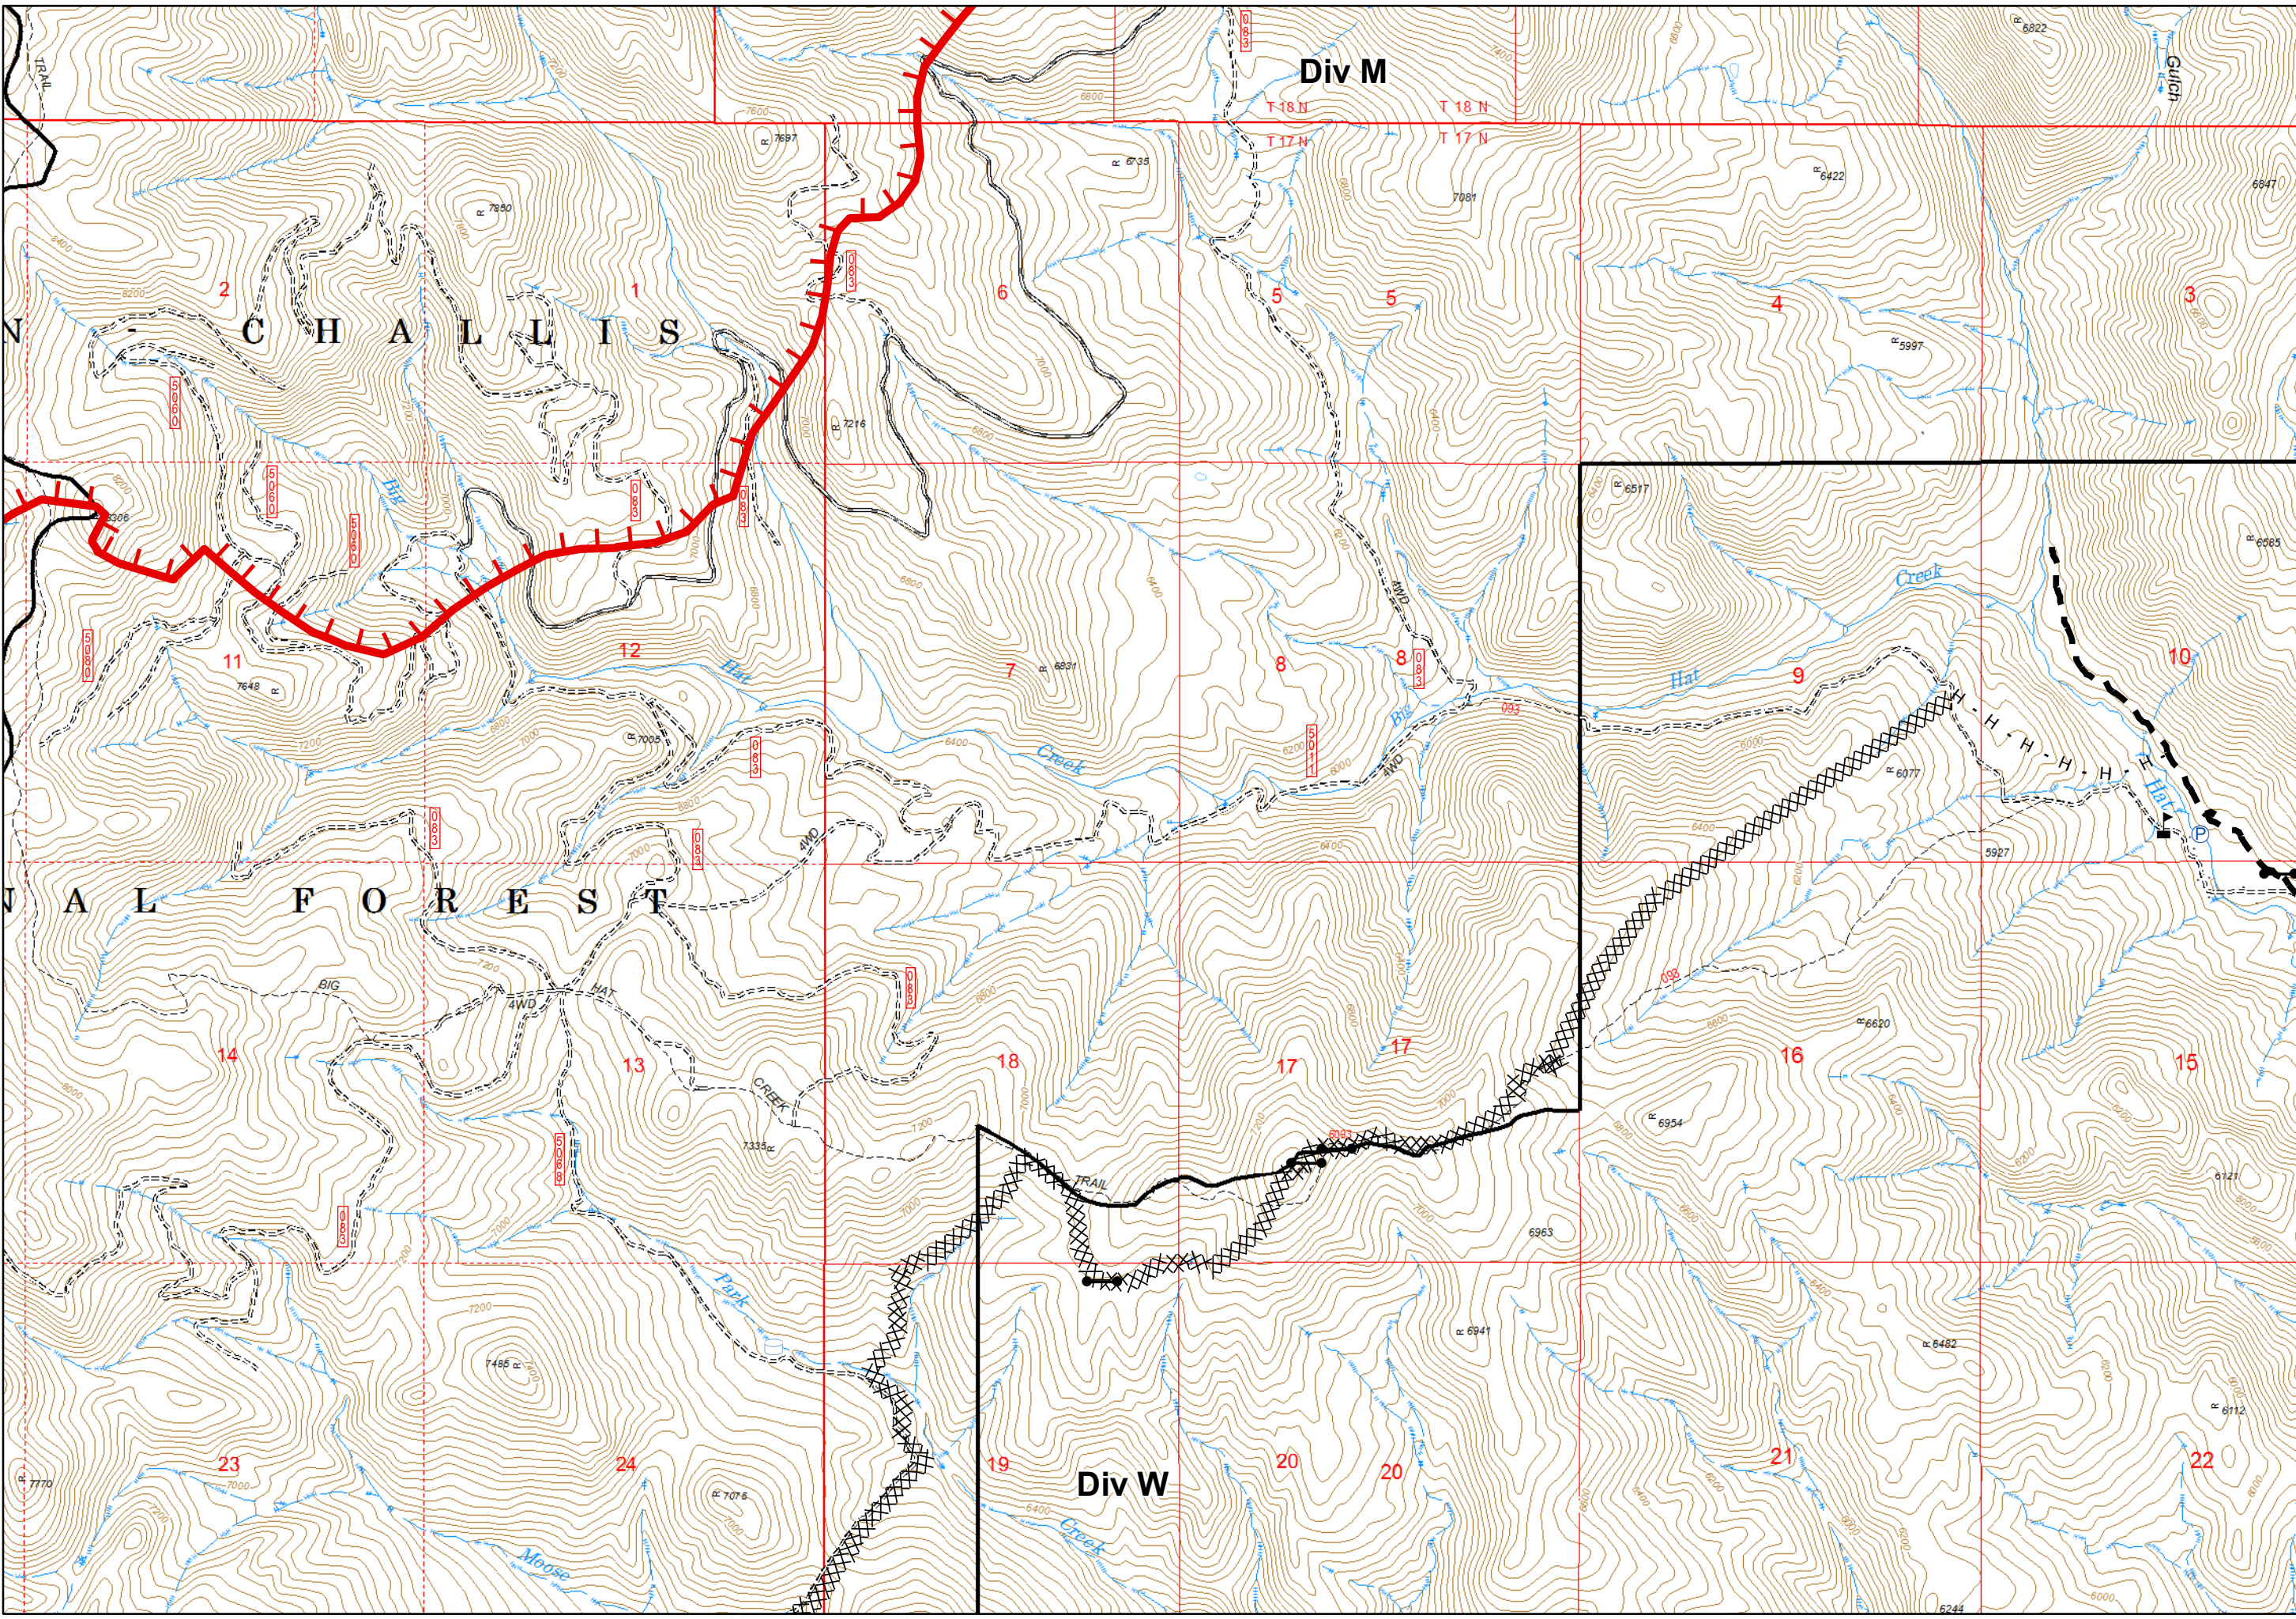

IAP
Rabbit Foot Fire
34,518 Acres
ID-SCF-018152
8/23/18
Page 12 of 14



- Uncontrolled Fire Edge
- Completed Dozer Line
- Completed Hand Line
- Planned Fire Line
- Gate
- Pump
- Water Tank
- Value at Risk



NAD 1983 UTM Zone 12N