














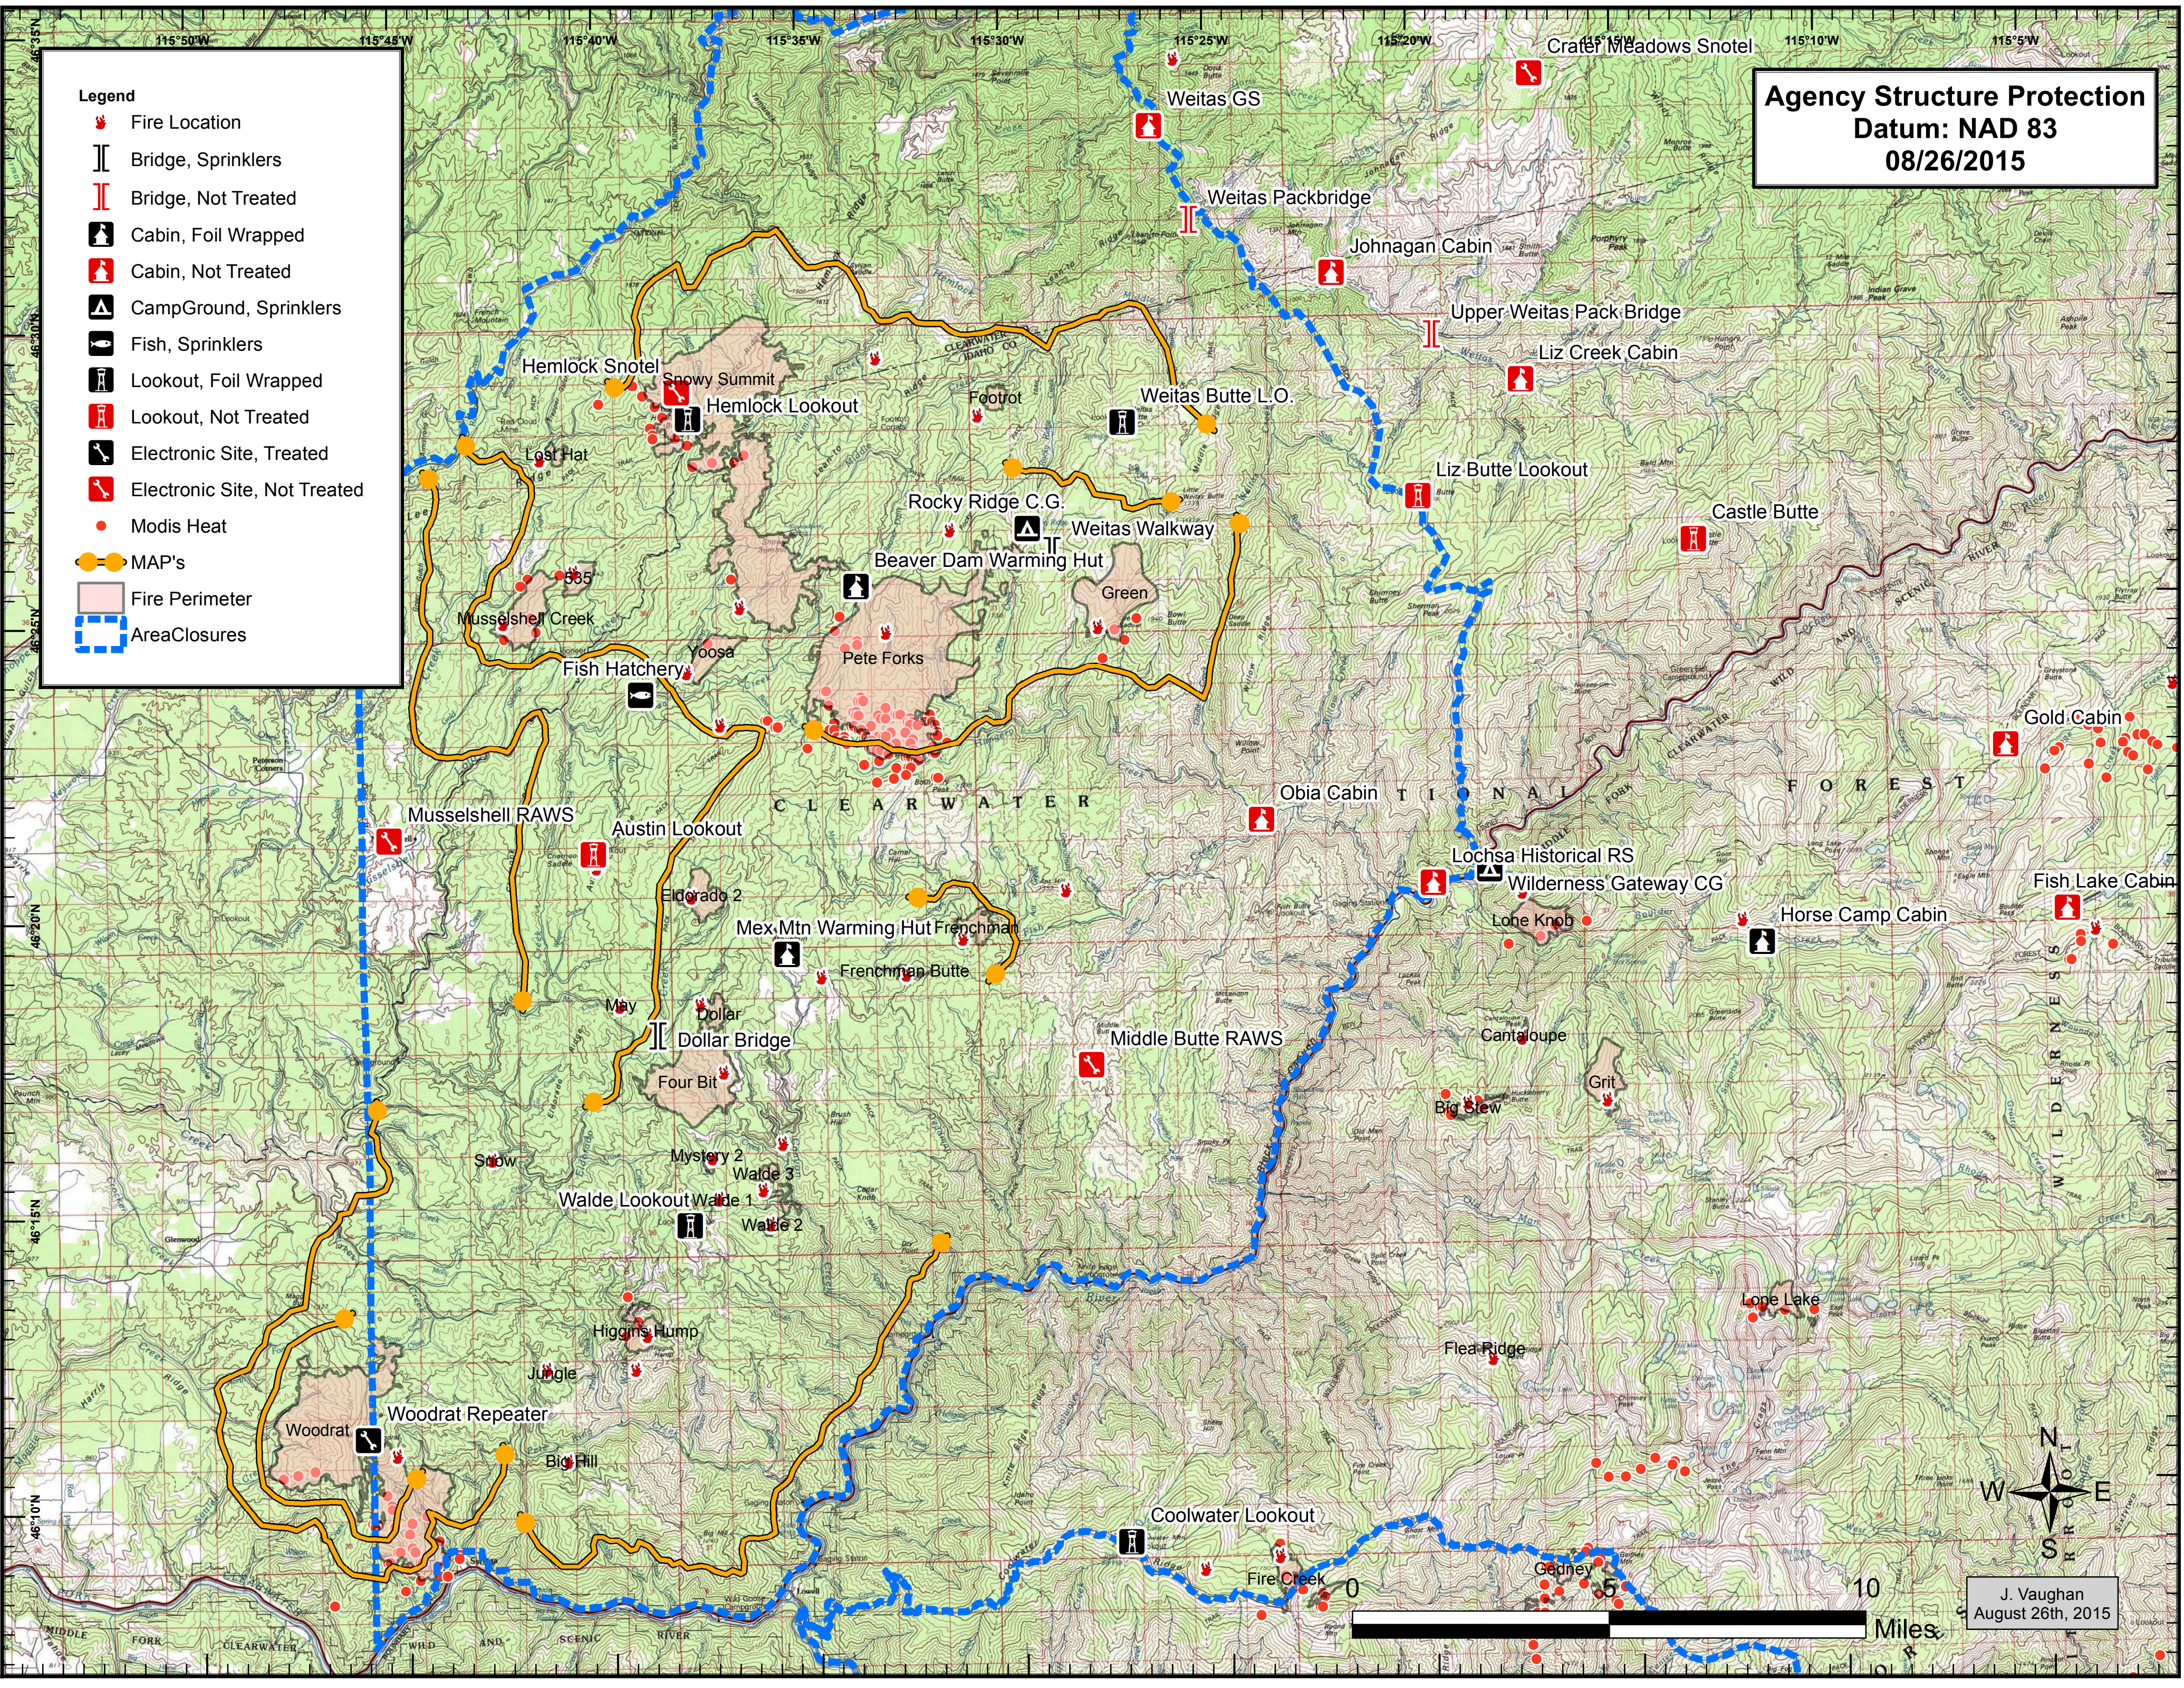


Agency Structure Protection
Datum: NAD 83
08/26/2015

- Legend**
-  Fire Location
 -  Bridge, Sprinklers
 -  Bridge, Not Treated
 -  Cabin, Foil Wrapped
 -  Cabin, Not Treated
 -  CampGround, Sprinklers
 -  Fish, Sprinklers
 -  Lookout, Foil Wrapped
 -  Lookout, Not Treated
 -  Electronic Site, Treated
 -  Electronic Site, Not Treated
 -  Modis Heat
 -  MAP's
 -  Fire Perimeter
 -  AreaClosures



J. Vaughan
 August 26th, 2015