






Meyers Sapphire Complex
MT-BDF-00217
9/14/2017


Branch III
 Meyers Fire: 62,034 ac

Fire perimeter from 9/13/2017 @ 1700





-  Division Break
-  Branch Break


-  Uncontrolled Fire Edge
-  Completed Line

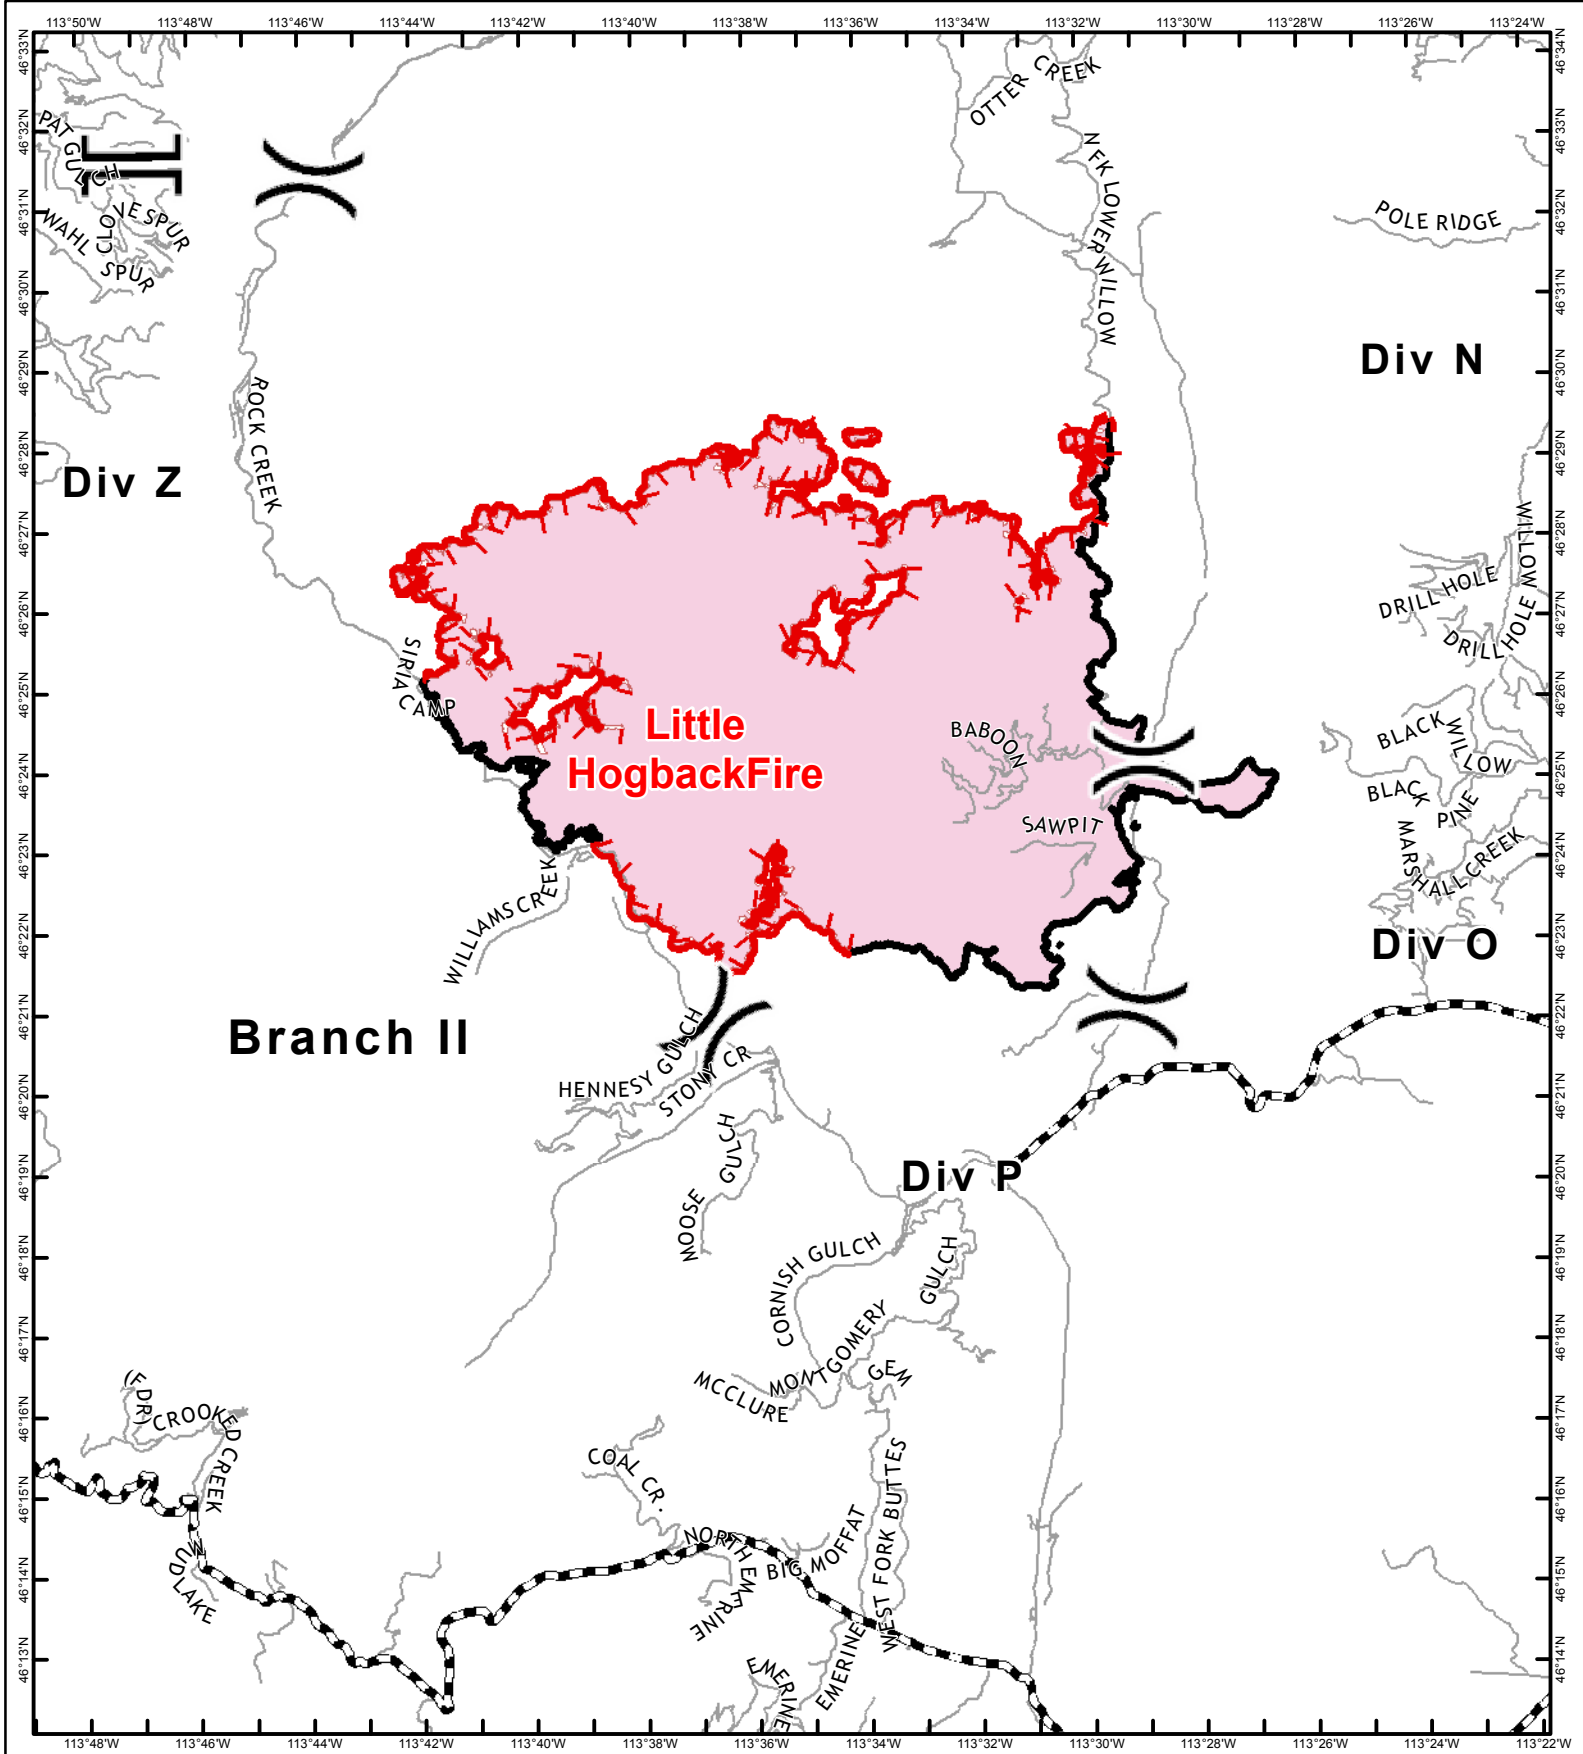




Meysers Sapphire Complex
MT-BDF-00217
9/14/2017
Branch II
 Little Hogback Fire: 34,552 ac

-  Division Break
-  Branch Break
-  Uncontrolled Fire Edge
-  Completed Line



Fire perimeter from 9/13/2017 @ 1700

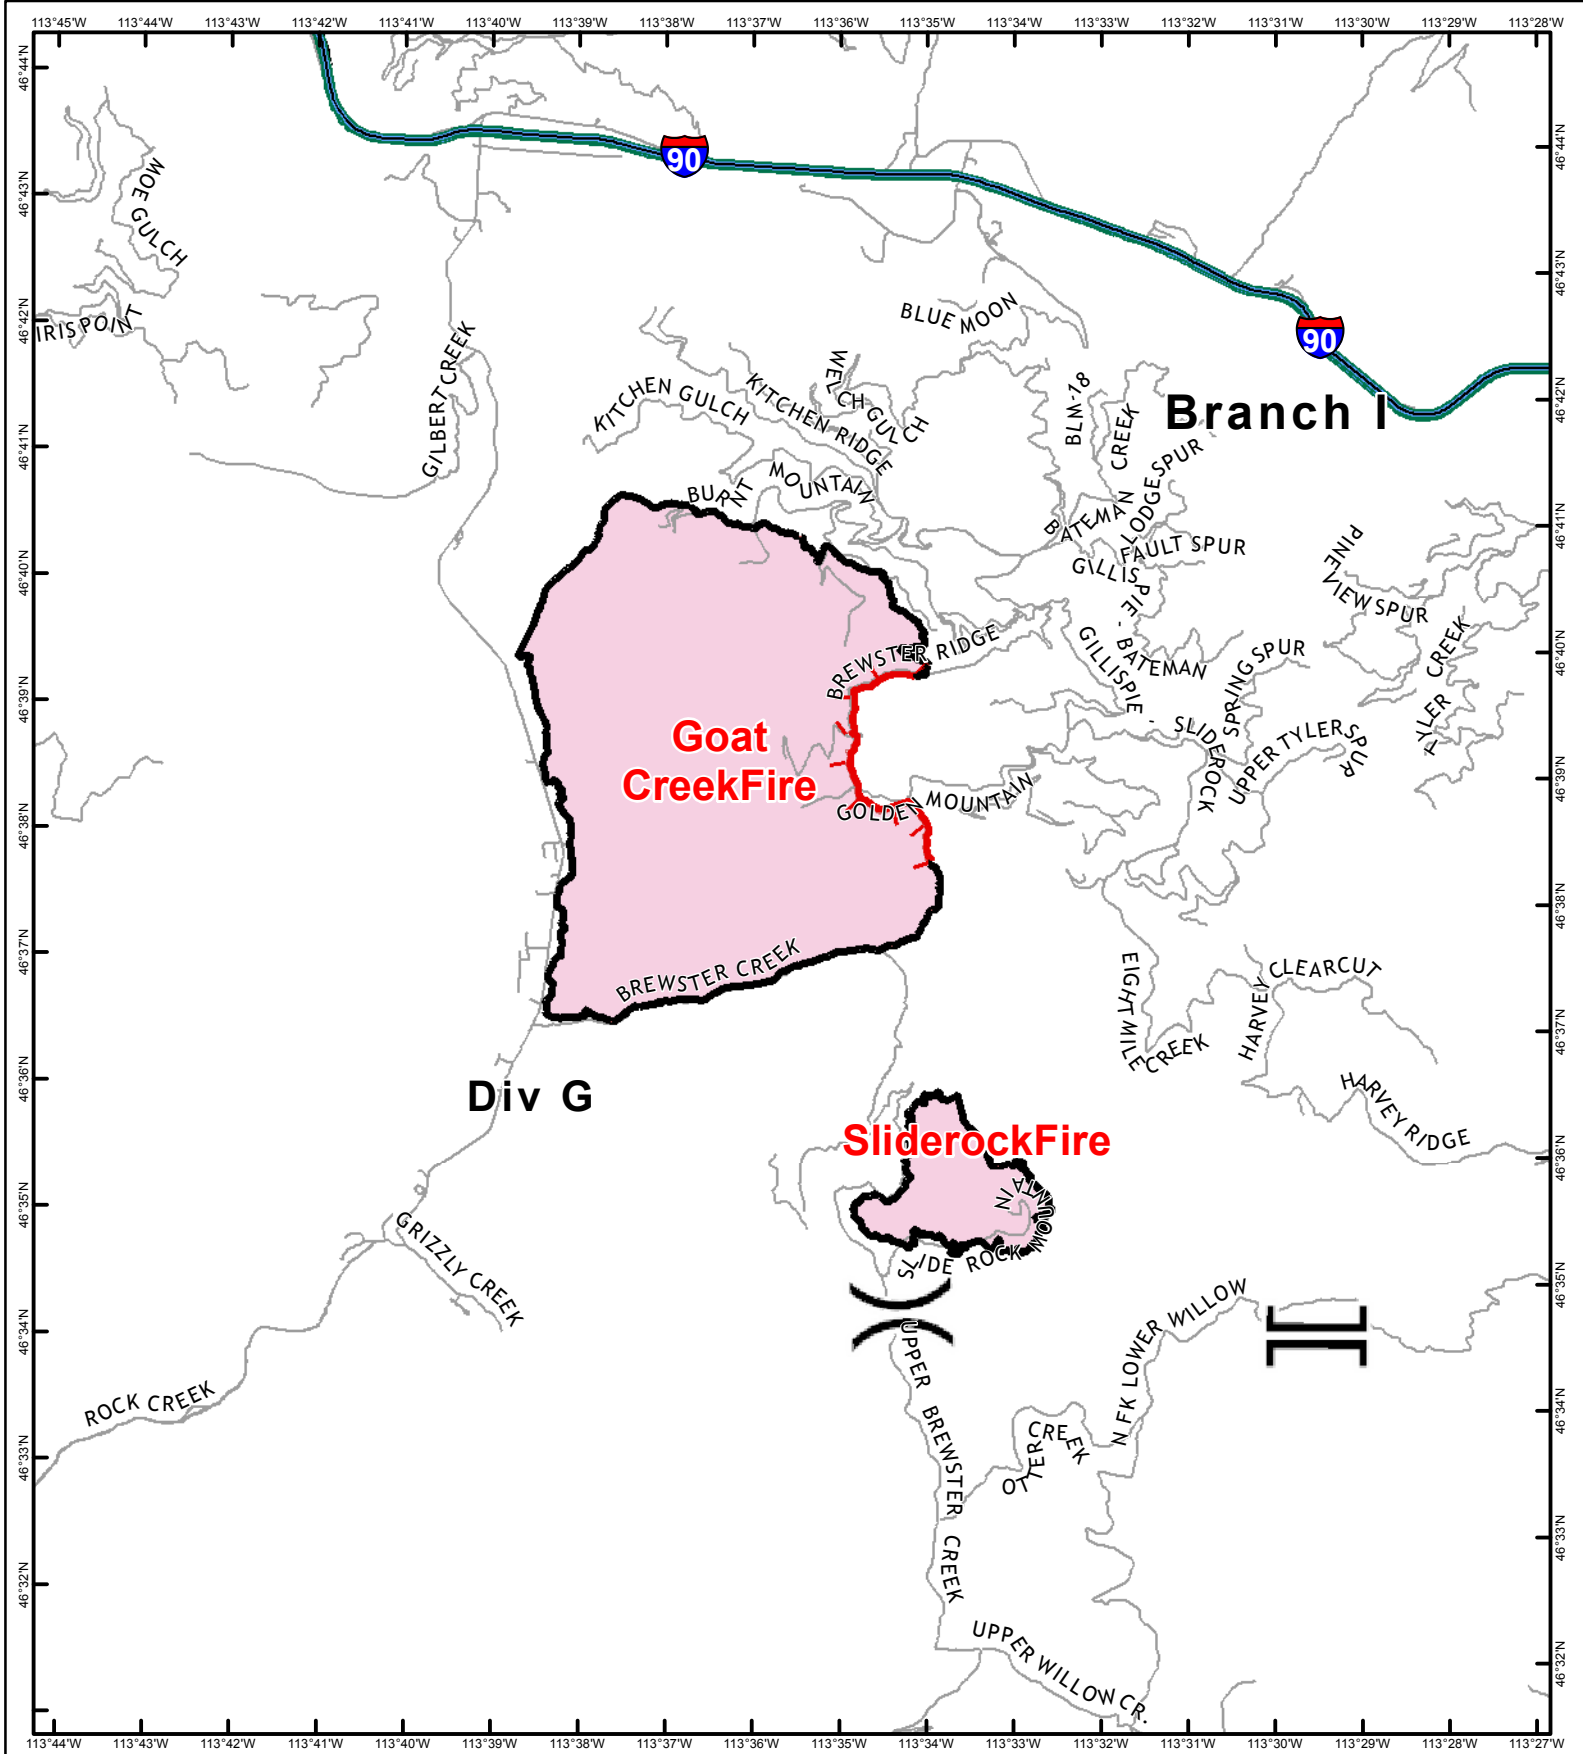

Meyers Sapphire Complex
MT-BDF-00217
9/14/2017

Branch I
 Goat Creek Fire: 8,300 ac
 Sliderock Fire: 901 ac

- () Division Break
- || Branch Break
- Uncontrolled Fire Edge
- Completed Line



Fire perimeter from 9/13/2017 @ 1700