







Meyers Sapphire Complex
MT-BDF-00217
September 17-19, 2017

Branch III
 Meyers Fire: 62,034 ac

Fire perimeter from 9/16/2017 @ 1000



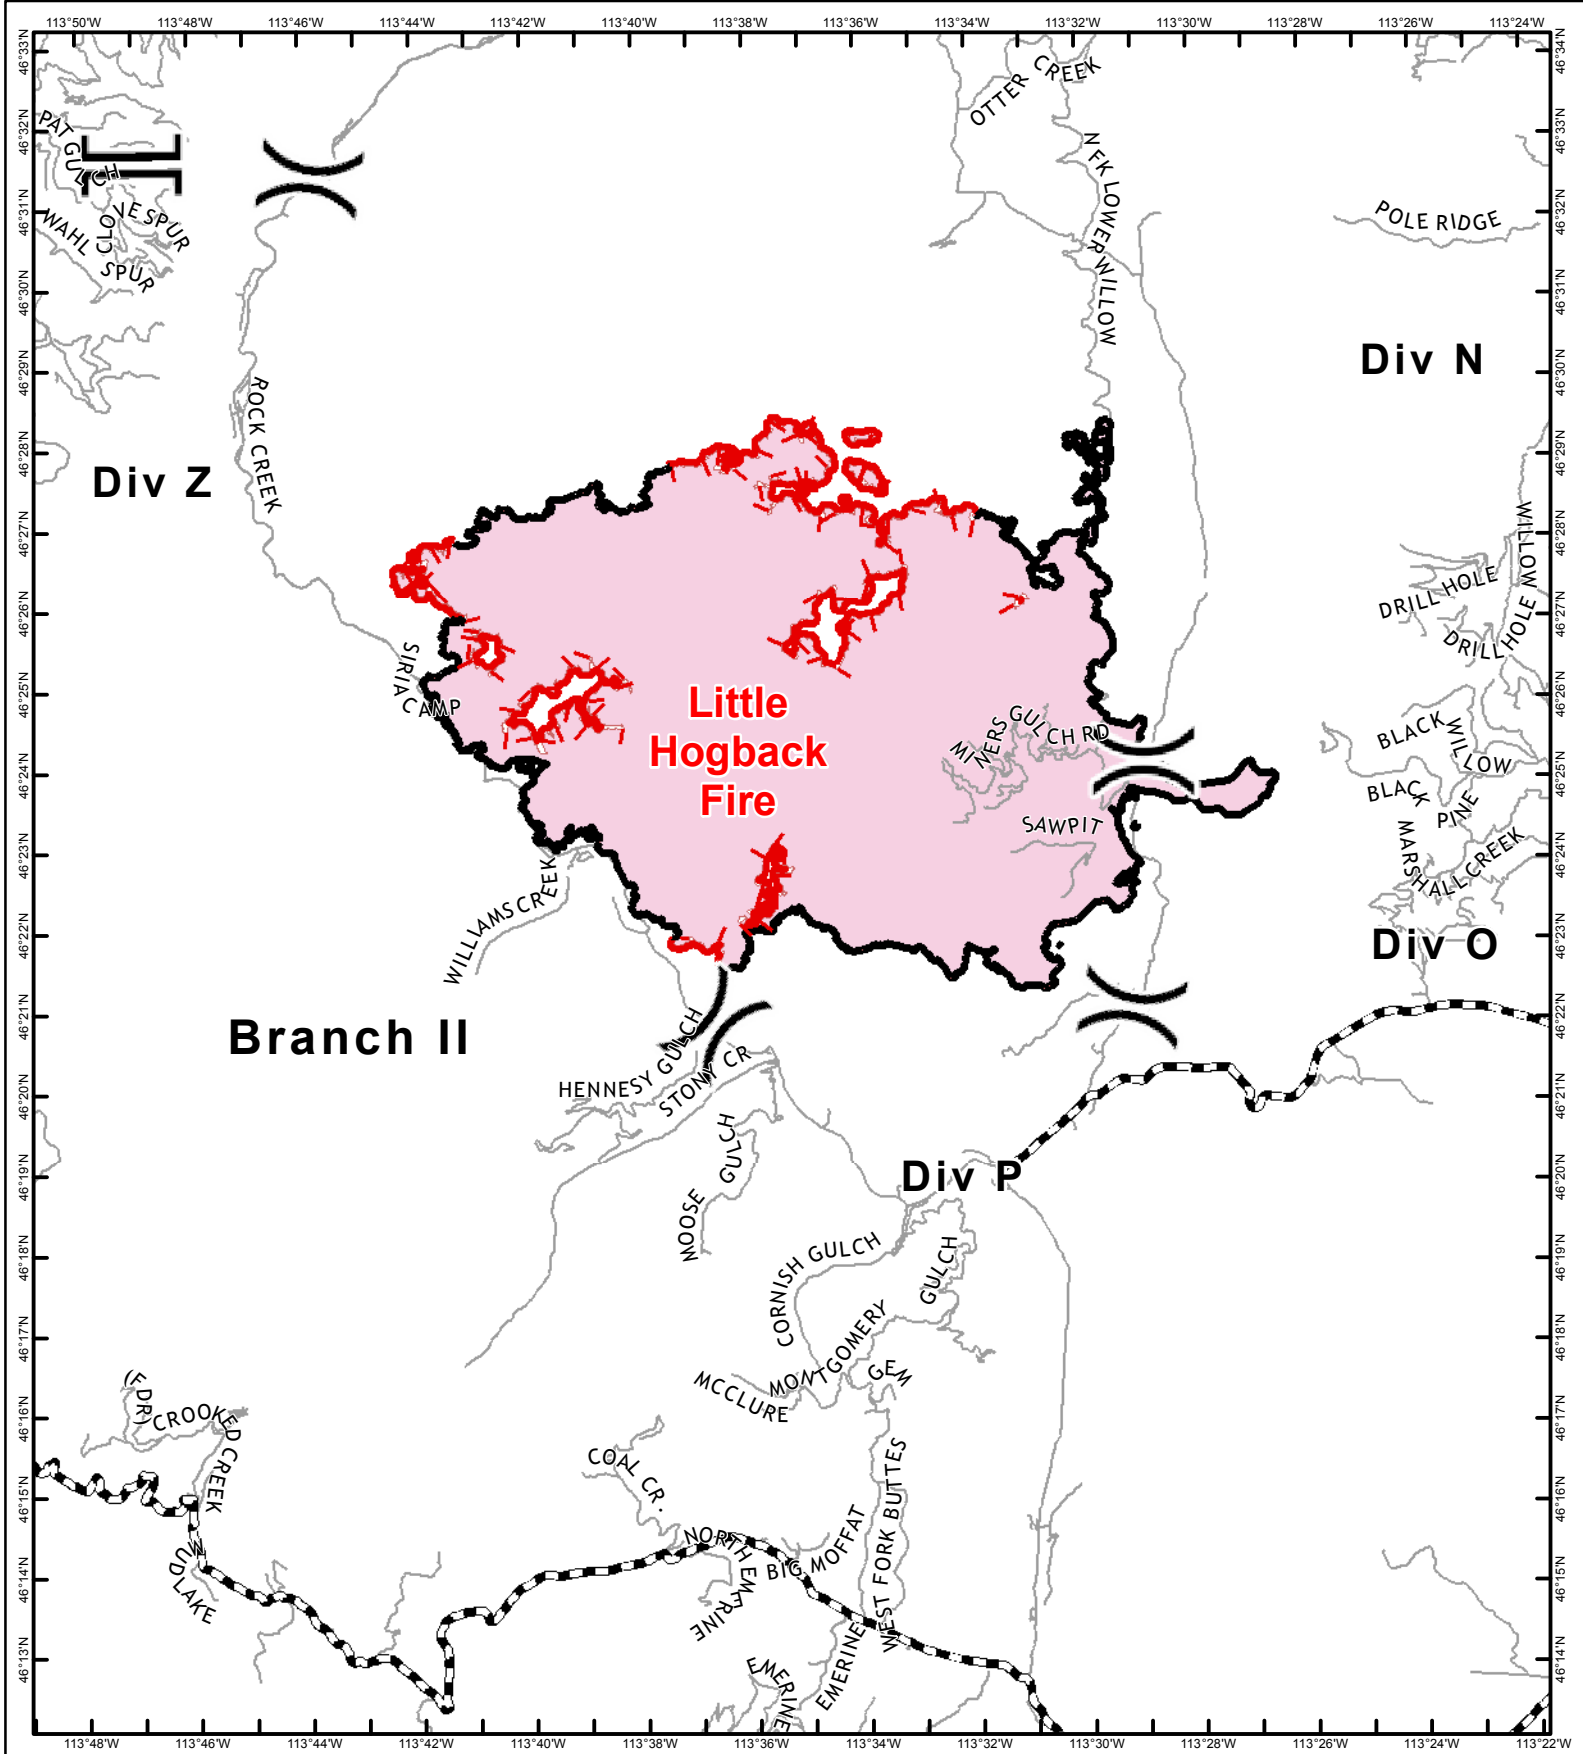

-  Division Break
-  Branch Break
-  Uncontrolled Fire Edge
-  Completed Line







Meysers Sapphire Complex
MT-BDF-00217
September 17-19, 2017

Branch II
 Little Hogback Fire: 34,552 ac

-  Division Break
-  Branch Break
-  Uncontrolled Fire Edge
-  Completed Line







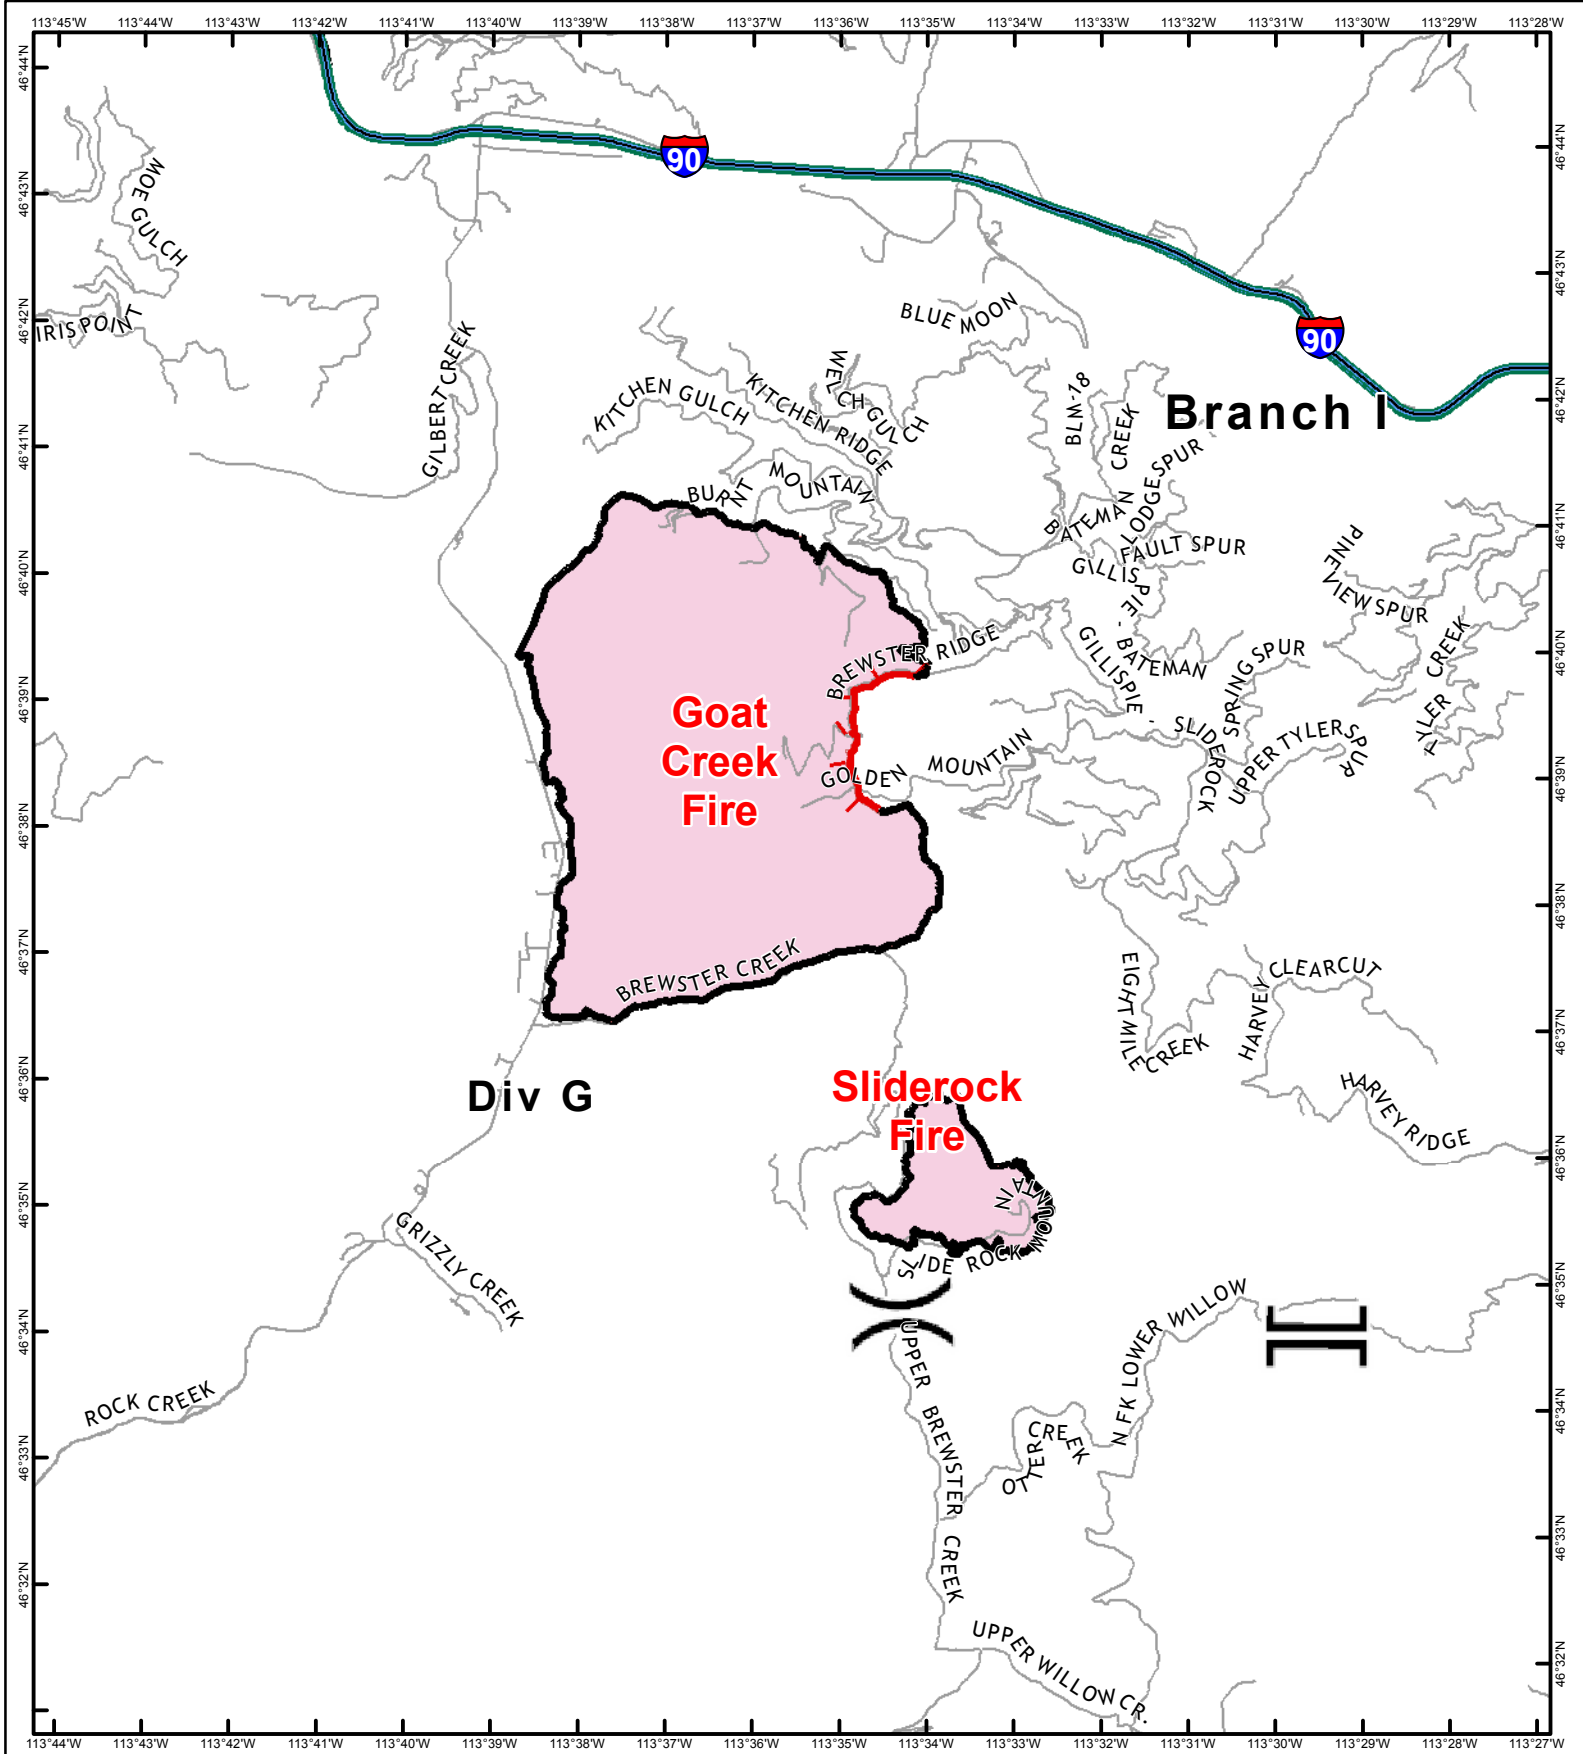Fire perimeter from 9/16/2017 @ 1000



Meyers Sapphire Complex
MT-BDF-00217
September 17-19, 2017

Branch I
 Goat Creek Fire: 8,300 ac
 Sliderock Fire: 901 ac

Fire perimeter from 9/16/2017 @ 1000

-  Division Break
-  Branch Break
-  Uncontrolled Fire Edge
-  Completed Line

