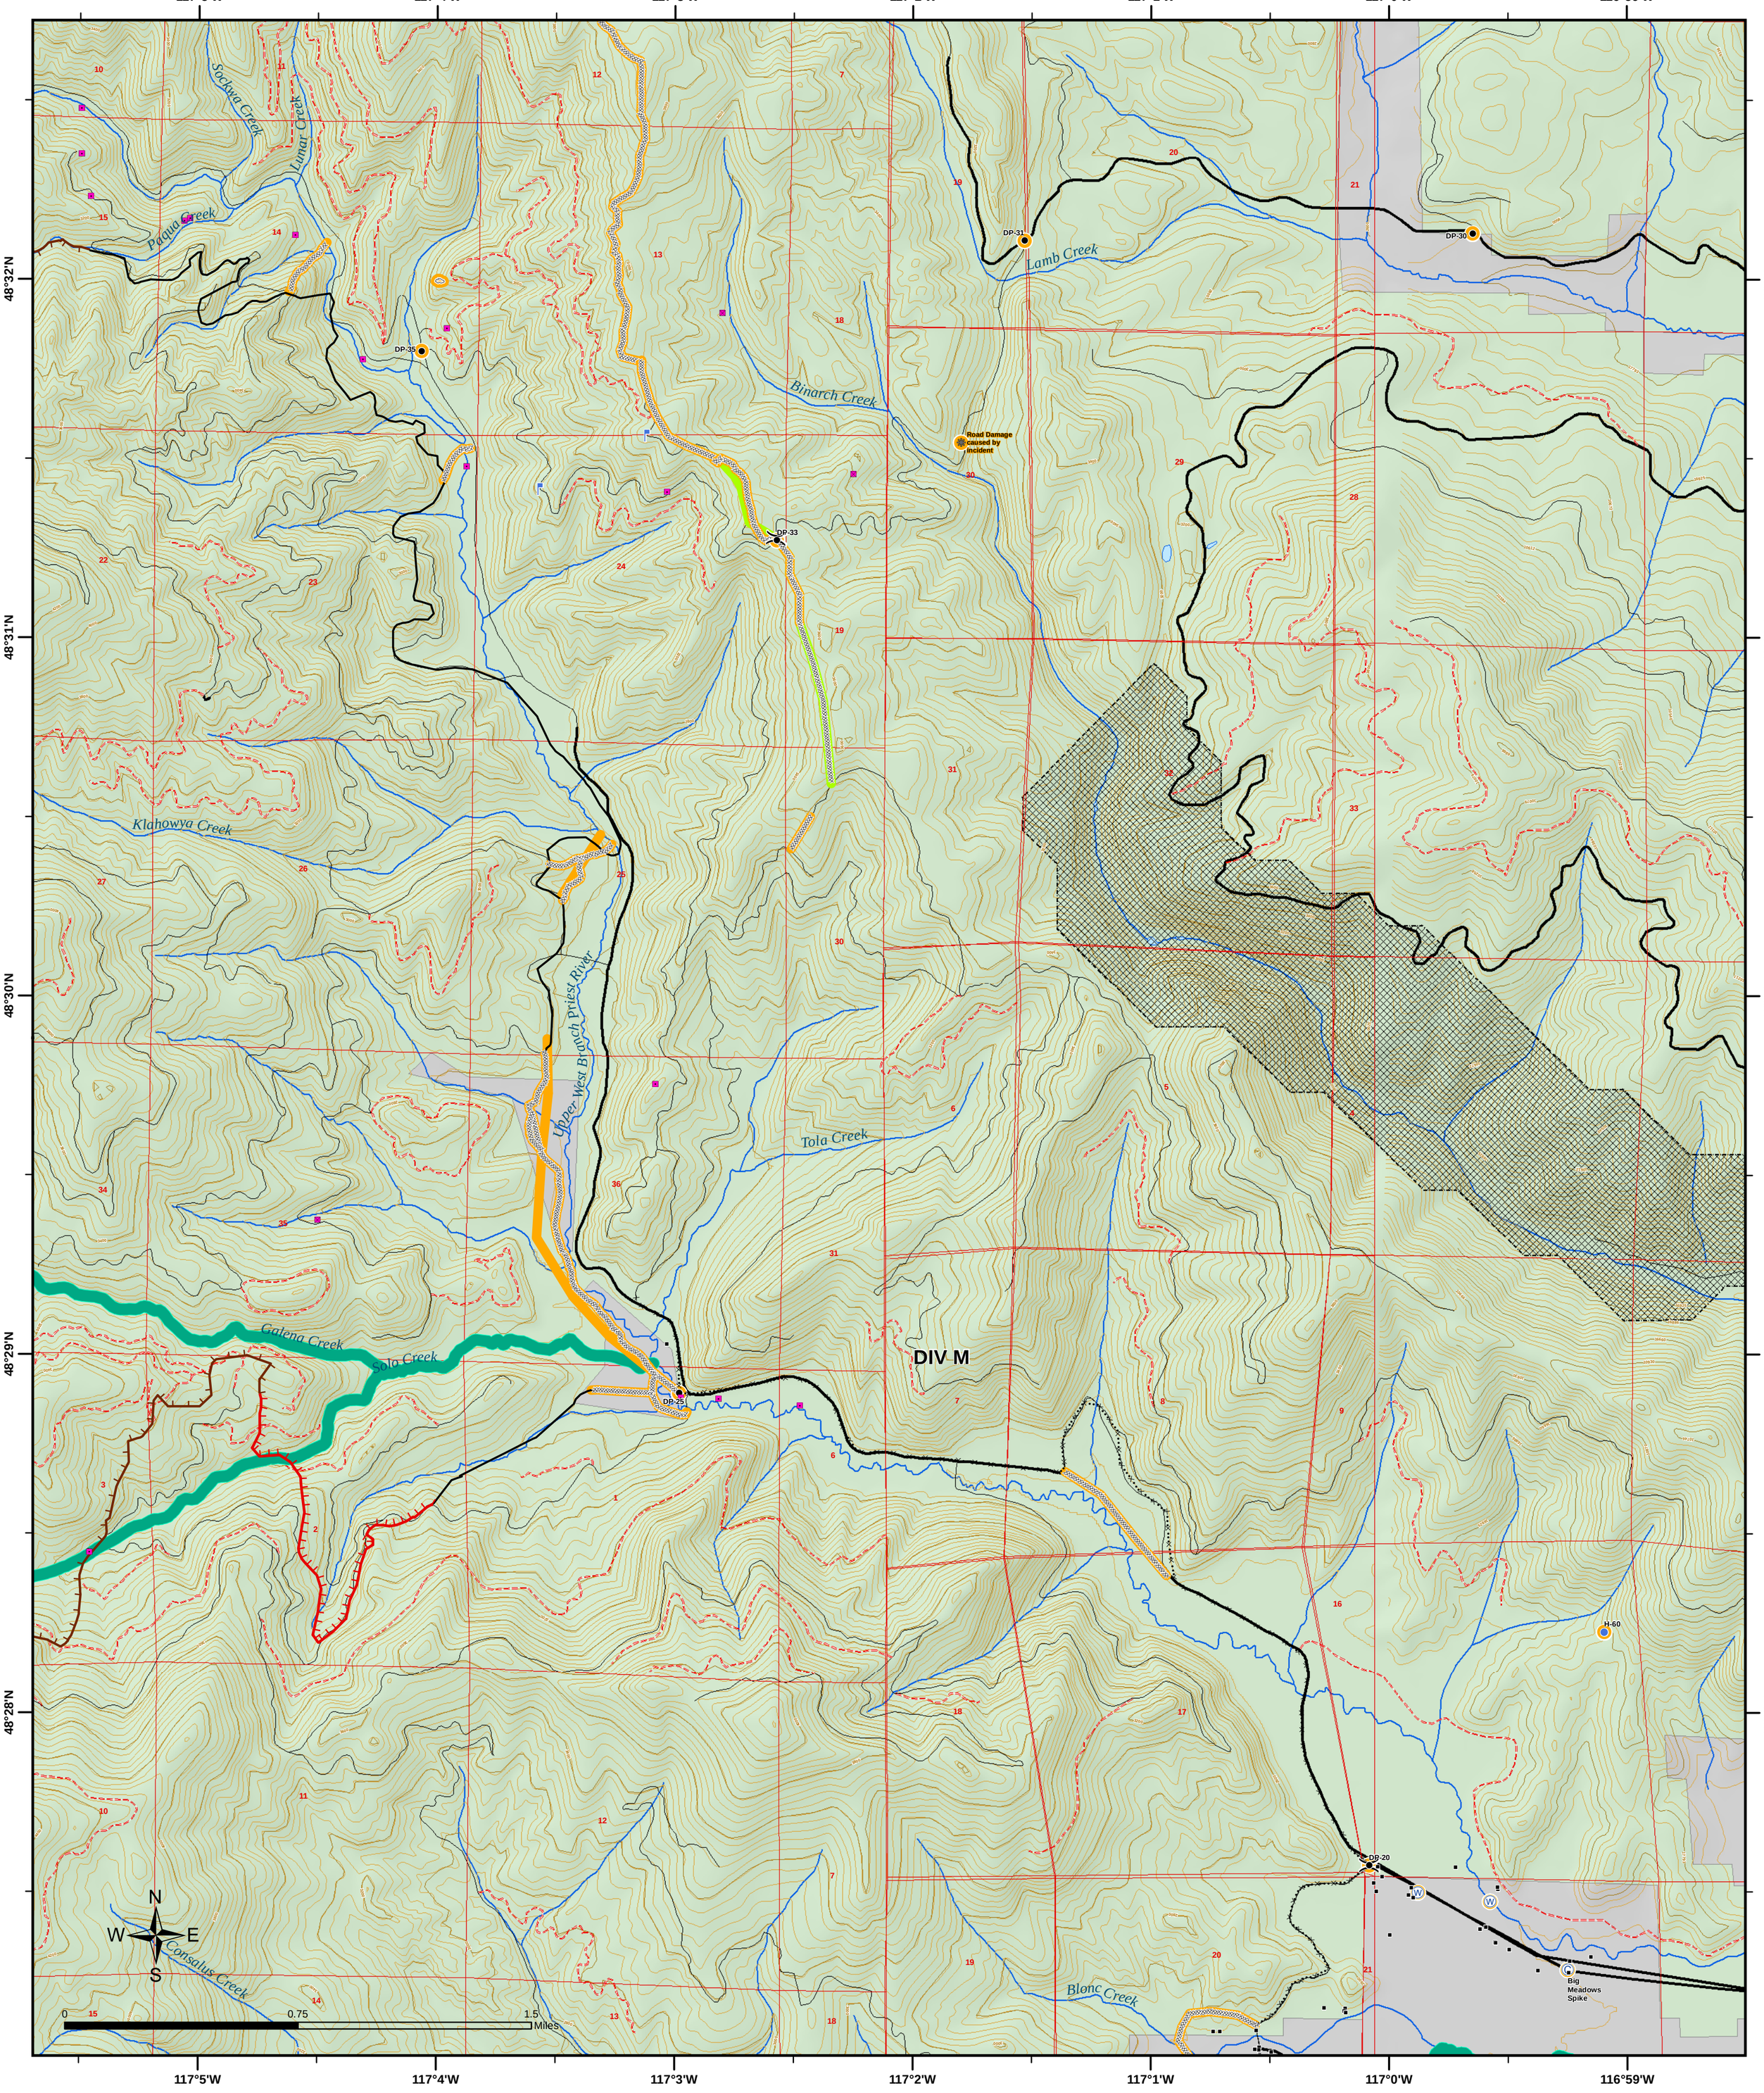

DIV M
Suppression Repair
Kaniksu Complex
WA-COF-001302
September 13, 2015

- Structures
- Pumps
- Repair Points

- Hand Line
- Uncontrolled Fire Edge
- Completed Dozer Line
- Completed Line
- Proposed Dozer Line
- Limited Threat - Minimal Action
- Sensitive streams

Ownership

- USFS
- Private

- Repairs Needed
- Repairs Approved
- Repairs Needed