






# Creedance 2175 Ac & Bigelow 80 Ac Fires

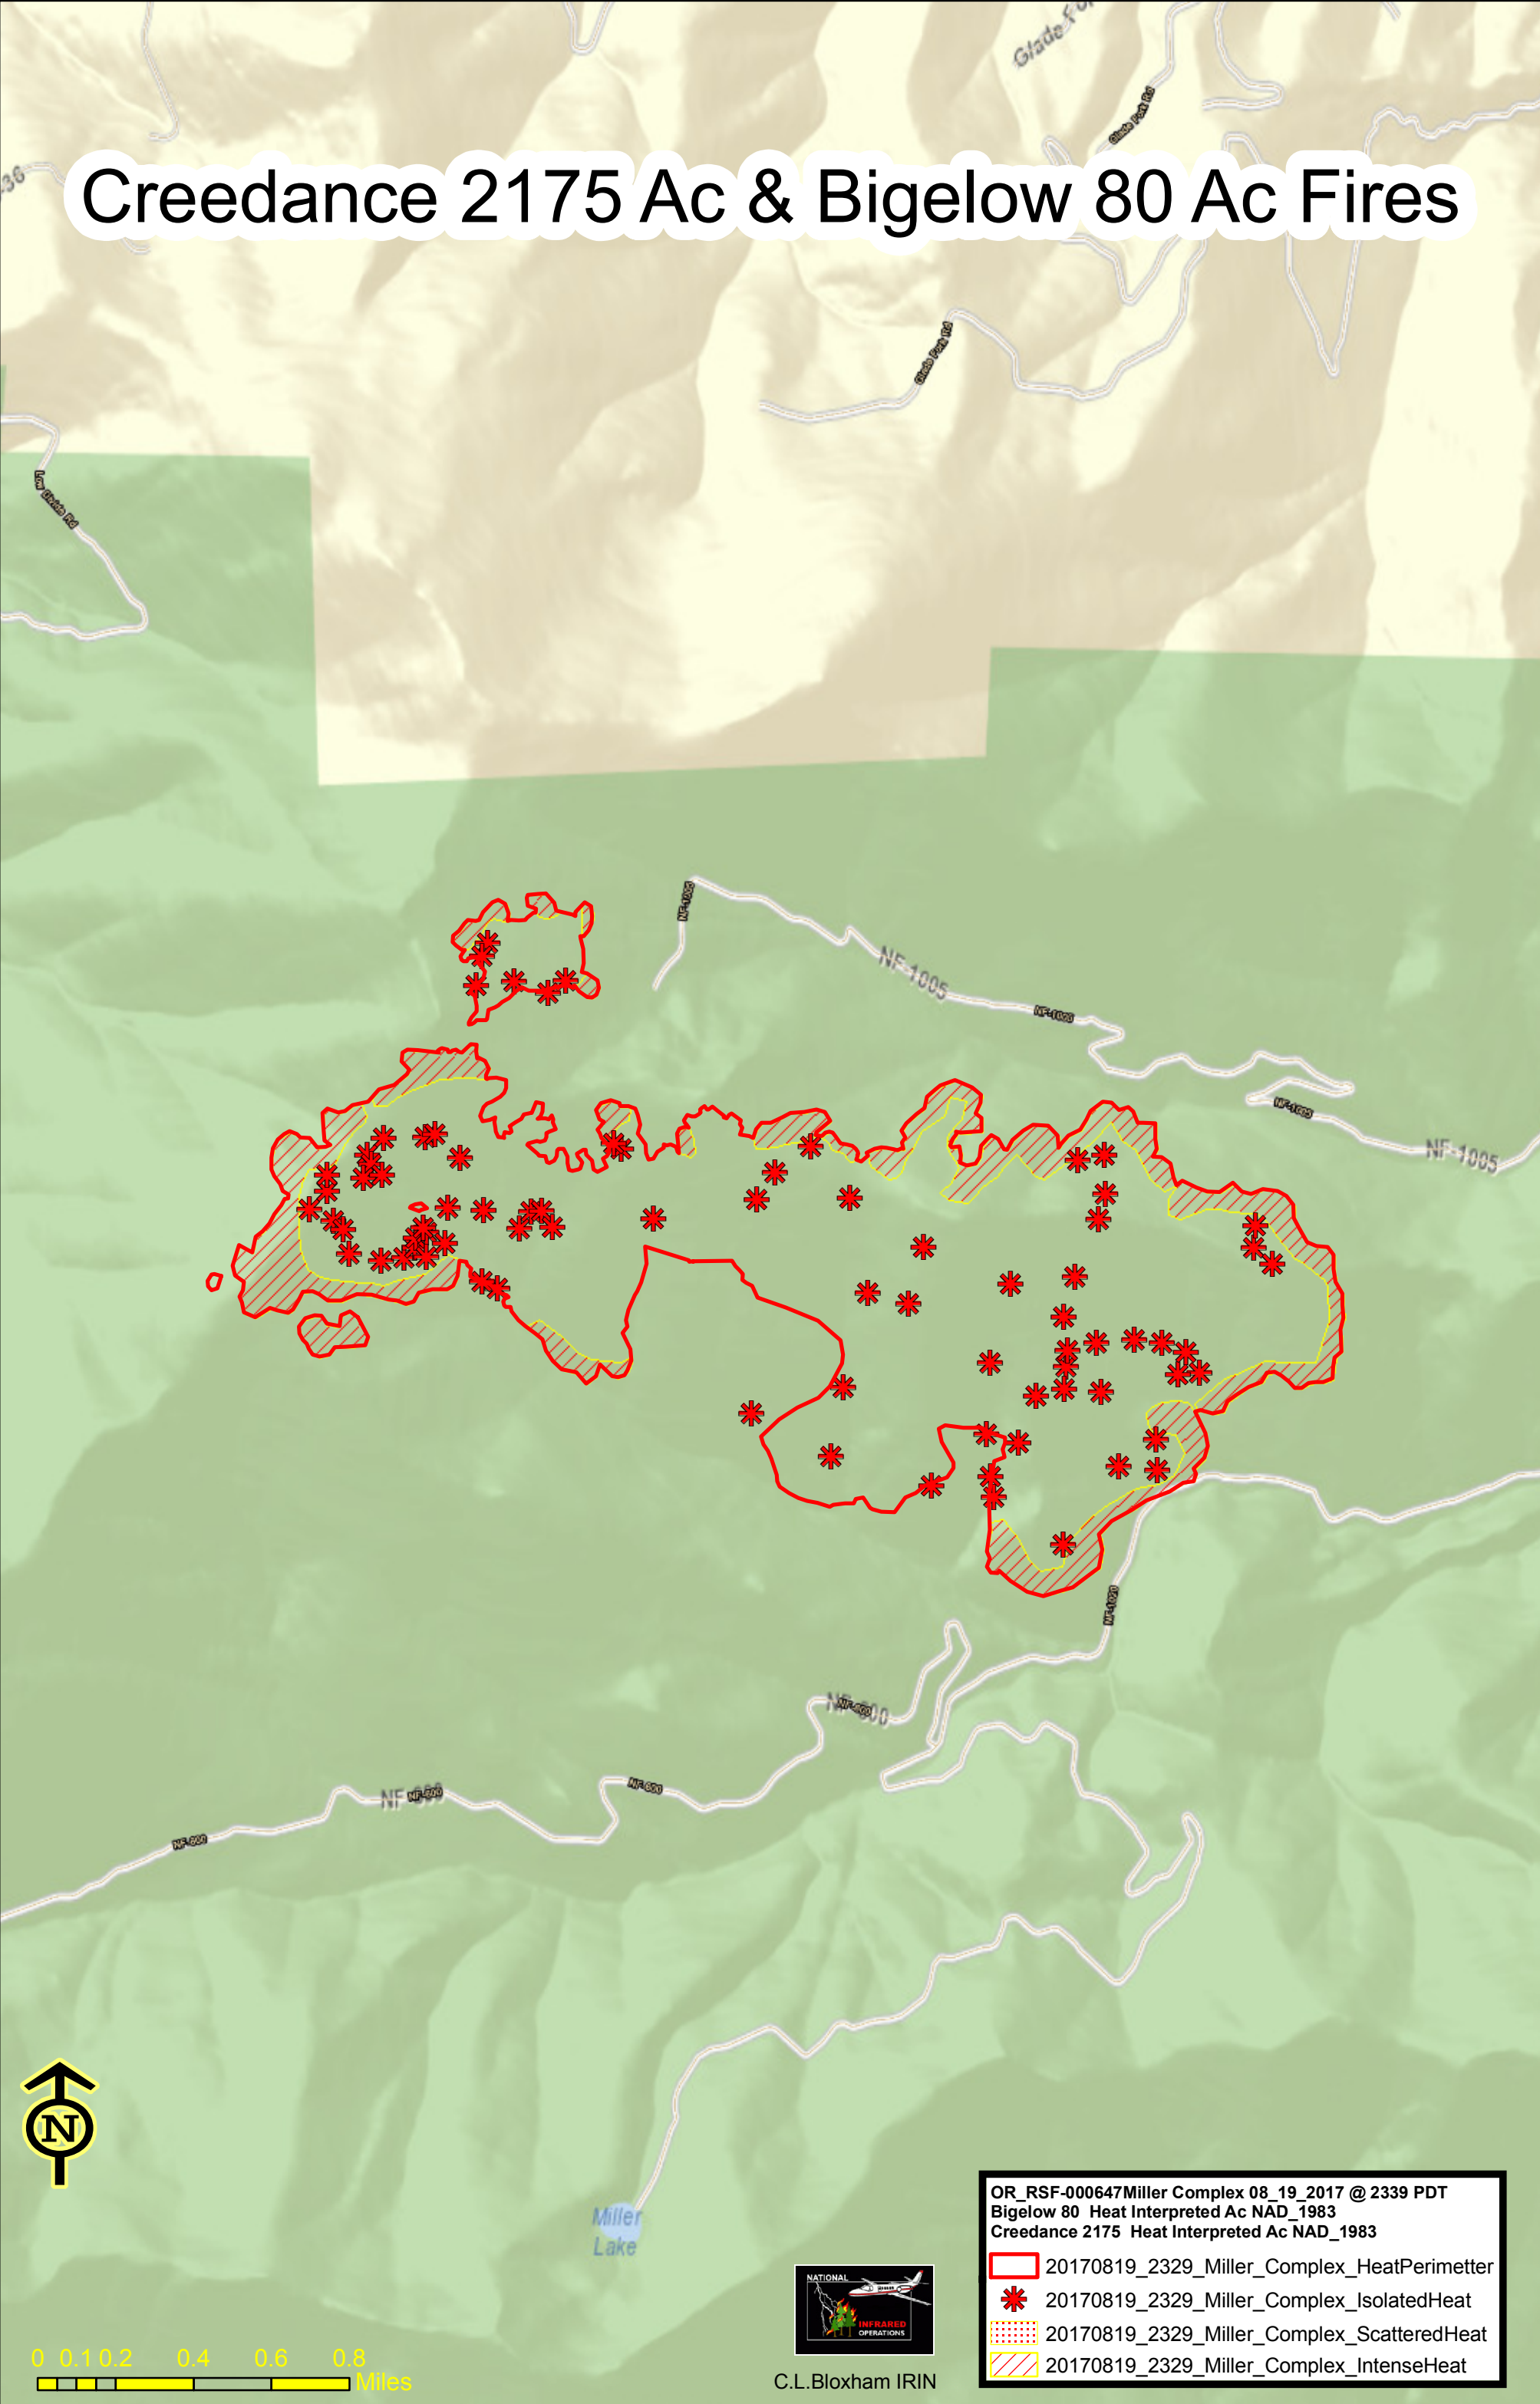

OR\_RSF-000647 Miller Complex 08\_19\_2017 @ 2339 PDT  
Bigelow 80 Heat Interpreted Ac NAD\_1983  
Creedance 2175 Heat Interpreted Ac NAD\_1983

-  20170819\_2329\_Miller\_Complex\_HeatPerimetter
-  20170819\_2329\_Miller\_Complex\_IsolatedHeat
-  20170819\_2329\_Miller\_Complex\_ScatteredHeat
-  20170819\_2329\_Miller\_Complex\_IntenseHeat



C.L. Bloxham IRIN