


# Div A/D - Repair Needed

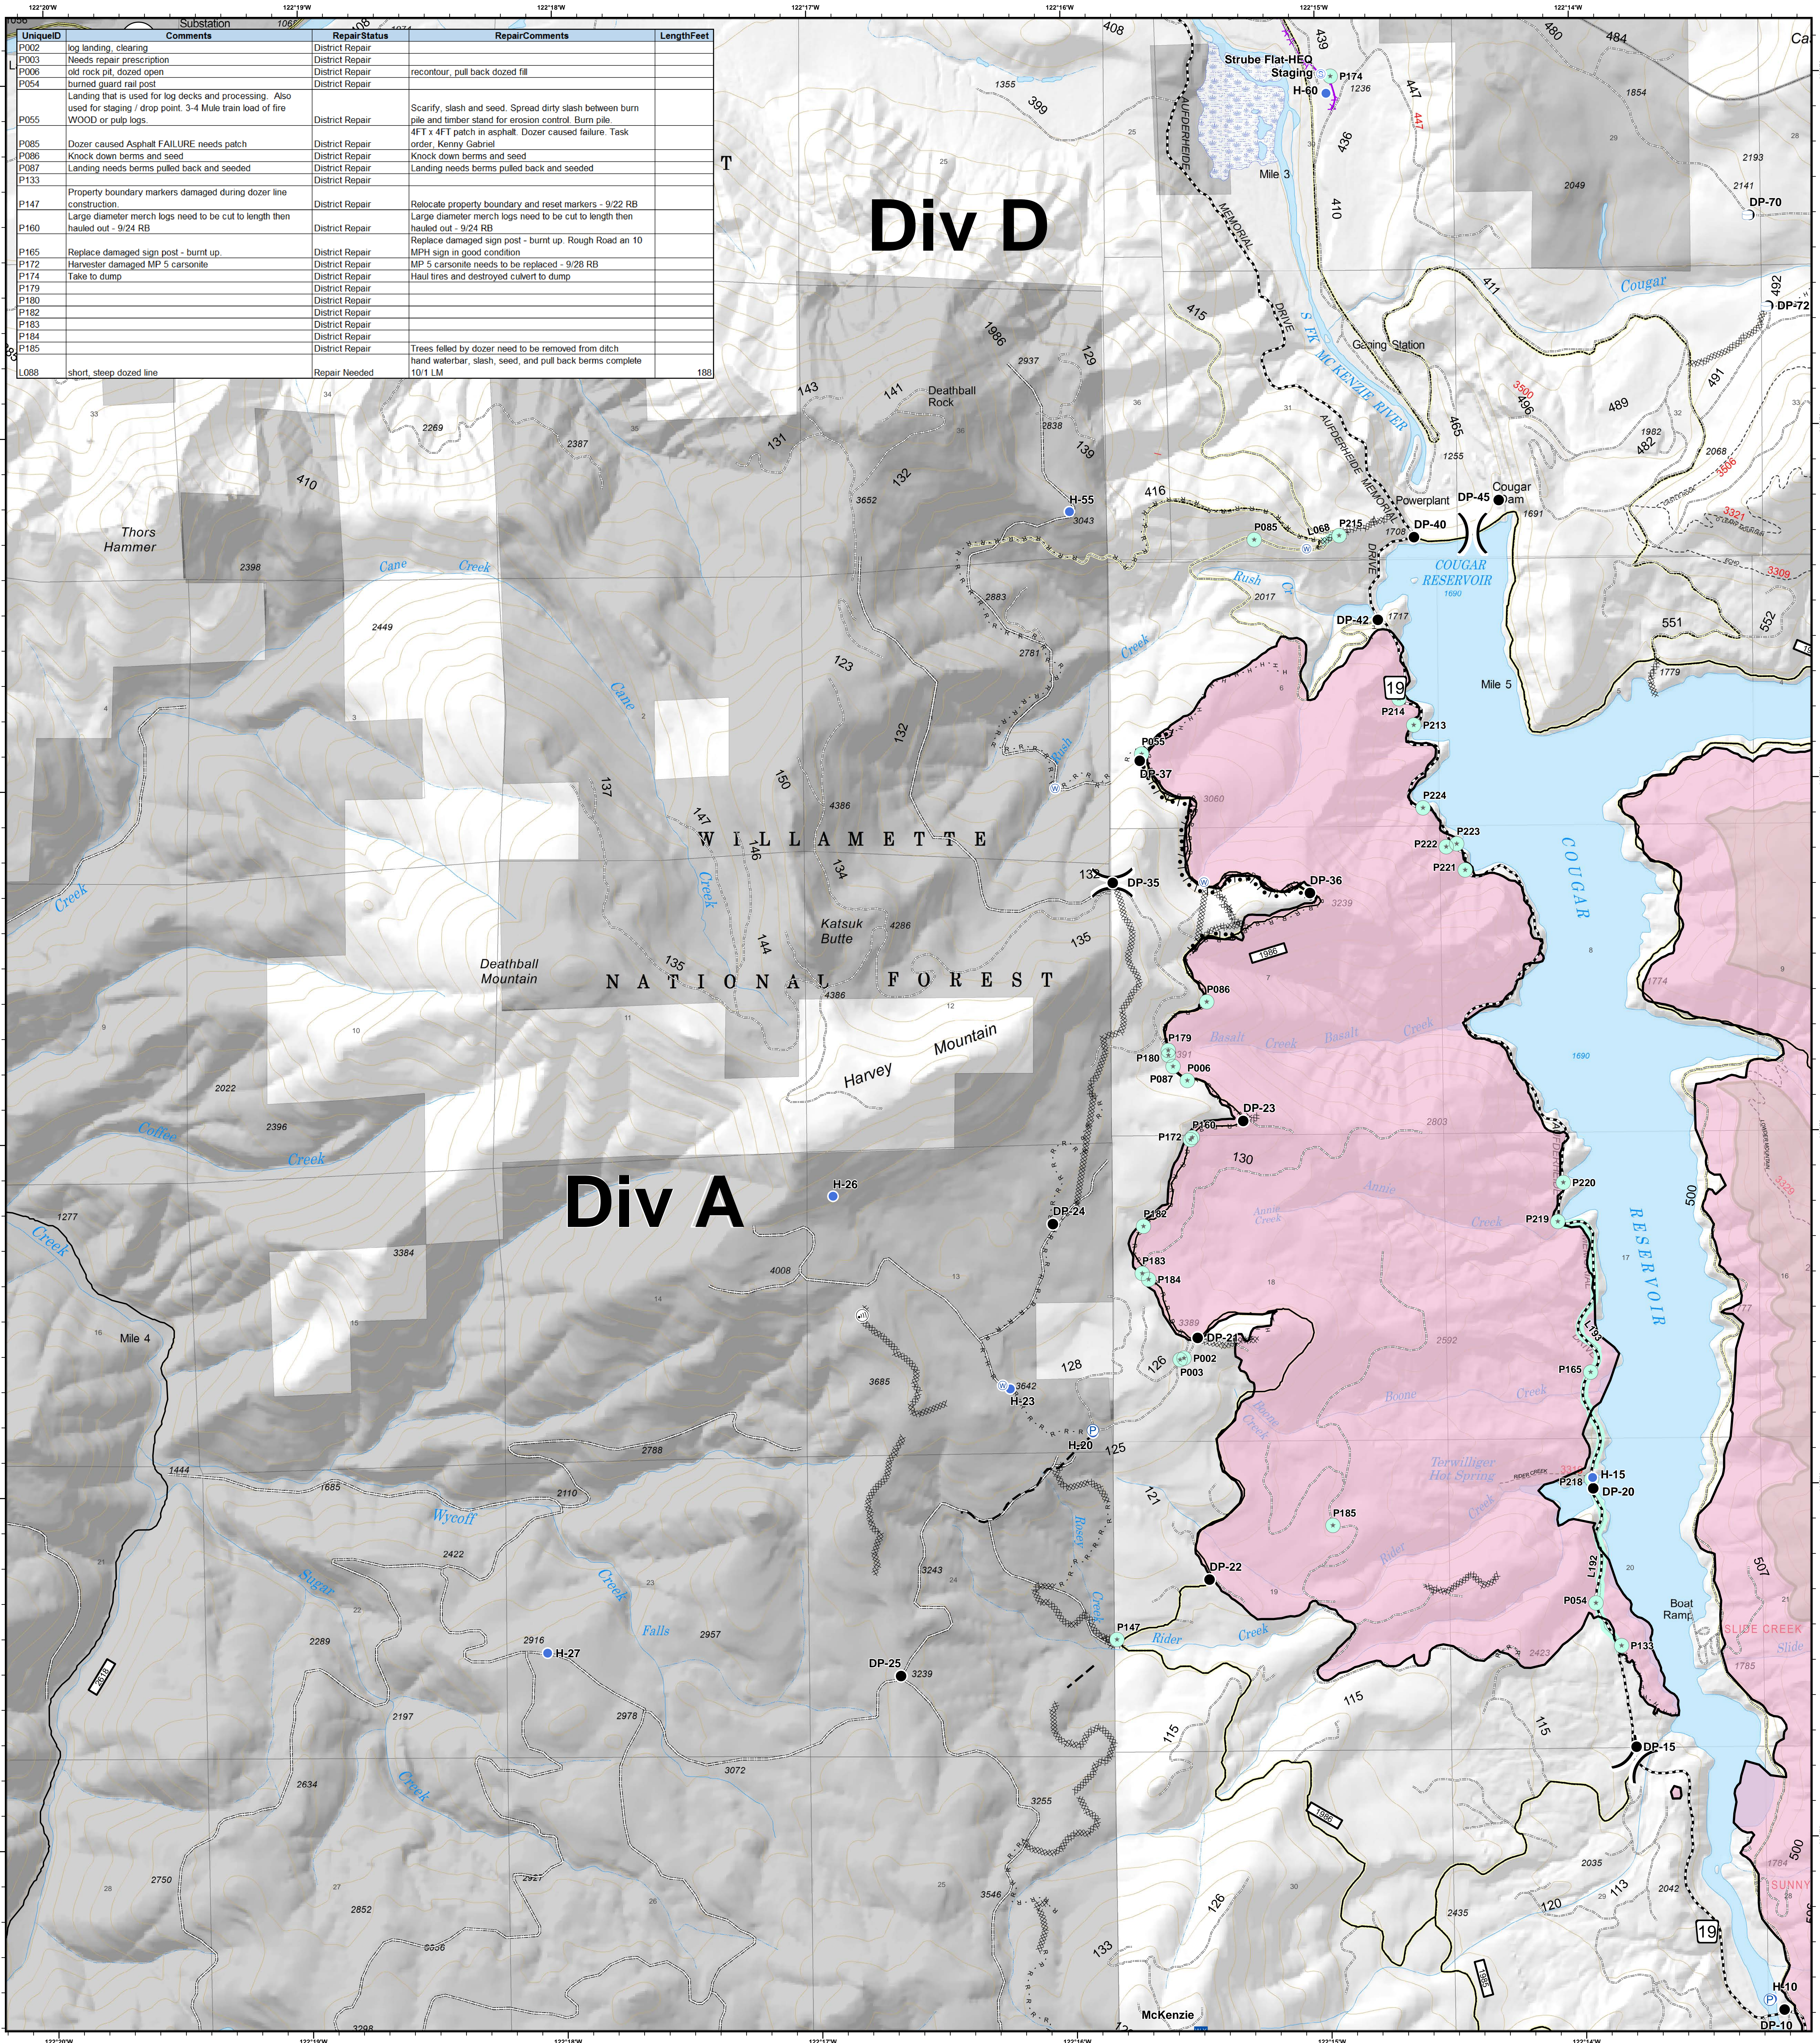

## Terwilliger OR-WIF-180227

Fire perimeter as of  
10/09/2018, 2354 hrs  
11,555 acres

Updated:  
Oct 22, 2018  
© 2029

- |                       |                   |                     |                          |                     |
|-----------------------|-------------------|---------------------|--------------------------|---------------------|
| <b>Repair Status</b>  | ● Drop Point      | ⊙ Water Source      | — Completed Line         | — State Highway     |
| ⊙ District Repair     | ● Helispot        | ⊙ Water Tank        | ⊘ Completed Dozer Line   | ⊘ Arterial Road     |
| ⊘ District Repair     | ⊙ Internet Access | ⊙ Value at Risk     | ⊘ Completed Hand Line    | ⊘ Collector Road    |
| ⊙ Mobile Weather Unit | ⊙ Pump            | ⊙ Division Break    | ⊘ Road as Completed Line | ⊘ Local Road        |
| ⊙ Staging Area        | ⊙ Powerlines      | ⊙ Completed Burnout | ⊘ Planned Fire Line      | ⊘ Private Ownership |
|                       |                   | ⊙ Powerlines        |                          | ⊘ US Forest Service |
|                       |                   |                     |                          | ⊘ Wilderness        |

NAD83 UTM10N